

**LEAD RISK ASSESSMENT
REPORT**

**RAVOUX HI-RISE APARTMENT BUILDING
280 Ravoux Street
St. Paul, Minnesota**

PREPARED FOR

**St. Paul Public Housing Agency
261 East University Avenue
St. Paul, Minnesota, 55103**

PREPARED BY

**Professional Service Industries, Inc.
2401 Pilot Knob Road, Suite 138
Mendota Heights, MN 55120**

**Phone # (651) 646-8148
Fax # (651) 646-8258**

PSI Project #0673226-11

June 9, 2011

June 9, 2011

Public Housing Agency of the City of St. Paul
 555 Wabasha Street North, Suite 400
 St. Paul, Minnesota 55102

Attn: Dave Lang
 St. Paul Public Housing

651-298-5664

Subject: LBP Inspection and Risk Assessment – 280 Ravoux Street, St. Paul, Minnesota 55102
 PSI Project No. 0673226-11

Dear Mr. Lang:

On November 8th, 2010 Mr. Michael Tjaden, Mr. Eric Brazeau, and Mr. Stephen Luth of Professional Service Industries, Inc. (PSI) conducted a combination lead-based paint inspection / risk assessment at the above address. Mr. Tjaden, Mr. Luth and Mr. Brazeau are certified Risk Assessors through the Minnesota Department of Health. The current owner of this property is the Public Housing Agency of the City of St. Paul (PHA). On May 9th, 2011, Mr. Luth returned to the building to conduct confirmation sampling of selected building components.

Were Lead-Based Paint (LBP) Hazards discovered at this residence? Yes No

A lead-based paint hazard is any of the following:

- LBP on a friction surface subject to abrasion and where the dust levels on the nearest horizontal surface (sill or floor) exceed the floor or window levels shown below.
- LBP damaged by impact
- LBP showing evidence of teeth marks
- Any other deteriorated LBP

Based on the HUD Guidelines, the following components must be treated as LBP throughout the building.

COMPONENT	# TESTED	# POSITIVE	% POSITIVE
RAIL / METAL	5	2	100.00%

In addition the following building components tested positive for lead. Although not technically lead-based paint, renovation, repair or other disturbance of these materials may result in lead dust exposure.

COMPONENT	# TESTED	# POSITIVE	% POSITIVE
SHOWER WALL TILE	28	5	17.85%

No other components tested were found to contain lead at greater than or equal to 1.0 mg/cm². Detailed XRF testing results are contained in Section A-1 of this report.

Were Lead Dust Hazards discovered at this residence?

Yes No

A lead-dust hazard is surface dust exceeding the levels shown below on one or more of the following components:

- Floors: 40µg/Square Foot
 - Window Sills: 250µg/Square Foot
 - Window Troughs 400µg/Square Foot
- Dust sample results location: Section A-2. Hazard recommendations: Section A-3

The average dust level for each category was determined to be:

WINDOW SILL	Floor
13.86 µg/SqFt	20.00 µg/SqFt

None of the individual dust wipe samples were found to contain lead dust above the respective regulatory standards.

Were Lead Soil Hazards discovered at this residence?

Yes No

A soil-lead hazard is bare soil containing 100 µg/g (micrograms per gram) in composited samples collected from the bare soil areas around the drip-line of the house or in the rest of the yard. Soil sample results are located in Section A-2 of this report. Hazard information and recommendations are located in Section A-3.

Bare Soil
20 µg/Kg

No lead hazards were identified in association with Ravoux Hi-Rise.

The simplest way to reduce lead exposures is through regular washing of hands, toys, and horizontal surfaces in the home with a liquid hand soap or dish soap and water. It is highly recommended that disposable cleaning materials be used to wash surfaces, so as not to re-contaminate them with a used mop or cloth. A guide to reducing lead hazards in the home is included in Section C of this report. Other ways of reducing lead hazards within the home include taking shoes off before entering living areas, letting water run prior to drinking or cooking, covering exposed soil with plant materials, and vacuuming with a High Efficiency Particulate Air (HEPA) filtered vacuum.

For more information regarding lead poisoning and prevention, contact your local health department or the National Lead Information Center (800-424-LEAD (5323)). Contact the Minnesota Department of Health Lead Program at (651) 215-0890 for information regarding lead hazard remediation or selection of qualified lead professionals. Additional Information is also available on the internet at <http://www.health.state.mn.us/divs/eh/lead/index.html>

The purpose of this lead-based paint investigation was to identify all painted and varnished surfaces for the presence of lead exceeding the regulatory level and to evaluate the property for the location, type and severity of existing or potential health hazards associated with lead-based paint, then develop recommendations for remediation of those hazards. The following report details the results of the assessment.


The findings of this report must be provided to each new lessee (tenant) or purchaser of this property under Federal law (24 CFR part 35 and 40 CFR part 745) before they become obligated under a lease or sales contract. The complete report must also be provided to purchasers and made available to tenants. Landlords (lessors) and sellers are also required to distribute an educational pamphlet approved by the U.S. Environmental Protection Agency (EPA), entitled Protect Your Family from Lead in Your Home, and include standard warning language in their leases or sales contracts to ensure that parents have the information they need to protect their children from lead-based paint hazards.

For more information regarding your obligations under federal lead-based paint regulations, contact the Minnesota Department of Health Lead Program at 651-215-0890.

We share your concern for the safety and well-being of your family or tenants and you are invited to call us at 651-646-8148 with any questions you may have concerning this report or your needs for additional guidance.

Sincerely,

Professional Service Industries, Inc.

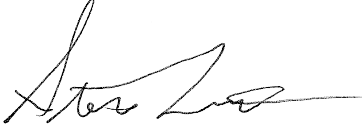

Stephen Luth, MDH Risk Assessor No. LR3835



Eric D. Brazeau, MDH Risk Assessor No. LR664



Michael Tjaden, MDH Risk Assessor No. LR316

INDEX AND SECTION INFORMATION

The report consists of the preceding cover letter which identifies all lead hazards found on the property and the following sections which provide detailed testing and evaluation information. Helpful information about contents and purpose is included on the cover page of each section.

NOTE: A checked box means that the section is included in this report

- Section A Hazard Assessment and Recommendations: This section includes:
A-1: XRF surface-by surface inventory of all painted and varnished components
A-2: Laboratory analysis of dust, soil and paint chips
A-3: Hazard remediation recommendations for hazards identified in Subparts A-1 and A-2
A-4: Field site sketch
- Section B Property Condition: Includes an assessment of the physical condition of the property and a summary of paint condition on selected surfaces.
- Section C Ownership and Occupants: Includes a physical description of the dwelling and property and information about the current occupants.
- Section D Sampling Procedures: Includes information on the methods used to collect paint, dust and soil samples.
- Section E Hazard Reduction Information and Related Requirements: This section provides guidance for the property owner if hazards have been identified as a result of this assessment.
- Section F PHA Management Information
- Section G Warranty
- Section H Certifications: Risk Assessor and Laboratory Certifications.

SECTION A: HAZARD ASSESSMENT & RECOMMENDATIONS

A-1:	COMPREHENSIVE LEAD-BASED PAINT INVESTIGATION
A-2:	RESULTS OF LABORATORY ANALYSIS
A-3:	HAZARD REMEDIATION RECOMMENDATIONS
A-4:	FIELD SITE SKETCH

The combination lead-based paint inspection / risk assessment conducted for this site was conducted in general accordance with the US Department of Housing and Urban Development (USHUD) Guidelines for the Evaluation and Control of Lead-Based Paint Hazards in Housing published in June, 1995 and revised in 1997. Risk assessment was conducted following a targeted sampling strategy. PSI requested that the PHA provide a list of units that fall into the targeted selection criteria. Based on the age of the apartment building and the number of apartments in the building, 20 units were selected for lead-based paint inspection and risk assessment. This included the targeted units identified by the PHA and additional randomly selected units for all remaining units. In addition, seven additional units were randomly selected, for a total of 27 units for lead-based paint inspection. Tenant accessible common areas and 50% of the hi-rise corridors were also included in the inspection / risk assessment.

A-1 COMPREHENSIVE LEAD-BASED PAINT INVESTIGATION

The following pages contain x-ray fluorescence (XRF) testing of painted and varnished components within selected tenant units, public common areas and on the exterior. XRF technology uses low-level radiation to induce energy in lead atoms within a painted surface, which the XRF unit is able to analyze. The device then displays the direct-reading results in milligrams of lead per square centimeter of surface area tested (mg/cm^2), and is able to determine if lead-based paint is present. Lead-based paint (LBP) is defined by state and federal regulations as surface coatings which contain $1.0 \text{ mg}/\text{cm}^2$ of lead, or greater. Information identifying paint-related hazards is also included in this section.

INSPECTION (PAINT TESTING):

All XRF testing results follow this page and are intended to comply with requirements and methods detailed in the U. S. Department of Housing and Urban Development Guidelines for the Evaluation and Control of Lead-Based Paint in Hazards and Housing, Chapter 7: Lead-Based Paint Inspection (1997 Revision). Lead inspections consist of a surface-by-surface investigation of all painted or varnished building components. XRF testing on this project was performed using a RMD LPA-1 X-ray fluorescence analyzer (XRF) Lead Paint Spectrum Analyzer, serial numbers 1149 and 1170, by risk assessors who have been trained in the use of this unit. The unit was operated in accordance with the Performance Characteristic Sheet (PCS) for the RMD LPA-1 XRF Lead Spectrum Analyzer.

REPORT TERMINOLOGY FOR INSPECTION-RELATED COLUMNS:

Column Title	Contents and abbreviations
Room #	The area or space being tested. May also be a common area or exterior area.
Component	The object or surface being tested
Location	All areas are oriented to walls A,B,C,D. This is described further below in section A-4.
Substrate	The underlying surface to which the paint or varnish has been applied. Wd=Wood, PP=Wallpaper, C=Concrete, Mt=Metal, St=Stone, Mas=Masonry, Pl=Plaster, ShRk=Sheetrock, Sc=Stucco
Color	Color of the painted area tested
Condition	G=Good, F=Fair, P=Poor
Reading	In milligrams per square centimeter (mg/cm^2) $1.0 \text{ mg}/\text{cm}^2$ or greater is lead-based paint.

LBP HAZARD ASSESSMENT:

Information identifying paint-related hazards is also included in this section.

A *lead-based paint hazard* is any of the following:

- LBP on a friction surface subject to abrasion and where the dust levels on the nearest horizontal surface (sill or floor) exceed the floor or window levels shown below.

- LBP damaged by impact
- LBP showing evidence of teeth marks
- Any other deteriorated LBP

REPORT TERMINOLOGY FOR LBP HAZARD-RELATED COLUMNS:

Column Title	Contents and abbreviations
Reading	In milligrams per square centimeter (mg/cm ²) 1.0 mg/cm ² or greater is lead-based paint.
Hazard Key	Refers the reader to section A-3 where recommendations to reduce or eliminate lead paint, dust, soil or other hazards are provided.

XRF TESTING SUMMARY
RAVOUX HI-RISE

BLDG Component	Substrate	# Tested	# Positive	% Positive
ACCESS PANEL	METAL	3	0	0.00%
BASEBOARD	TILE	1	0	0.00%
BASEBOARD	VINYL	115	0	0.00%
BENCH	METAL	1	0	0.00%
BOOKSHELF	WOOD	2	0	0.00%
BOX TRIM	WOOD	2	0	0.00%
CABINET	METAL	9	0	0.00%
CABINET	WOOD	54	0	0.00%
CABINET DOOR	WOOD	27	0	0.00%
CEILING	CONCRETE	88	0	0.00%
CEILING	DRYWALL	38	0	0.00%
CEILING	TILE	4	0	0.00%
CHAIR RAIL	WOOD	15	0	0.00%
CLOSET DOOR	LAMINATE	54	0	0.00%
CLOSET WALL	DRYWALL	34	0	0.00%
CLOSET WALL	PLASTER	20	0	0.00%
COLUMN	PLASTIC	1	0	0.00%
COLUMN	WOOD	2	0	0.00%
CROWN MOLDING	WOOD	4	0	0.00%
DOOR	METAL	20	0	0.00%
DOOR	WOOD	97	0	0.00%
DOOR CASING	WOOD	2	0	0.00%
DOOR FRAME	METAL	117	1	0.85%
DOOR FRAME	WOOD	2	0	0.00%
DRAIN PIPE	METAL	1	0	0.00%
ELECTRIC PANEL	METAL	18	0	0.00%
ELEVATOR DOOR FRAME	METAL	4	0	0.00%
FENCE	METAL	2	0	0.00%
FENCE	WOOD	1	0	0.00%
FIRE EXT. DOOR	METAL	4	0	0.00%
FIREPLACE FRAME	WOOD	2	0	0.00%
FIREPLACE TILE	TILE	1	0	0.00%
FLOOR	CARPET	1	0	0.00%
FLOOR	CONCRETE	6	0	0.00%
FLOOR	TERRAZZO	5	0	0.00%
FLOOR	TILE	99	0	0.00%
FLOOR	VINYL	21	0	0.00%
GARAGE DOOR	METAL	2	0	0.00%
LINTEL	METAL	1	0	0.00%
MAILBOX TRIM	WOOD	2	0	0.00%
PARTITIONS	METAL	2	0	0.00%
RADIATOR	METAL	70	0	0.00%
RAIL	METAL	5	2	40.00%
RAIL	WOOD	6	0	0.00%
SHELF	WOOD	1	0	0.00%
SHELF SUPPORT	WOOD	1	0	0.00%
SHOWER WALL	TILE	28	5	17.86%
SINK	PORCELIN	2	0	0.00%
SPRINKLER PIPE	METAL	3	0	0.00%
STAIR	CONCRETE	4	0	0.00%
TABLE SUPPORT	METAL	3	0	0.00%
TABLE SUPPORT	WOOD	1	0	0.00%
TUB	METAL	2	0	0.00%
TUB SURROUND	TILE	1	0	0.00%
VENT	METAL	34	0	0.00%
WALL	CONCRETE	75	0	0.00%
WALL	DRYWALL	351	0	0.00%
WALL	PLASTER	100	0	0.00%
WALL	TILE	11	0	0.00%
WALL TRIM	WOOD	20	0	0.00%
WINDOW FRAME	WOOD	7	0	0.00%
WINDOW TRIM	WOOD	2	0	0.00%

Project Name:	St. Paul PHA	XRF# 1149	1	2	3	TIME	
Project Number:	0673226-10	Test Block 1:	1.0	1.0	1.0	9:00	
Date:	11/8/2010	Test Block 2:	1.0	0.9	0.9	12:00	
Risk Assessor:	Mike Tjaden, Stephen Luth and Eric Brazeau	Test Block 3:	1.0	0.9	1.0	16:30	
		XRF# 1170					
		Test Block 1:	1.1	1.1	1.1	9:00	
		Test Block 2:	1.1	1.0	0.9	12:30	
		Test Block 3:	1.1	0.9	0.9	16:30	
Address:	Ravoux Hi Rise						
Unit:	280 Ravoux Street						

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
1	COMMON	8TH FLOOR LAUNDRY	WALL	A	CONCRETE	BEIGE	INTACT	0.3	
2	COMMON	8TH FLOOR LAUNDRY	WALL	B	DRYWALL	BEIGE	INTACT	0.0	
3	COMMON	8TH FLOOR LAUNDRY	WALL	C	DRYWALL	BEIGE	INTACT	0.0	
4	COMMON	8TH FLOOR LAUNDRY	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
5	COMMON	8TH FLOOR LAUNDRY	CEILING	A	TILE	WHITE	INTACT	0.2	
6	COMMON	8TH FLOOR LAUNDRY	FLOOR	C	TILE	TAN	INTACT	-0.1	
7	COMMON	8TH FLOOR LAUNDRY	ACCESS PANEL	C	METAL	TAN	INTACT	0.2	
8	COMMON	8TH FLOOR LAUNDRY	RADIATOR	C	METAL	BEIGE	INTACT	0.5	
9	COMMON	8TH FLOOR LAUNDRY	DOOR	D	WOOD	BEIGE	INTACT	-0.1	
10	COMMON	8TH FLOOR LAUNDRY	DOOR FRAME	D	METAL	BEIGE	INTACT	0.1	
11	COMMON	8TH FLOOR LAUNDRY	WINDOW FRAME	C	METAL	BEIGE	INTACT	0.3	
12	COMMON	8TH FLOOR LAUNDRY	TABLE SUPPORT	D	WOOD	BEIGE	INTACT	0.2	
13	COMMON	3RD FLOOR LAUNDRY	WALL	A	DRYWALL	WHITE	INTACT	-0.1	
14	COMMON	3RD FLOOR LAUNDRY	WALL	B	DRYWALL	WHITE	INTACT	0.1	
15	COMMON	3RD FLOOR LAUNDRY	WALL	C	DRYWALL	WHITE	INTACT	-0.2	
16	COMMON	3RD FLOOR LAUNDRY	WALL	D	CONCRETE	WHITE	INTACT	0.3	
17	COMMON	3RD FLOOR LAUNDRY	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
18	COMMON	3RD FLOOR LAUNDRY	FLOOR	A	TILE	WHITE	INTACT	0.3	
19	COMMON	3RD FLOOR LAUNDRY	ACCESS PANEL	D	METAL	WHITE	INTACT	0.4	
20	COMMON	3RD FLOOR LAUNDRY	RADIATOR	D	METAL	WHITE	INTACT	0.0	
21	COMMON	3RD FLOOR LAUNDRY	DOOR	C	WOOD	WHITE	INTACT	-0.2	
22	COMMON	3RD FLOOR LAUNDRY	DOOR FRAME	C	METAL	WHITE	INTACT	0.0	
23	COMMON	3RD FLOOR LAUNDRY	WINDOW FRAME	C	METAL	WHITE	INTACT	-0.2	
24	COMMON	3RD FLOOR LAUNDRY	TABLE SUPPORT	C	METAL	WHITE	INTACT	0.2	
25	COMMON	2ND FLOOR LAUNDRY	WALL	A	DRYWALL	WHITE	INTACT	0.2	
26	COMMON	2ND FLOOR LAUNDRY	WALL	B	DRYWALL	WHITE	INTACT	0.1	
27	COMMON	2ND FLOOR LAUNDRY	WALL	C	DRYWALL	WHITE	INTACT	-0.1	
28	COMMON	2ND FLOOR LAUNDRY	WALL	D	DRYWALL	WHITE	INTACT	0.3	
29	COMMON	2ND FLOOR LAUNDRY	CEILING	A	CONCRETE	WHITE	INTACT	0.6	
30	COMMON	2ND FLOOR LAUNDRY	FLOOR	A	TILE	WHITE	INTACT	-0.2	
31	COMMON	2ND FLOOR LAUNDRY	ACCESS PANEL	D	METAL	WHITE	INTACT	0.4	
32	COMMON	2ND FLOOR LAUNDRY	RADIATOR	D	METAL	WHITE	INTACT	0.1	
33	COMMON	2ND FLOOR LAUNDRY	DOOR	C	WOOD	WHITE	INTACT	0.1	
34	COMMON	2ND FLOOR LAUNDRY	DOOR FRAME	C	METAL	WHITE	INTACT	0.2	
35	COMMON	2ND FLOOR LAUNDRY	WINDOW FRAME	B	METAL	WHITE	INTACT	0.2	
36	COMMON	2ND FLOOR LAUNDRY	TABLE SUPPORT	B	METAL	WHITE	INTACT	-0.2	
37	COMMON	2ND FLOOR TUB ROOM	WALL	A	DRYWALL	WHITE	INTACT	-0.1	
38	COMMON	2ND FLOOR TUB ROOM	WALL	B	DRYWALL	WHITE	INTACT	-0.2	
39	COMMON	2ND FLOOR TUB ROOM	WALL	C	DRYWALL	WHITE	INTACT	0.3	
40	COMMON	2ND FLOOR TUB ROOM	WALL	D	DRYWALL	WHITE	INTACT	0.0	
41	COMMON	2ND FLOOR TUB ROOM	CEILING	A	CONCRETE	WHITE	INTACT	0.2	
42	COMMON	2ND FLOOR TUB ROOM	FLOOR	A	TILE	WHITE	INTACT	0.1	
43	COMMON	2ND FLOOR TUB ROOM	RADIATOR	B	METAL	WHITE	INTACT	-0.1	
44	COMMON	2ND FLOOR TUB ROOM	TUB	C	PORCELAIN	WHITE	INTACT	0.1	
45	COMMON	2ND FLOOR TUB ROOM	SHELF	C	WOOD	WHITE	INTACT	0.0	
46	COMMON	2ND FLOOR TUB ROOM	SHELF SUPPORT	C	WOOD	WHITE	INTACT	-0.1	
47	COMMON	2ND FLOOR TUB ROOM	VENT	D	METAL	WHITE	INTACT	0.0	
48	COMMON	2ND FLOOR TUB ROOM	DOOR	A	WOOD	WHITE	INTACT	0.3	
49	COMMON	2ND FLOOR TUB ROOM	DOOR FRAME	A	METAL	WHITE	INTACT	-0.2	
50	COMMON	1ST FLOOR LAUNDRY	WALL	A	PLASTER	WHITE	INTACT	-0.2	
51	COMMON	1ST FLOOR LAUNDRY	WALL	B	DRYWALL	WHITE	INTACT	0.3	
52	COMMON	1ST FLOOR LAUNDRY	WALL	C	DRYWALL	WHITE	INTACT	-0.2	
53	COMMON	1ST FLOOR LAUNDRY	WALL	D	PLASTER	WHITE	INTACT	0.3	
54	COMMON	1ST FLOOR LAUNDRY	CEILING	A	CONCRETE	WHITE	INTACT	0.6	
55	COMMON	1ST FLOOR LAUNDRY	FLOOR	A	TILE	WHITE	INTACT	-0.2	
56	COMMON	1ST FLOOR LAUNDRY	VENT	B	METAL	WHITE	INTACT	0.3	
57	COMMON	1ST FLOOR LAUNDRY	RADIATOR	D	METAL	WHITE	INTACT	0.3	
58	COMMON	1ST FLOOR LAUNDRY	TABLE SUPPORT	B	METAL	WHITE	INTACT	-0.1	
59	COMMON	1ST FLOOR LAUNDRY	DOOR	B	WOOD	WHITE	INTACT	-0.1	
60	COMMON	1ST FLOOR LAUNDRY	DOOR FRAME	B	METAL	WHITE	INTACT	-0.1	
61	COMMON	1ST FLOOR DINING ROOM	WALL	A	DRYWALL	WHITE	INTACT	0.5	
62	COMMON	1ST FLOOR DINING ROOM	WALL	B	DRYWALL	WHITE	INTACT	0.6	
63	COMMON	1ST FLOOR DINING ROOM	WALL	C	DRYWALL	WHITE	INTACT	0.4	
64	COMMON	1ST FLOOR DINING ROOM	WALL	D	DRYWALL	WHITE	INTACT	0.4	
65	COMMON	1ST FLOOR DINING ROOM	CEILING	A	DRYWALL	WHITE	INTACT	0.1	
66	COMMON	1ST FLOOR DINING ROOM	FLOOR	A	CARPET	BROWN	INTACT	0.4	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
67	COMMON	1ST FLOOR DINING ROOM	BASEBOARD	A	VINYL	BROWN	INTACT	0.5	
68	COMMON	1ST FLOOR DINING ROOM	COLUMN	B	WOOD	WHITE	INTACT	0.1	
69	COMMON	1ST FLOOR DINING ROOM	CHAIR RAIL	A	WOOD	WHITE	INTACT	0.5	
70	COMMON	1ST FLOOR DINING ROOM	BOOKSHELF	B	WOOD	BROWN	INTACT	0.4	
71	COMMON	1ST FLOOR DINING ROOM	FIREPLACE FRAME	B	WOOD	WHITE	INTACT	-0.2	
72	COMMON	1ST FLOOR DINING ROOM	CROWN MOLDING	A	WOOD	BROWN	INTACT	-0.1	
73	COMMON	1ST FLOOR DINING ROOM	FLOOR	A	TERRAZZO	WHITE	INTACT	-0.1	
74	COMMON	1ST FLOOR DINING ROOM	DOOR	B	WOOD	BROWN	INTACT	0.1	
75	COMMON	1ST FLOOR DINING ROOM	DOOR FRAME	B	WOOD	BROWN	INTACT	0.4	
76	COMMON	1ST FLOOR DINING ROOM	DOOR CASING	B	WOOD	BROWN	INTACT	0.1	
77	COMMON	1ST FLOOR DINING ROOM	DOOR	C	METAL	BROWN	INTACT	0.3	
78	COMMON	1ST FLOOR DINING ROOM	DOOR FRAME	C	METAL	BROWN	INTACT	0.0	
79	COMMON	1ST FLOOR DINING ROOM	CROWN MOLDING	B	WOOD	GREEN	INTACT	0.1	
80	COMMON	1ST FLOOR DINING ROOM	WINDOW FRAME	B	METAL	BROWN	INTACT	0.3	
81	COMMON	1ST FLOOR CORRIDOR	WALL	A	DRYWALL	WHITE	INTACT	0.2	
82	COMMON	1ST FLOOR CORRIDOR	WALL	B	DRYWALL	WHITE	INTACT	0.1	
83	COMMON	1ST FLOOR CORRIDOR	WALL	C	DRYWALL	WHITE	INTACT	0.2	
84	COMMON	1ST FLOOR CORRIDOR	WALL	D	DRYWALL	WHITE	INTACT	0.1	
85	COMMON	1ST FLOOR CORRIDOR	CEILING	A	DRYWALL	WHITE	INTACT	0.1	
86	COMMON	1ST FLOOR CORRIDOR	FLOOR	A	TERRAZZO	WHITE	INTACT	0.1	
87	COMMON	1ST FLOOR CORRIDOR	BASEBOARD	D	VINYL	BROWN	INTACT	-0.1	
88	COMMON	1ST FLOOR CORRIDOR	RADIATOR	C	METAL	WHITE	INTACT	0.1	
89	COMMON	1ST FLOOR CORRIDOR	VENT	A	METAL	WHITE	INTACT	-0.2	
90	COMMON	1ST FLOOR CORRIDOR	MAILBOX TRIM	D	WOOD	WHITE	INTACT	0.1	
91	COMMON	1ST FLOOR CORRIDOR	RAIL	B	WOOD	BROWN	INTACT	0.3	
92	COMMON	1ST FLOOR CORRIDOR	WINDOW TRIM	B	METAL	WHITE	INTACT	0.3	
93	COMMON	1ST FLOOR CORRIDOR	CHAIR RAIL	B	WOOD	WHITE	INTACT	0.0	
94	COMMON	1ST FLOOR CORRIDOR	DOOR	B	WOOD	WHITE	INTACT	-0.1	
95	COMMON	1ST FLOOR CORRIDOR	DOOR FRAME	B	METAL	WHITE	INTACT	-0.1	
96	COMMON	1ST FLOOR CORRIDOR	BOX TRIM	D	WOOD	BROWN	INTACT	0.1	
97	COMMON	1ST FLOOR CORRIDOR	DOOR	C	METAL	WHITE	INTACT	0.0	
98	COMMON	1ST FLOOR CORRIDOR	DOOR FRAME	C	METAL	WHITE	INTACT	0.1	
99	COMMON	1ST FLOOR DINING ROOM	BASEBOARD	A	VINYL	BROWN	INTACT	0.5	
100	COMMON	1ST FLOOR DINING ROOM	COLUMN	B	WOOD	WHITE	INTACT	0.1	
101	COMMON	1ST FLOOR DINING ROOM	CHAIR RAIL	A	WOOD	WHITE	INTACT	0.5	
102	COMMON	1ST FLOOR DINING ROOM	BOOKSHELF	B	WOOD	BROWN	INTACT	0.4	
103	COMMON	1ST FLOOR DINING ROOM	FIREPLACE FRAME	B	WOOD	WHITE	INTACT	0.0	
104	COMMON	1ST FLOOR DINING ROOM	FIREPLACE TILE	B	TILE	GREEN	INTACT	0.2	
105	COMMON	1ST FLOOR DINING ROOM	CROWN MOLDING	A	WOOD	BROWN	INTACT	0.2	
106	COMMON	1ST FLOOR DINING ROOM	FLOOR	A	TERRAZZO	WHITE	INTACT	0.1	
107	COMMON	1ST FLOOR DINING ROOM	DOOR	B	WOOD	BROWN	INTACT	0.1	
108	COMMON	1ST FLOOR DINING ROOM	DOOR FRAME	B	METAL	BROWN	INTACT	0.4	
109	COMMON	1ST FLOOR DINING ROOM	DOOR CASING	B	WOOD	BROWN	INTACT	0.1	
110	COMMON	1ST FLOOR DINING ROOM	DOOR	C	METAL	BROWN	INTACT	0.0	
111	COMMON	1ST FLOOR DINING ROOM	DOOR FRAME	C	METAL	BROWN	INTACT	-0.1	
112	COMMON	1ST FLOOR DINING ROOM	CROWN MOLDING	B	WOOD	GREEN	INTACT	0.1	
113	COMMON	1ST FLOOR DINING ROOM	WINDOW FRAME	B	METAL	BROWN	INTACT	0.3	
114	COMMON	1ST FLOOR CORRIDOR	WALL	A	DRYWALL	WHITE	INTACT	0.2	
115	COMMON	1ST FLOOR CORRIDOR	WALL	B	DRYWALL	WHITE	INTACT	0.1	
116	COMMON	1ST FLOOR CORRIDOR	WALL	C	DRYWALL	WHITE	INTACT	0.2	
117	COMMON	1ST FLOOR CORRIDOR	WALL	D	DRYWALL	WHITE	INTACT	0.0	
118	COMMON	1ST FLOOR CORRIDOR	CEILING	A	DRYWALL	WHITE	INTACT	0.1	
119	COMMON	1ST FLOOR CORRIDOR	FLOOR	A	TERRAZZO	WHITE	INTACT	-0.2	
120	COMMON	1ST FLOOR CORRIDOR	BASEBOARD	D	VINYL	BROWN	INTACT	-0.1	
121	COMMON	1ST FLOOR CORRIDOR	RADIATOR	C	METAL	WHITE	INTACT	0.1	
122	COMMON	1ST FLOOR CORRIDOR	VENT	A	METAL	WHITE	INTACT	-0.2	
123	COMMON	1ST FLOOR CORRIDOR	MAILBOX TRIM	D	WOOD	WHITE	INTACT	0.3	
124	COMMON	1ST FLOOR CORRIDOR	RAIL	B	WOOD	BROWN	INTACT	-0.1	
125	COMMON	1ST FLOOR CORRIDOR	WINDOW TRIM	B	METAL	WHITE	INTACT	0.0	
126	COMMON	1ST FLOOR CORRIDOR	CHAIR RAIL	B	WOOD	WHITE	INTACT	-0.2	
127	COMMON	1ST FLOOR CORRIDOR	DOOR	B	WOOD	WHITE	INTACT	-0.1	
128	COMMON	1ST FLOOR CORRIDOR	DOOR FRAME	B	METAL	WHITE	INTACT	-0.1	
129	COMMON	1ST FLOOR CORRIDOR	BOX TRIM	D	WOOD	BROWN	INTACT	0.1	
130	COMMON	1ST FLOOR CORRIDOR	DOOR	C	METAL	WHITE	INTACT	-0.2	
131	COMMON	1ST FLOOR CORRIDOR	DOOR FRAME	C	METAL	WHITE	INTACT	0.1	
132	COMMON	1ST FLOOR ENTRY	WALL	B	DRYWALL	WHITE	INTACT	-0.2	
133	COMMON	1ST FLOOR ENTRY	WALL	D	DRYWALL	WHITE	INTACT	0.1	
134	COMMON	1ST FLOOR ENTRY	CEILING	A	DRYWALL	WHITE	INTACT	0.3	
135	COMMON	1ST FLOOR ENTRY	FLOOR	A	TERRAZZO	WHITE	INTACT	-0.2	
136	COMMON	1ST FLOOR ENTRY	BASEBOARD	B	TILE	WHITE	INTACT	0.3	
137	COMMON	1ST FLOOR ENTRY	RADIATOR	D	METAL	WHITE	INTACT	0.1	
138	COMMON	1ST FLOOR ENTRY	WINDOW FRAME	D	METAL	WHITE	INTACT	0.4	
139	COMMON	1ST FLOOR MEN' S RESTROOM	WALL	A	DRYWALL	WHITE	INTACT	0.3	
140	COMMON	1ST FLOOR MEN' S RESTROOM	WALL	B	DRYWALL	WHITE	INTACT	0.3	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
141	COMMON	1ST FLOOR MEN' S RESTROOM	WALL	C	DRYWALL	WHITE	INTACT	0.0	
142	COMMON	1ST FLOOR MEN' S RESTROOM	WALL	D	DRYWALL	WHITE	INTACT	0.3	
143	COMMON	1ST FLOOR MEN' S RESTROOM	FLOOR	A	TILE	WHITE	INTACT	-0.1	
144	COMMON	1ST FLOOR MEN' S RESTROOM	SINK	B	PORCELAIN	WHITE	INTACT	0.3	
145	COMMON	1ST FLOOR MEN' S RESTROOM	PARTITION	C	METAL	BLUE	INTACT	0.1	
146	COMMON	1ST FLOOR MEN' S RESTROOM	WALL	A	TILE	WHITE	INTACT	0.0	
147	COMMON	1ST FLOOR MEN' S RESTROOM	WALL	B	TILE	WHITE	INTACT	0.3	
148	COMMON	1ST FLOOR MEN' S RESTROOM	WALL	C	TILE	WHITE	INTACT	-0.1	
149	COMMON	1ST FLOOR MEN' S RESTROOM	WALL	D	TILE	WHITE	INTACT	0.1	
150	COMMON	1ST FLOOR WOMEN'S RESTROOM	WALL	A	DRYWALL	WHITE	INTACT	-0.2	
151	COMMON	1ST FLOOR WOMEN'S RESTROOM	WALL	B	DRYWALL	WHITE	INTACT	0.3	
152	COMMON	1ST FLOOR WOMEN'S RESTROOM	WALL	C	DRYWALL	WHITE	INTACT	-0.1	
153	COMMON	1ST FLOOR WOMEN'S RESTROOM	WALL	D	DRYWALL	WHITE	INTACT	-0.2	
154	COMMON	1ST FLOOR WOMEN'S RESTROOM	FLOOR	A	TILE	WHITE	INTACT	0.0	
155	COMMON	1ST FLOOR WOMEN'S RESTROOM	SINK	D	PORCELAIN	WHITE	INTACT	0.2	
156	COMMON	1ST FLOOR WOMEN'S RESTROOM	PARTITIONS	D	METAL	BLUE	INTACT	-0.2	
157	COMMON	1ST FLOOR WOMEN'S RESTROOM	DOOR	D	WOOD	BROWN	INTACT	0.1	
158	COMMON	1ST FLOOR WOMEN'S RESTROOM	DOOR FRAME	D	METAL	BROWN	INTACT	0.3	
159	COMMON	7TH FLOOR	WALL	A	DRYWALL	WHITE	INTACT	0.1	
160	COMMON	7TH FLOOR	WALL	B	DRYWALL	WHITE	INTACT	-0.2	
161	COMMON	7TH FLOOR	WALL	C	DRYWALL	WHITE	INTACT	0.0	
162	COMMON	7TH FLOOR	WALL	D	DRYWALL	WHITE	INTACT	0.1	
163	COMMON	7TH FLOOR	CEILING	A	DRYWALL	WHITE	INTACT	0.2	
164	COMMON	7TH FLOOR	FLOOR	A	TILE	WHITE	INTACT	0.2	
165	COMMON	7TH FLOOR	BASEBOARD	B	VINYL	BROWN	INTACT	0.1	
166	COMMON	7TH FLOOR	CHAIR RAIL	B	WOOD	GREEN	INTACT	-0.2	
167	COMMON	7TH FLOOR	RAIL	B	WOOD	BROWN	INTACT	-0.2	
168	COMMON	7TH FLOOR	DOOR	B	WOOD	GREEN	INTACT	0.0	
169	COMMON	7TH FLOOR	DOOR FRAME	B	METAL	GREEN	INTACT	-0.2	
170	COMMON	7TH FLOOR	DOOR	A	METAL	WHITE	INTACT	0.2	
171	COMMON	7TH FLOOR	DOOR FRAME	A	METAL	WHITE	INTACT	0.2	
172	COMMON	7TH FLOOR	FIRE EXTINGUISHER	D	METAL	WHITE	INTACT	0.1	
173	COMMON	7TH FLOOR	ELEVATOR DOOR FR	B	METAL	WHITE	INTACT	0.2	
174	COMMON	7TH FLOOR	VENT	B	METAL	WHITE	INTACT	0.2	
175	COMMON	5TH FLOOR	WALL	A	DRYWALL	WHITE	INTACT	0.1	
176	COMMON	5TH FLOOR	WALL	B	DRYWALL	WHITE	INTACT	-0.2	
177	COMMON	5TH FLOOR	WALL	C	DRYWALL	WHITE	INTACT	0.3	
178	COMMON	5TH FLOOR	WALL	D	DRYWALL	WHITE	INTACT	-0.2	
179	COMMON	5TH FLOOR	CEILING	A	DRYWALL	WHITE	INTACT	0.3	
180	COMMON	5TH FLOOR	FLOOR	A	TILE	WHITE	INTACT	0.1	
181	COMMON	5TH FLOOR	BASEBOARD	B	VINYL	BROWN	INTACT	0.3	
182	COMMON	5TH FLOOR	CHAIR RAIL	B	WOOD	GREEN	INTACT	0.1	
183	COMMON	5TH FLOOR	RAIL	B	WOOD	BROWN	INTACT	0.2	
184	COMMON	5TH FLOOR	DOOR	B	WOOD	GREEN	INTACT	-0.2	
185	COMMON	5TH FLOOR	DOOR FRAME	B	METAL	GREEN	INTACT	-0.2	
186	COMMON	5TH FLOOR	DOOR	A	METAL	WHITE	INTACT	-0.2	
187	COMMON	5TH FLOOR	DOOR FRAME	A	METAL	WHITE	INTACT	0.3	
188	COMMON	5TH FLOOR	FIRE EXTINGUISHER	B	METAL	WHITE	INTACT	-0.1	
189	COMMON	5TH FLOOR	ELEVATOR DOOR FR	D	METAL	WHITE	INTACT	0.2	
190	COMMON	5TH FLOOR	VENT	B	METAL	WHITE	INTACT	0.0	
191	COMMON	5TH FLOOR	WALL	A	TILE	GREEN	INTACT	0.3	
192	COMMON	3RD FLOOR	WALL	A	DRYWALL	WHITE	INTACT	-0.2	
193	COMMON	3RD FLOOR	WALL	B	DRYWALL	WHITE	INTACT	0.1	
194	COMMON	3RD FLOOR	WALL	C	DRYWALL	WHITE	INTACT	0.1	
195	COMMON	3RD FLOOR	WALL	D	DRYWALL	WHITE	INTACT	0.3	
196	COMMON	3RD FLOOR	CEILING	A	CONCRETE	WHITE	INTACT	0.1	
197	COMMON	3RD FLOOR	FLOOR	A	TILE	WHITE	INTACT	-0.1	
198	COMMON	3RD FLOOR	BASEBOARD	D	VINYL	BROWN	INTACT	0.3	
199	COMMON	3RD FLOOR	CHAIR RAIL	D	WOOD	GREEN	INTACT	-0.1	
200	COMMON	3RD FLOOR	RAIL	B	WOOD	BROWN	INTACT	0.2	
201	COMMON	3RD FLOOR	DOOR	B	WOOD	GREEN	INTACT	-0.2	
202	COMMON	3RD FLOOR	DOOR FRAME	B	METAL	GREEN	INTACT	0.1	
203	COMMON	3RD FLOOR	DOOR	C	METAL	WHITE	INTACT	-0.2	
204	COMMON	3RD FLOOR	DOOR FRAME	C	METAL	WHITE	INTACT	-0.2	
205	COMMON	3RD FLOOR	FIRE EXTINGUISHER	D	METAL	WHITE	INTACT	0.5	
206	COMMON	3RD FLOOR	ELEVATOR DOOR FR	B	METAL	WHITE	INTACT	-0.2	
207	COMMON	3RD FLOOR	VENT	B	METAL	WHITE	INTACT	0.5	
208	COMMON	3RD FLOOR	WALL	A	TILE	WHITE	INTACT	0.3	
209	COMMON	1ST FLOOR	WALL	A	DRYWALL	WHITE	INTACT	0.3	
210	COMMON	1ST FLOOR	WALL	B	DRYWALL	WHITE	INTACT	0.3	
211	COMMON	1ST FLOOR	WALL	C	DRYWALL	WHITE	INTACT	0.2	
212	COMMON	1ST FLOOR	WALL	D	DRYWALL	WHITE	INTACT	0.1	
213	COMMON	1ST FLOOR	CEILING	A	CONCRETE	WHITE	INTACT	0.2	
214	COMMON	1ST FLOOR	FLOOR	A	TILE	WHITE	INTACT	0.0	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
215	COMMON	1ST FLOOR	BASEBOARD	B	VINYL	BROWN	INTACT	-0.1	
216	COMMON	1ST FLOOR	CHAIR RAIL	B	WOOD	GREEN	INTACT	0.2	
217	COMMON	1ST FLOOR	RAIL	B	WOOD	BROWN	INTACT	-0.2	
218	COMMON	1ST FLOOR	DOOR	B	WOOD	GREEN	INTACT	0.2	
219	COMMON	1ST FLOOR	DOOR FRAME	B	METAL	BROWN	INTACT	0.0	
220	COMMON	1ST FLOOR	DOOR	D	WOOD	WHITE	INTACT	-0.1	
221	COMMON	1ST FLOOR	DOOR FRAME	D	METAL	WHITE	INTACT	-0.2	
222	COMMON	1ST FLOOR	FIRE EXTINGUISHER	D	METAL	WHITE	INTACT	0.3	
223	COMMON	1ST FLOOR	ELEVATOR DOOR FR	B	METAL	WHITE	INTACT	-0.2	
224	COMMON	1ST FLOOR	VENT	D	METAL	WHITE	INTACT	0.3	
225	COMMON	1ST FLOOR	WALL	A	TILE	GREEN	INTACT	0.1	
226	COMMON	8TH FLOOR TUB ROOM	WALL	A	DRYWALL	BEIGE	INTACT	0.3	
227	COMMON	8TH FLOOR TUB ROOM	WALL	B	DRYWALL	BEIGE	INTACT	-0.1	
228	COMMON	8TH FLOOR TUB ROOM	WALL	C	DRYWALL	BEIGE	INTACT	0.1	
229	COMMON	8TH FLOOR TUB ROOM	WALL	D	DRYWALL	BEIGE	INTACT	0.1	
230	COMMON	8TH FLOOR TUB ROOM	CEILING	D	DRYWALL	WHITE	INTACT	0.1	
231	COMMON	8TH FLOOR TUB ROOM	FLOOR	D	TILE	TAN	INTACT	-0.1	
232	COMMON	8TH FLOOR TUB ROOM	DOOR	A	WOOD	BEIGE	INTACT	0.1	
233	COMMON	8TH FLOOR TUB ROOM	DOOR FRAME	A	METAL	BEIGE	INTACT	0.1	
234	COMMON	8TH FLOOR TUB ROOM	RADIATOR	B	METAL	BEIGE	INTACT	0.1	
235	COMMON	8TH FLOOR TUB ROOM	VENT	D	METAL	BEIGE	INTACT	0.2	
236	COMMON	8TH FLOOR TUB ROOM	TUB SURROUND	C	TILE	TAN	INTACT	0.3	
237	COMMON	8TH FLOOR TUB ROOM	TUB	C	METAL	WHITE	INTACT	0.1	
238	COMMON	8TH FLOOR BALCONY	DOOR	C	METAL	BROWN	POOR	-0.2	
239	COMMON	8TH FLOOR BALCONY	DOOR FRAME	C	METAL	TAN	POOR	0.1	
240	COMMON	8TH FLOOR BALCONY	RAILING	C	METAL	TAN	POOR	-0.1	
241	COMMON	4TH FLOOR BALCONY	DOOR	C	METAL	TAN	POOR	0.3	
242	COMMON	4TH FLOOR BALCONY	DOOR FRAME	C	METAL	TAN	POOR	-0.2	
243	COMMON	4TH FLOOR BALCONY	RAILING	C	METAL	TAN	POOR	0.1	
244	COMMON	4TH FLOOR SHOWER ROOM	WALL	A	DRYWALL	BEIGE	INTACT	0.1	
245	COMMON	4TH FLOOR SHOWER ROOM	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
246	COMMON	4TH FLOOR SHOWER ROOM	WALL	C	DRYWALL	BEIGE	INTACT	0.3	
247	COMMON	4TH FLOOR SHOWER ROOM	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
248	COMMON	4TH FLOOR SHOWER ROOM	CEILING	D	DRYWALL	WHITE	INTACT	-0.1	
249	COMMON	4TH FLOOR SHOWER ROOM	FLOOR	D	TILE	TAN	INTACT	0.1	
250	COMMON	4TH FLOOR SHOWER ROOM	DOOR	D	METAL	BEIGE	INTACT	0.0	
251	COMMON	4TH FLOOR SHOWER ROOM	DOOR FRAME	A	METAL	BEIGE	INTACT	0.1	
252	COMMON	4TH FLOOR SHOWER ROOM	RADIATOR	A	METAL	BROWN	INTACT	0.2	
253	COMMON	4TH FLOOR SHOWER ROOM	VENT	D	METAL	BEIGE	INTACT	0.4	
254	COMMON	4TH FLOOR SHOWER ROOM	DRAIN PIPE	D	METAL	BEIGE	INTACT	0.4	
255	COMMON	4TH FLOOR SHOWER ROOM	SHOWER WALL	B	TILE	TAN	INTACT	-0.2	
256	COMMON	CENTER STAIRS	WALL	B	CONCRETE	BEIGE	INTACT	0.3	
257	COMMON	CENTER STAIRS	WALL	C	CONCRETE	BEIGE	INTACT	0.3	
258	COMMON	CENTER STAIRS	WALL	D	CONCRETE	BEIGE	INTACT	-0.1	
259	COMMON	CENTER STAIRS	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
260	COMMON	CENTER STAIRS	FLOOR	A	CONCRETE	GREEN	INTACT	0.1	
261	COMMON	CENTER STAIRS	STAIR	B	CONCRETE	GREEN	INTACT	-0.2	
262	COMMON	CENTER STAIRS	STAIR	X	CONCRETE	GRAY	INTACT	0.1	
263	COMMON	CENTER STAIRS	RAILING	X	METAL	GREEN	INTACT	1.0	
264	COMMON	CENTER STAIRS	DOOR	A	METAL	BEIGE	INTACT	0.1	
265	COMMON	CENTER STAIRS	DOOR FRAME	A	METAL	BEIGE	INTACT	0.3	
266	COMMON	CENTER STAIRS	RADIATOR	C	METAL	BEIGE	INTACT	0.2	
267	COMMON	CENTER STAIRS	SPRINKLER PIPE	C	METAL	BEIGE	INTACT	0.4	
268	COMMON	CENTER STAIRS	WALL	A	CONCRETE	BEIGE	INTACT	0.1	
269	COMMON	WEST STAIR	WALL	A	CONCRETE	BEIGE	INTACT	0.2	
270	COMMON	WEST STAIR	WALL	B	CONCRETE	BEIGE	INTACT	0.0	
271	COMMON	WEST STAIR	WALL	C	CONCRETE	BEIGE	INTACT	0.1	
272	COMMON	WEST STAIR	WALL	D	CONCRETE	BEIGE	INTACT	-0.1	
273	COMMON	WEST STAIR	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
274	COMMON	WEST STAIR	FLOOR	A	CONCRETE	GRAY	INTACT	0.3	
275	COMMON	WEST STAIR	STAIR	B	CONCRETE	GRAY	INTACT	0.1	
276	COMMON	WEST STAIR	SPRINKLER PIPE	X	METAL	BEIGE	INTACT	0.4	
277	COMMON	WEST STAIR	RAILING	X	METAL	GREEN	INTACT	1.0	
278	COMMON	WEST STAIR	DOOR	A	METAL	BEIGE	INTACT	0.1	
279	COMMON	WEST STAIR	DOOR FRAME	A	METAL	BEIGE	INTACT	0.6	
280	COMMON	WEST STAIR	RADIATOR	C	METAL	BEIGE	INTACT	0.4	
281	COMMON	EAST STAIR	WALL	A	CONCRETE	BEIGE	INTACT	0.2	
282	COMMON	EAST STAIR	WALL	B	CONCRETE	BEIGE	INTACT	0.3	
283	COMMON	EAST STAIR	WALL	C	CONCRETE	BEIGE	INTACT	0.3	
284	COMMON	EAST STAIR	WALL	D	CONCRETE	BEIGE	INTACT	0.1	
285	COMMON	EAST STAIR	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
286	COMMON	EAST STAIR	FLOOR	A	CONCRETE	GRAY	INTACT	0.2	
287	COMMON	EAST STAIR	STAIR	B	CONCRETE	GRAY	INTACT	-0.2	
288	COMMON	EAST STAIR	SPRINKLER PIPE	A	METAL	BEIGE	INTACT	0.2	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
289	COMMON	EAST STAIR	RAILING	X	METAL	GREEN	INTACT	0.5	
290	COMMON	EAST STAIR	DOOR	A	METAL	BEIGE	INTACT	0.1	
291	COMMON	EAST STAIR	DOOR FRAME	A	METAL	BEIGE	INTACT	0.2	
292	COMMON	EAST STAIR	RADIATOR	C	METAL	BEIGE	INTACT	-0.1	
293	COMMON	EAST RESTROOM	WALL	A	DRYWALL	BEIGE	INTACT	-0.2	
294	COMMON	EAST RESTROOM	WALL	B	DRYWALL	BEIGE	INTACT	-0.1	
295	COMMON	EAST RESTROOM	WALL	C	DRYWALL	BEIGE	INTACT	0.1	
296	COMMON	EAST RESTROOM	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
297	COMMON	EAST RESTROOM	CEILING	A	TILE	WHITE	INTACT	-0.2	
298	COMMON	EAST RESTROOM	FLOOR	A	TILE	TAN	INTACT	0.1	
299	COMMON	EAST RESTROOM	WALL	C	TILE	TAN	INTACT	0.2	
300	COMMON	EAST RESTROOM	WALL	D	TILE	TAN	INTACT	0.1	
301	COMMON	EAST RESTROOM	DOOR	A	METAL	BEIGE	INTACT	-0.3	
302	COMMON	EAST RESTROOM	DOOR FRAME	A	METAL	BEIGE	INTACT	0.3	
303	COMMON	WEST RESTROOM	WALL	A	DRYWALL	BEIGE	INTACT	-0.1	
304	COMMON	WEST RESTROOM	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
305	COMMON	WEST RESTROOM	WALL	C	DRYWALL	BEIGE	INTACT	0.3	
306	COMMON	WEST RESTROOM	WALL	D	DRYWALL	BEIGE	INTACT	0.1	
307	COMMON	WEST RESTROOM	CEILING	A	TILE	WHITE	INTACT	-0.1	
308	COMMON	WEST RESTROOM	FLOOR	A	TILE	TAN	INTACT	0.1	
309	COMMON	WEST RESTROOM	WALL	C	TILE	TAN	INTACT	0.1	
310	COMMON	WEST RESTROOM	WALL	D	TILE	TAN	INTACT	0.2	
311	COMMON	WEST RESTROOM	DOOR	A	METAL	BEIGE	INTACT	0.1	
312	COMMON	WEST RESTROOM	DOOR FRAME	A	METAL	BEIGE	INTACT	-0.1	
313	COMMON	RESIDENT'S LOUNGE	WALL	A	DRYWALL	BEIGE	INTACT	0.1	
314	COMMON	RESIDENT'S LOUNGE	WALL	B	DRYWALL	BEIGE	INTACT	0.2	
315	COMMON	RESIDENT'S LOUNGE	WALL	C	DRYWALL	BEIGE	INTACT	-0.1	
316	COMMON	RESIDENT'S LOUNGE	WALL	D	DRYWALL	BEIGE	INTACT	0.0	
317	COMMON	RESIDENT'S LOUNGE	CEILING	A	TILE	WHITE	INTACT	0.3	
318	COMMON	RESIDENT'S LOUNGE	FLOOR	A	TILE	TAN	INTACT	0.1	
319	COMMON	RESIDENT'S LOUNGE	BASEBOARD	A	VINYL	TAN	INTACT	-0.1	
320	COMMON	RESIDENT'S LOUNGE	DOOR	A	METAL	BEIGE	INTACT	0.1	
321	COMMON	RESIDENT'S LOUNGE	DOOR FRAME	A	METAL	BEIGE	INTACT	-0.1	
322	COMMON	RESIDENT'S LOUNGE	WINDOW FRAME	B	METAL	BEIGE	INTACT	0.1	
323	COMMON	RESIDENT'S LOUNGE	RADIATOR	B	METAL	BEIGE	INTACT	0.2	
324	COMMON	EXTERIOR	COLUMN	A	PLASTIC	WHITE	INTACT	0.1	
325	COMMON	EXTERIOR	WALL	A	CONCRETE	BROWN	INTACT	0.3	
326	COMMON	EXTERIOR	BENCH	A	METAL	WHITE	INTACT	0.2	
327	COMMON	EXTERIOR	DOOR	A	METAL	BEIGE	INTACT	-0.1	
328	COMMON	EXTERIOR	DOOR FRAME	A	METAL	BEIGE	FAIR	0.1	
329	COMMON	EXTERIOR	LINTEL	B	METAL	BEIGE	INTACT	-0.2	
330	COMMON	EXTERIOR	GARAGE DOOR	B	METAL	BEIGE	INTACT	0.1	
331	COMMON	EXTERIOR	DOOR FRAME	B	WOOD	BEIGE	INTACT	0.3	
332	COMMON	EXTERIOR	FENCE	B	WOOD	GRAY	INTACT	-0.2	
333	COMMON	EXTERIOR	WALL	C	CONCRETE	GRAY	INTACT	0.4	
334	COMMON	EXTERIOR	WALL	C	CONCRETE	WHITE	INTACT	0.3	
335	COMMON	EXTERIOR	DOOR	C	METAL	WHITE	INTACT	0.1	
336	COMMON	EXTERIOR	DOOR FRAME	C	METAL	WHITE	INTACT	1.0	
337	COMMON	EXTERIOR	CEILING	C	CONCRETE	WHITE	INTACT	0.1	
338	COMMON	EXTERIOR	FENCE	C	METAL	BROWN	INTACT	0.1	
339	COMMON	EXTERIOR	DOOR	C	METAL	WHITE	INTACT	0.3	
340	COMMON	EXTERIOR	DOOR FRAME	C	METAL	WHITE	INTACT	0.2	
341	COMMON	EXTERIOR	WALL	D	CONCRETE	BROWN	INTACT	0.4	
342	COMMON	EXTERIOR	GARAGE DOOR	D	METAL	BROWN	INTACT	0.3	
343	COMMON	EXTERIOR	DOOR FRAME	D	METAL	BROWN	INTACT	0.3	
344	COMMON	EXTERIOR	DOOR	A	METAL	BROWN	INTACT	-0.1	
345	COMMON	EXTERIOR	DOOR FRAME	A	METAL	WHITE	INTACT	0.6	
346	COMMON	EXTERIOR	FENCE	A	METAL	WHITE	INTACT	0.2	
347	102	1	WALL	A	DRYWALL	BEIGE	INTACT	0.1	
348	102	1	WALL	B	CONCRETE	BEIGE	INTACT	0.4	
349	102	1	WALL	C	CONCRETE	BEIGE	INTACT	-0.1	
350	102	1	WALL	D	DRYWALL	BEIGE	INTACT	0.1	
351	102	1	FLOOR	A	TILE	TAN	INTACT	0.2	
352	102	1	CEILING	A	CONCRETE	WHITE	INTACT	0.1	
353	102	1	BASEBOARD	C	VINYL	BROWN	INTACT	0.1	
354	102	1	RADIATOR	C	METAL	BEIGE	INTACT	0.3	
355	102	2	WALL	A	DRYWALL	BEIGE	INTACT	0.3	
356	102	2	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
357	102	2	WALL	C	DRYWALL	BEIGE	INTACT	0.2	
358	102	2	WALL	D	DRYWALL	BEIGE	INTACT	0.2	
359	102	2	FLOOR	A	TILE	TAN	INTACT	0.2	
360	102	2	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
361	102	2	BASEBOARD	C	VINYL	BROWN	INTACT	0.1	
362	102	2	RADIATOR	C	METAL	BEIGE	INTACT	0.3	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
363	102	2	DOOR	B	WOOD	BEIGE	INTACT	0.1	
364	102	2	DOOR FRAME	B	METAL	BROWN	INTACT	0.2	
365	102	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	-0.2	
366	102	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.1	
367	102	3	WALL	A	CONCRETE	BEIGE	INTACT	-0.2	
368	102	3	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
369	102	3	WALL	C	DRYWALL	BEIGE	INTACT	-0.1	
370	102	3	WALL	D	CONCRETE	BEIGE	INTACT	0.2	
371	102	3	FLOOR	A	CONCRETE	TAN	INTACT	0.2	
372	102	3	CEILING	A	CONCRETE	WHITE	INTACT	0.4	
373	102	3	BASEBOARD	D	VINYL	TAN	INTACT	0.1	
374	102	3	CABINET	B	WOOD	BROWN	INTACT	0.0	
375	102	3	DOOR	C	WOOD	BEIGE	INTACT	0.1	
376	102	3	DOOR FRAME	C	METAL	BROWN	INTACT	-0.1	
377	102	3	CABINET	B	METAL	WHITE	INTACT	0.3	
378	102	3	SHOWER WALL	A	TILE	WHITE	INTACT	-0.1	
379	102	4	WALL	A	DRYWALL	BEIGE	INTACT	0.3	
380	102	4	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
381	102	4	WALL	C	DRYWALL	BEIGE	INTACT	-0.1	
382	102	4	WALL	D	DRYWALL	BEIGE	INTACT	0.3	
383	102	4	FLOOR	A	TILE	TAN	INTACT	-0.1	
384	102	4	CEILING	A	CONCRETE	WHITE	INTACT	0.0	
385	102	4	BASEBOARD	A	VINYL	BROWN	INTACT	0.2	
386	102	4	ELECTRIC PANEL	A	METAL	BEIGE	INTACT	0.2	
387	102	4	DOOR	A	WOOD	BEIGE	INTACT	-0.1	
388	102	4	DOOR FRAME	A	METAL	BROWN	INTACT	-0.2	
389	102	4	CLOSET DOOR	B	LAMINATE	BEIGE	INTACT	-0.2	
390	102	4	CLOSET WALL	B	DRYWALL	BEIGE	INTACT	-0.1	
391	102	4	CABINET	D	WOOD	BROWN	INTACT	0.1	
392	102	4	CABINET DOOR	D	WOOD	BROWN	INTACT	0.1	
393	102	3	CHAIR RAIL	B	WOOD	BEIGE	INTACT	-0.1	
394	102	3	VENT	B	METAL	BEIGE	INTACT	0.1	
395	101	1	WALL	A	DRYWALL	BEIGE	INTACT	0.0	
396	101	1	WALL	B	CONCRETE	BEIGE	INTACT	0.2	
397	101	1	WALL	C	CONCRETE	BEIGE	INTACT	0.1	
398	101	1	WALL	D	DRYWALL	BEIGE	INTACT	0.0	
399	101	1	FLOOR	A	TILE	TAN	INTACT	0.1	
400	101	1	CEILING	A	CONCRETE	WHITE	INTACT	0.7	
401	101	1	BASEBOARD	C	VINYL	TAN	INTACT	0.1	
402	101	1	RADIATOR	D	METAL	BEIGE	INTACT	0.3	
403	101	2	WALL	A	DRYWALL	BEIGE	INTACT	-0.1	
404	101	2	WALL	B	DRYWALL	BEIGE	INTACT	-0.1	
405	101	2	WALL	C	CONCRETE	BEIGE	INTACT	0.2	
406	101	2	WALL	D	CONCRETE	BEIGE	INTACT	0.1	
407	101	2	FLOOR	A	TILE	TAN	INTACT	-0.1	
408	101	2	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
409	101	2	BASEBOARD	B	VINYL	TAN	INTACT	0.2	
410	101	2	DOOR FRAME	B	METAL	BROWN	INTACT	0.6	
411	101	2	RADIATOR	C	METAL	BEIGE	INTACT	0.3	
412	101	2	DOOR	B	WOOD	BEIGE	INTACT	0.2	
413	101	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.1	
414	101	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	-0.2	
415	101	3	DOOR FRAME	C	METAL	BROWN	INTACT	0.5	
416	101	3	CEILING	A	CONCRETE	WHITE	INTACT	0.4	
417	101	3	FLOOR	A	CONCRETE	TAN	INTACT	0.3	
418	101	3	WALL	D	CONCRETE	BEIGE	INTACT	0.2	
419	101	3	BASEBOARD	B	VINYL	TAN	INTACT	0.1	
420	101	3	CABINET	B	METAL	WHITE	INTACT	0.1	
421	101	3	WALL	A	CONCRETE	BEIGE	INTACT	0.1	
422	101	3	WALL	C	DRYWALL	BEIGE	INTACT	0.0	
423	101	3	CABINET	B	WOOD	BROWN	INTACT	0.2	
424	101	3	SHOWER WALL	A	TILE	WHITE	INTACT	-0.1	
425	101	3	WALL	B	DRYWALL	BEIGE	INTACT	-0.1	
426	101	3	DOOR	C	WOOD	BEIGE	INTACT	-0.4	
427	101	4	VENT	B	METAL	BEIGE	INTACT	0.6	
428	101	4	CEILING	A	CONCRETE	WHITE	INTACT	0.4	
429	101	4	DOOR	A	WOOD	BEIGE	INTACT	0.2	
430	101	4	WALL	C	DRYWALL	BEIGE	INTACT	0.1	
431	101	4	ELECTRIC PANEL	A	METAL	BEIGE	INTACT	0.1	
432	101	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.1	
433	101	4	CLOSET WALL	B	DRYWALL	BEIGE	INTACT	0.1	
434	101	4	CHAIR RAIL	B	WOOD	BEIGE	INTACT	0.1	
435	101	4	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
436	101	4	WALL	D	DRYWALL	BEIGE	INTACT	0.2	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
437	101	4	BASEBOARD	A	VINYL	BROWN	INTACT	-0.1	
438	101	4	CLOSET DOOR	B	LAMINATE	BEIGE	INTACT	0.0	
439	101	4	CABINET DOOR	D	WOOD	BROWN	INTACT	-0.1	
440	101	4	WALL	A	DRYWALL	BEIGE	INTACT	-0.1	
441	101	4	FLOOR	A	TILE	TAN	INTACT	-0.1	
442	101	4	CABINET	D	WOOD	BROWN	INTACT	-0.1	
443	107	1	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
444	107	1	WALL	A	DRYWALL	WHITE	INTACT	0.1	
445	107	1	WALL	B	PLASTER	WHITE	INTACT	0.3	
446	107	1	WALL	C	PLASTER	WHITE	INTACT	0.3	
447	107	1	WALL	D	DRYWALL	WHITE	INTACT	0.1	
448	107	1	FLOOR	A	TILE	TAN	INTACT	0.3	
449	107	1	BASEBOARD	C	VINYL	BROWN	INTACT	-0.1	
450	107	1	RADIATOR	C	METAL	WHITE	INTACT	0.1	
451	107	2	CEILING	A	DRYWALL	WHITE	INTACT	0.5	
452	107	2	WALL	A	DRYWALL	WHITE	INTACT	0.0	
453	107	2	WALL	B	DRYWALL	WHITE	INTACT	0.0	
454	107	2	WALL	C	PLASTER	WHITE	INTACT	-0.1	
455	107	2	WALL	D	PLASTER	WHITE	INTACT	-0.2	
456	107	2	FLOOR	A	TILE	TAN	INTACT	0.3	
457	107	2	BASEBOARD	D	VINYL	BROWN	INTACT	0.3	
458	107	2	RADIATOR	C	METAL	BEIGE	INTACT	-0.1	
459	107	2	DOOR	D	WOOD	BEIGE	INTACT	-0.1	
460	107	2	DOOR FRAME	D	METAL	BROWN	INTACT	-0.2	
461	107	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	-0.1	
462	107	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.2	
463	107	3	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
464	107	3	WALL	A	CONCRETE	WHITE	INTACT	0.3	
465	107	3	WALL	B	DRYWALL	WHITE	INTACT	0.1	
466	107	3	WALL	C	DRYWALL	WHITE	INTACT	0.1	
467	107	3	WALL	D	PLASTER	WHITE	INTACT	0.0	
468	107	3	FLOOR	A	TILE	WHITE	INTACT	-0.2	
469	107	3	BASEBOARD	D	VINYL	BROWN	INTACT	-0.2	
470	107	3	CABINET	B	METAL	WHITE	INTACT	0.2	
471	107	3	DOOR	C	WOOD	WHITE	INTACT	-0.2	
472	107	3	DOOR FRAME	C	METAL	BROWN	INTACT	-0.1	
473	107	3	CABINET	B	WOOD	BROWN	INTACT	0.1	
474	107	3	SHOWER WALL	A	TILE	WHITE	INTACT	0.3	
475	107	3	WALL TRIM	D	WOOD	WHITE	INTACT	0.2	
476	107	3	VENT	B	METAL	WHITE	INTACT	-0.2	
477	107	4	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
478	107	4	WALL	A	DRYWALL	BEIGE	INTACT	0.2	
479	107	4	WALL	B	DRYWALL	BEIGE	INTACT	-0.1	
480	107	4	WALL	C	DRYWALL	BEIGE	INTACT	0.0	
481	107	4	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
482	107	4	FLOOR	A	TILE	WHITE	INTACT	0.3	
483	107	4	BASEBOARD	A	VINYL	BROWN	INTACT	0.0	
484	107	4	ELECTRIC PANEL	A	METAL	BEIGE	INTACT	0.0	
485	107	4	DOOR	A	WOOD	WHITE	INTACT	0.0	
486	107	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.1	
487	107	4	CLOSET DOOR	B	LAMINATE	BEIGE	INTACT	0.2	
488	107	4	CLOSET WALL	B	PLASTER	BEIGE	INTACT	0.1	
489	107	4	CABINET	D	WOOD	BROWN	INTACT	-0.2	
490	107	4	CABINET DOOR	D	WOOD	BROWN	INTACT	0.3	
491	115	1	BASEBOARD	C	VINYL	BROWN	INTACT	0.6	
492	115	1	WALL	A	DRYWALL	WHITE	INTACT	0.2	
493	115	1	WALL	B	PLASTER	WHITE	INTACT	0.3	
494	115	1	WALL	C	PLASTER	WHITE	INTACT	-0.2	
495	115	1	WALL	D	DRYWALL	WHITE	INTACT	0.3	
496	115	1	FLOOR	A	TILE	TAN	INTACT	0.3	
497	115	1	CEILING	A	CONCRETE	WHITE	INTACT	0.0	
498	115	1	RADIATOR	C	METAL	WHITE	INTACT	0.0	
499	115	2	WALL	A	DRYWALL	WHITE	INTACT	0.0	
500	115	2	WALL	B	DRYWALL	WHITE	INTACT	-0.2	
501	115	2	WALL	C	PLASTER	WHITE	INTACT	0.0	
502	115	2	WALL	D	PLASTER	WHITE	INTACT	-0.2	
503	115	2	FLOOR	A	TILE	TAN	INTACT	-0.1	
504	115	2	CEILING	A	DRYWALL	WHITE	INTACT	-0.2	
505	115	2	BASEBOARD	D	VINYL	BROWN	INTACT	0.0	
506	115	2	RADIATOR	C	METAL	BEIGE	INTACT	0.1	
507	115	2	DOOR	D	WOOD	BEIGE	INTACT	0.0	
508	115	2	DOOR FRAME	D	METAL	BROWN	INTACT	-0.2	
509	115	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	-0.1	
510	115	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	-0.2	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
511	115	3	CABINET	B	METAL	WHITE	INTACT	0.4	
512	115	3	VENT	B	METAL	WHITE	INTACT	0.4	
513	115	3	WALL	A	CONCRETE	WHITE	INTACT	0.3	
514	115	3	WALL	B	DRYWALL	WHITE	INTACT	0.1	
515	115	3	WALL	C	DRYWALL	WHITE	INTACT	0.1	
516	115	3	WALL	D	DRYWALL	WHITE	INTACT	0.1	
517	115	3	FLOOR	A	VINYL	WHITE	INTACT	0.3	
518	115	3	CEILING	A	CONCRETE	WHITE	INTACT	-0.2	
519	115	3	BASEBOARD	D	VINYL	BROWN	INTACT	0.3	
520	115	3	DOOR	C	WOOD	WHITE	INTACT	0.1	
521	115	3	DOOR FRAME	C	METAL	BROWN	INTACT	-0.1	
522	115	3	CABINET	B	WOOD	BROWN	INTACT	-0.2	
523	115	3	SHOWER WALL	A	TILE	WHITE	INTACT	-0.2	
524	115	3	WALL TRIM	D	WOOD	WHITE	INTACT	0.2	
525	115	4	WALL	A	DRYWALL	BEIGE	INTACT	0.3	
526	115	4	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
527	115	4	WALL	C	DRYWALL	BEIGE	INTACT	0.2	
528	115	4	WALL	D	DRYWALL	BEIGE	INTACT	0.3	
529	115	4	FLOOR	A	TILE	WHITE	INTACT	0.3	
530	115	4	CEILING	A	CONCRETE	WHITE	INTACT	-0.2	
531	115	4	BASEBOARD	A	VINYL	BROWN	INTACT	0.0	
532	115	4	ELECTRIC PANEL	A	METAL	BEIGE	INTACT	0.0	
533	115	4	DOOR	A	WOOD	WHITE	INTACT	0.1	
534	115	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.0	
535	115	4	CLOSET DOOR	B	LAMINATE	BEIGE	INTACT	-0.2	
536	115	4	CLOSET WALL	B	PLASTER	BEIGE	INTACT	0.2	
537	115	4	CABINET	D	WOOD	BROWN	INTACT	0.2	
538	115	4	CABINET DOOR	D	WOOD	BROWN	INTACT	0.3	
539	119	1	CEILING	A	CONCRETE	WHITE	INTACT	0.6	
540	119	1	RADIATOR	C	METAL	WHITE	INTACT	0.2	
541	119	1	WALL	A	DRYWALL	WHITE	INTACT	0.0	
542	119	1	WALL	B	DRYWALL	WHITE	INTACT	-0.2	
543	119	1	WALL	C	PLASTER	WHITE	INTACT	0.1	
544	119	1	WALL	D	PLASTER	WHITE	INTACT	-0.2	
545	119	1	FLOOR	A	TILE	WHITE	INTACT	0.2	
546	119	1	BASEBOARD	B	VINYL	BROWN	INTACT	0.2	
547	119	2	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
548	119	2	BASEBOARD	B	VINYL	BROWN	INTACT	0.2	
549	119	2	WALL	A	DRYWALL	WHITE	INTACT	-0.1	
550	119	2	WALL	B	PLASTER	WHITE	INTACT	-0.1	
551	119	2	WALL	C	PLASTER	WHITE	INTACT	0.3	
552	119	2	WALL	D	DRYWALL	WHITE	INTACT	0.1	
553	119	2	FLOOR	A	TILE	WHITE	INTACT	-0.1	
554	119	2	RADIATOR	C	METAL	WHITE	INTACT	-0.1	
555	119	2	DOOR	D	WOOD	BEIGE	INTACT	0.1	
556	119	2	DOOR FRAME	D	METAL	BROWN	INTACT	-0.1	
557	119	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	0.2	
558	119	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	-0.2	
559	119	3	CEILING	A	CONCRETE	WHITE	INTACT	0.6	
560	119	3	DOOR FRAME	C	METAL	BROWN	INTACT	0.2	
561	119	3	SHOWER WALL	A	TILE	WHITE	INTACT	0.1	
562	119	3	WALL	A	DRYWALL	WHITE	INTACT	-0.2	
563	119	3	WALL	B	DRYWALL	WHITE	INTACT	0.2	
564	119	3	WALL	C	DRYWALL	WHITE	INTACT	0.0	
565	119	3	WALL	D	PLASTER	WHITE	INTACT	-0.1	
566	119	3	FLOOR	A	VINYL	WHITE	INTACT	0.2	
567	119	3	BASEBOARD	B	VINYL	BROWN	INTACT	0.0	
568	119	3	RADIATOR	B	METAL	WHITE	INTACT	0.1	
569	119	3	DOOR	C	WOOD	WHITE	INTACT	-0.1	
570	119	3	CABINET	D	WOOD	BROWN	INTACT	-0.1	
571	119	3	WALL TRIM	B	WOOD	WHITE	INTACT	0.3	
572	119	3	VENT	D	METAL	WHITE	INTACT	-0.2	
573	119	4	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
574	119	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.3	
575	119	4	WALL	A	DRYWALL	BEIGE	INTACT	-0.2	
576	119	4	WALL	B	DRYWALL	BEIGE	INTACT	-0.2	
577	119	4	WALL	C	DRYWALL	BEIGE	INTACT	0.3	
578	119	4	WALL	D	DRYWALL	BEIGE	INTACT	0.3	
579	119	4	FLOOR	A	TILE	WHITE	INTACT	0.1	
580	119	4	BASEBOARD	A	VINYL	BROWN	INTACT	0.1	
581	119	4	ELECTRIC PANEL	A	METAL	BEIGE	INTACT	0.1	
582	119	4	DOOR	A	WOOD	WHITE	INTACT	0.0	
583	119	4	CLOSET DOOR	D	LAMINATE	BEIGE	INTACT	0.1	
584	119	4	CLOSET WALL	D	PLASTER	BEIGE	INTACT	0.1	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
585	119	4	CABINET	B	WOOD	BROWN	INTACT	-0.2	
586	119	4	CABINET DOOR	B	WOOD	BROWN	INTACT	0.0	
587	201	1	CEILING	A	CONCRETE	WHITE	INTACT	0.4	
588	201	1	WALL	A	DRYWALL	WHITE	INTACT	0.2	
589	201	1	WALL	B	PLASTER	WHITE	INTACT	-0.2	
590	201	1	WALL	C	PLASTER	WHITE	INTACT	0.1	
591	201	1	WALL	D	DRYWALL	WHITE	INTACT	-0.1	
592	201	1	FLOOR	A	TILE	WHITE	INTACT	0.2	
593	201	1	BASEBOARD	B	VINYL	BROWN	INTACT	0.1	
594	201	1	RADIATOR	C	METAL	WHITE	INTACT	-0.2	
595	201	2	CEILING	A	CONCRETE	WHITE	INTACT	0.6	
596	201	2	WALL	A	DRYWALL	WHITE	INTACT	0.0	
597	201	2	WALL	B	DRYWALL	WHITE	INTACT	0.1	
598	201	2	WALL	C	PLASTER	WHITE	INTACT	0.0	
599	201	2	WALL	D	PLASTER	WHITE	INTACT	0.0	
600	201	2	FLOOR	A	TILE	WHITE	INTACT	0.0	
601	201	2	BASEBOARD	C	VINYL	BROWN	INTACT	0.3	
602	201	2	RADIATOR	C	METAL	WHITE	INTACT	-0.1	
603	201	2	DOOR	B	WOOD	BEIGE	INTACT	0.0	
604	201	2	DOOR FRAME	B	METAL	BROWN	INTACT	0.1	
605	201	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	0.3	
606	201	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.0	
607	201	3	SHOWER WALL	A	TILE	WHITE	INTACT	9.9	
608	201	3	CEILING	A	CONCRETE	WHITE	INTACT	0.6	
609	201	3	WALL	A	CONCRETE	WHITE	INTACT	0.2	
610	201	3	WALL	B	DRYWALL	WHITE	INTACT	0.3	
611	201	3	WALL	C	DRYWALL	WHITE	INTACT	0.3	
612	201	3	WALL	D	PLASTER	WHITE	INTACT	0.0	
613	201	3	FLOOR	A	VINYL	WHITE	INTACT	0.2	
614	201	3	BASEBOARD	D	VINYL	BROWN	INTACT	-0.2	
615	201	3	DOOR	C	WOOD	WHITE	INTACT	-0.1	
616	201	3	DOOR FRAME	C	METAL	BROWN	INTACT	0.3	
617	201	3	CABINET	B	WOOD	BROWN	INTACT	0.1	
618	201	3	WALL TRIM	D	WOOD	WHITE	INTACT	0.2	
619	201	3	VENT	D	METAL	WHITE	INTACT	0.0	
620	201	4	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
621	201	4	WALL	A	DRYWALL	BEIGE	INTACT	-0.1	
622	201	4	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
623	201	4	WALL	C	DRYWALL	BEIGE	INTACT	0.0	
624	201	4	WALL	D	DRYWALL	BEIGE	INTACT	0.0	
625	201	4	FLOOR	A	TILE	WHITE	INTACT	0.3	
626	201	4	BASEBOARD	A	VINYL	BROWN	INTACT	-0.2	
627	201	4	ELECTRIC PANEL	A	METAL	BEIGE	INTACT	0.3	
628	201	4	DOOR	A	WOOD	WHITE	INTACT	0.2	
629	201	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.1	
630	201	4	CLOSET DOOR	B	LAMINATE	BEIGE	INTACT	-0.2	
631	201	4	CLOSET WALL	B	PLASTER	BEIGE	INTACT	0.2	
632	201	4	CABINET	D	WOOD	BROWN	INTACT	0.1	
633	201	4	CABINET DOOR	D	WOOD	BROWN	INTACT	-0.2	
634	211	1	CEILING	A	CONCRETE	WHITE	INTACT	0.4	
635	211	1	WALL	A	DRYWALL	WHITE	INTACT	0.1	
636	211	1	WALL	B	PLASTER	WHITE	INTACT	0.1	
637	211	1	WALL	C	PLASTER	WHITE	INTACT	-0.1	
638	211	1	WALL	D	DRYWALL	WHITE	INTACT	-0.1	
639	211	1	FLOOR	A	TILE	WHITE	INTACT	0.1	
640	211	1	BASEBOARD	B	VINYL	BROWN	INTACT	-0.1	
641	211	1	RADIATOR	C	METAL	WHITE	INTACT	0.2	
642	211	2	CEILING	A	CONCRETE	WHITE	INTACT	0.6	
643	211	2	WALL	A	DRYWALL	WHITE	INTACT	0.0	
644	211	2	WALL	B	DRYWALL	WHITE	INTACT	0.1	
645	211	2	WALL	C	PLASTER	WHITE	INTACT	0.3	
646	211	2	WALL	D	PLASTER	WHITE	INTACT	0.0	
647	211	2	FLOOR	A	TILE	WHITE	INTACT	0.2	
648	211	2	BASEBOARD	C	VINYL	BROWN	INTACT	0.2	
649	211	2	RADIATOR	C	METAL	WHITE	INTACT	0.1	
650	211	2	DOOR	B	WOOD	WHITE	INTACT	0.0	
651	211	2	DOOR FRAME	B	METAL	WHITE	INTACT	0.3	
652	211	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	0.1	
653	211	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	-0.1	
654	211	3	SHOWER WALL	A	TILE	WHITE	INTACT	9.9	
655	211	3	CEILING	A	CONCRETE	WHITE	INTACT	0.6	
656	211	3	VENT	D	METAL	WHITE	INTACT	0.2	
657	211	3	WALL	A	CONCRETE	WHITE	INTACT	-0.1	
658	211	3	WALL	B	DRYWALL	WHITE	INTACT	0.1	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
659	211	3	WALL	C	DRYWALL	WHITE	INTACT	-0.2	
660	211	3	WALL	D	PLASTER	WHITE	INTACT	0.3	
661	211	3	FLOOR	A	VINYL	WHITE	INTACT	0.0	
662	211	3	BASEBOARD	D	VINYL	BROWN	INTACT	0.3	
663	211	3	DOOR	C	WOOD	WHITE	INTACT	-0.1	
664	211	3	DOOR FRAME	C	METAL	BROWN	INTACT	-0.2	
665	211	3	CABINET	B	WOOD	BROWN	INTACT	0.1	
666	211	3	WALL TRIM	D	WOOD	WHITE	INTACT	0.0	
667	211	4	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
668	211	4	WALL	A	DRYWALL	BEIGE	INTACT	0.2	
669	211	4	WALL	B	DRYWALL	BEIGE	INTACT	0.2	
670	211	4	WALL	C	DRYWALL	BEIGE	INTACT	-0.1	
671	211	4	WALL	D	DRYWALL	BEIGE	INTACT	0.1	
672	211	4	FLOOR	A	TILE	WHITE	INTACT	0.3	
673	211	4	BASEBOARD	A	VINYL	BROWN	INTACT	0.3	
674	211	4	ELECTRIC PANEL	A	METAL	WHITE	INTACT	-0.1	
675	211	4	DOOR	A	WOOD	WHITE	INTACT	0.1	
676	211	4	DOOR FRAME	A	METAL	BROWN	INTACT	-0.1	
677	211	4	CLOSET DOOR	B	LAMINATE	WHITE	INTACT	0.1	
678	211	4	CLOSET WALL	B	PLASTER	WHITE	INTACT	0.1	
679	211	4	CABINET	D	WOOD	BROWN	INTACT	0.3	
680	211	4	CABINET DOOR	D	WOOD	BROWN	INTACT	0.2	
681	212	1	CEILING	A	CONCRETE	WHITE	INTACT	0.4	
682	212	1	WALL	C	CONCRETE	BEIGE	INTACT	0.2	
683	212	1	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
684	212	1	WALL	D	CONCRETE	BEIGE	INTACT	0.1	
685	212	1	FLOOR	A	TILE	TAN	INTACT	0.1	
686	212	1	BASEBOARD	C	VINYL	BROWN	INTACT	0.1	
687	212	1	WALL	A	DRYWALL	BEIGE	INTACT	0.3	
688	212	1	RADIATOR	C	METAL	BEIGE	POOR	0.2	
689	212	2	CEILING	A	CONCRETE	WHITE	INTACT	0.4	
690	212	2	WALL	C	CONCRETE	BEIGE	INTACT	0.3	
691	212	2	WALL	B	CONCRETE	BEIGE	INTACT	0.2	
692	212	2	FLOOR	A	TILE	TAN	INTACT	0.2	
693	212	2	BASEBOARD	C	VINYL	BROWN	INTACT	0.1	
694	212	2	DOOR	D	WOOD	BEIGE	INTACT	0.1	
695	212	2	WALL	A	DRYWALL	BEIGE	INTACT	-0.1	
696	212	2	RADIATOR	C	METAL	BEIGE	INTACT	0.0	
697	212	2	DOOR FRAME	D	METAL	BROWN	INTACT	-0.1	
698	212	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	0.2	
699	212	2	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
700	212	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	-0.1	
701	212	3	SHOWER WALL	A	TILE	WHITE	INTACT	9.9	
702	212	3	CABINET	D	METAL	WHITE	INTACT	0.5	
703	212	3	CEILING	A	CONCRETE	WHITE	INTACT	0.3	
704	212	3	VENT	D	METAL	BEIGE	INTACT	0.2	
705	212	3	WALL	A	CONCRETE	BEIGE	INTACT	0.1	
706	212	3	WALL	D	DRYWALL	BEIGE	INTACT	0.1	
707	212	3	FLOOR	A	CONCRETE	TAN	INTACT	0.1	
708	212	3	DOOR	C	WOOD	BEIGE	INTACT	0.1	
709	212	3	CHAIR RAIL	D	WOOD	BEIGE	INTACT	0.1	
710	212	3	WALL	B	CONCRETE	BEIGE	INTACT	0.2	
711	212	3	WALL	C	DRYWALL	BEIGE	INTACT	0.0	
712	212	3	BASEBOARD	C	VINYL	TAN	INTACT	0.2	
713	212	3	CABINET	D	WOOD	BROWN	INTACT	0.3	
714	212	3	DOOR FRAME	C	METAL	BROWN	INTACT	-0.1	
715	212	4	CEILING	A	CONCRETE	WHITE	INTACT	0.6	
716	212	4	ELECTRIC PANEL	A	METAL	BEIGE	INTACT	0.2	
717	212	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.2	
718	212	4	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
719	212	4	WALL	A	DRYWALL	BEIGE	INTACT	0.3	
720	212	4	WALL	C	DRYWALL	BEIGE	INTACT	-0.1	
721	212	4	WALL	D	DRYWALL	BEIGE	INTACT	-0.2	
722	212	4	FLOOR	A	TILE	TAN	INTACT	-0.1	
723	212	4	BASEBOARD	A	VINYL	BEIGE	INTACT	0.1	
724	212	4	DOOR	A	WOOD	BEIGE	INTACT	-0.1	
725	212	4	CLOSET DOOR	D	LAMINATE	BEIGE	INTACT	-0.2	
726	212	4	CABINET	B	WOOD	BROWN	INTACT	0.2	
727	212	4	CLOSET WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
728	212	4	CABINET DOOR	B	WOOD	BROWN	INTACT	-0.1	
729	213	1	WALL	A	DRYWALL	WHITE	INTACT	-0.2	
730	213	1	WALL	B	DRYWALL	WHITE	INTACT	-0.1	
731	213	1	WALL	C	PLASTER	WHITE	INTACT	0.2	
732	213	1	WALL	D	PLASTER	WHITE	INTACT	0.1	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
733	213	1	FLOOR	A	TILE	WHITE	INTACT	0.2	
734	213	1	CEILING	A	DRYWALL	WHITE	INTACT	0.0	
735	213	1	BASEBOARD	B	VINYL	BROWN	INTACT	0.2	
736	213	1	RADIATOR	C	METAL	WHITE	INTACT	0.0	
737	213	2	WALL	A	DRYWALL	WHITE	INTACT	0.3	
738	213	2	WALL	B	PLASTER	WHITE	INTACT	-0.1	
739	213	2	WALL	C	PLASTER	WHITE	INTACT	0.3	
740	213	2	WALL	D	DRYWALL	WHITE	INTACT	0.2	
741	213	2	FLOOR	A	TILE	WHITE	INTACT	-0.1	
742	213	2	CEILING	A	DRYWALL	WHITE	INTACT	0.3	
743	213	2	BASEBOARD	D	VINYL	BROWN	INTACT	0.0	
744	213	2	RADIATOR	C	METAL	WHITE	INTACT	0.2	
745	213	2	DOOR	D	WOOD	WHITE	INTACT	0.0	
746	213	2	DOOR FRAME	D	METAL	BROWN	INTACT	0.0	
747	213	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	-0.1	
748	213	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	-0.2	
749	213	3	WALL	A	CONCRETE	WHITE	INTACT	-0.2	
750	213	3	WALL	B	PLASTER	WHITE	INTACT	0.3	
751	213	3	WALL	C	DRYWALL	WHITE	INTACT	0.2	
752	213	3	WALL	D	DRYWALL	WHITE	INTACT	-0.2	
753	213	3	FLOOR	A	VINYL	WHITE	INTACT	0.3	
754	213	3	CEILING	A	DRYWALL	WHITE	INTACT	0.0	
755	213	3	BASEBOARD	B	VINYL	BROWN	INTACT	0.2	
756	213	3	DOOR	C	WOOD	WHITE	INTACT	0.3	
757	213	3	DOOR FRAME	C	METAL	BROWN	INTACT	-0.2	
758	213	3	CABINET	D	WOOD	BROWN	INTACT	0.1	
759	213	3	SHOWER WALL	A	TILE	WHITE	INTACT	0.3	
760	213	3	WALL TRIM	B	WOOD	WHITE	INTACT	0.3	
761	213	3	VENT	D	METAL	WHITE	INTACT	-0.2	
762	213	4	WALL	A	DRYWALL	BEIGE	INTACT	0.2	
763	213	4	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
764	213	4	WALL	C	DRYWALL	BEIGE	INTACT	-0.2	
765	213	4	WALL	D	DRYWALL	BEIGE	INTACT	0.2	
766	213	4	FLOOR	A	TILE	WHITE	INTACT	-0.1	
767	213	4	CEILING	A	DRYWALL	WHITE	INTACT	0.2	
768	213	4	BASEBOARD	B	VINYL	BROWN	INTACT	0.2	
769	213	4	DOOR	A	WOOD	WHITE	INTACT	0.0	
770	213	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.1	
771	213	4	CLOSET DOOR	D	LAMINATE	WHITE	INTACT	0.0	
772	213	4	CLOSET WALL	D	PLASTER	WHITE	INTACT	-0.1	
773	213	4	CABINET	D	WOOD	BROWN	INTACT	0.1	
774	213	4	CABINET DOOR	D	WOOD	BROWN	INTACT	0.0	
775	214	1	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
776	214	1	WALL	A	DRYWALL	WHITE	INTACT	0.3	
777	214	1	WALL	B	PLASTER	WHITE	INTACT	0.1	
778	214	1	WALL	C	PLASTER	WHITE	INTACT	-0.2	
779	214	1	WALL	D	DRYWALL	WHITE	INTACT	0.3	
780	214	1	FLOOR	A	TILE	WHITE	INTACT	0.2	
781	214	1	BASEBOARD	C	VINYL	BROWN	INTACT	0.0	
782	214	1	RADIATOR	C	METAL	WHITE	INTACT	-0.1	
783	214	2	CEILING	A	CONCRETE	WHITE	INTACT	0.6	
784	214	2	WALL	A	DRYWALL	WHITE	INTACT	0.0	
785	214	2	WALL	B	PLASTER	WHITE	INTACT	0.2	
786	214	2	WALL	C	PLASTER	WHITE	INTACT	0.2	
787	214	2	WALL	D	DRYWALL	WHITE	INTACT	-0.2	
788	214	2	FLOOR	A	TILE	WHITE	INTACT	-0.1	
789	214	2	BASEBOARD	C	VINYL	BROWN	INTACT	-0.2	
790	214	2	RADIATOR	C	METAL	WHITE	INTACT	0.0	
791	214	2	DOOR	D	WOOD	WHITE	INTACT	0.0	
792	214	2	DOOR FRAME	D	METAL	BROWN	INTACT	0.0	
793	214	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	0.0	
794	214	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.3	
795	214	3	SHOWER WALL	A	TILE	WHITE	INTACT	9.9	
796	214	3	CEILING	A	CONCRETE	WHITE	INTACT	0.4	
797	214	3	WALL	A	CONCRETE	WHITE	INTACT	0.2	
798	214	3	WALL	B	PLASTER	WHITE	INTACT	-0.1	
799	214	3	WALL	C	DRYWALL	WHITE	INTACT	-0.2	
800	214	3	WALL	D	DRYWALL	WHITE	INTACT	0.3	
801	214	3	FLOOR	A	VINYL	WHITE	INTACT	0.3	
802	214	3	BASEBOARD	B	VINYL	BROWN	INTACT	0.3	
803	214	3	DOOR	C	WOOD	WHITE	INTACT	-0.1	
804	214	3	DOOR FRAME	C	METAL	BROWN	INTACT	0.1	
805	214	3	CABINET	D	WOOD	BROWN	INTACT	0.1	
806	214	3	WALL TRIM	B	WOOD	WHITE	INTACT	-0.2	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
807	214	3	VENT	D	METAL	WHITE	INTACT	0.1	
808	214	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.6	
809	214	4	CEILING	A	CONCRETE	WHITE	INTACT	0.4	
810	214	4	WALL	A	DRYWALL	BEIGE	INTACT	-0.1	
811	214	4	WALL	B	DRYWALL	BEIGE	INTACT	0.2	
812	214	4	WALL	C	DRYWALL	BEIGE	INTACT	0.2	
813	214	4	WALL	D	DRYWALL	BEIGE	INTACT	0.3	
814	214	4	FLOOR	A	TILE	WHITE	INTACT	-0.1	
815	214	4	BASEBOARD	A	VINYL	BROWN	INTACT	0.0	
816	214	4	ELECTRIC PANEL	A	METAL	WHITE	INTACT	0.2	
817	214	4	DOOR	A	WOOD	WHITE	INTACT	-0.1	
818	214	4	CLOSET DOOR	D	LAMINATE	WHITE	INTACT	0.2	
819	214	4	CLOSET WALL	D	PLASTER	WHITE	INTACT	0.1	
820	214	4	CABINET	B	WOOD	BROWN	INTACT	-0.2	
821	214	4	CABINET DOOR	B	WOOD	BROWN	INTACT	-0.1	
822	221	1	WALL	A	DRYWALL	WHITE	INTACT	0.1	
823	221	1	WALL	B	DRYWALL	WHITE	INTACT	-0.2	
824	221	1	WALL	C	PLASTER	WHITE	INTACT	0.0	
825	221	1	WALL	D	PLASTER	WHITE	INTACT	-0.2	
826	221	1	FLOOR	A	TILE	WHITE	INTACT	0.1	
827	221	1	CEILING	A	CONCRETE	WHITE	INTACT	0.2	
828	221	1	BASEBOARD	C	VINYL	BROWN	INTACT	-0.1	
829	221	1	RADIATOR	C	METAL	WHITE	INTACT	-0.2	
830	221	2	WALL	A	DRYWALL	WHITE	INTACT	0.1	
831	221	2	WALL	B	PLASTER	WHITE	INTACT	-0.2	
832	221	2	WALL	C	PLASTER	WHITE	INTACT	0.1	
833	221	2	WALL	D	DRYWALL	WHITE	INTACT	0.2	
834	221	2	FLOOR	A	TILE	WHITE	INTACT	-0.2	
835	221	2	CEILING	A	CONCRETE	WHITE	INTACT	0.0	
836	221	2	BASEBOARD	C	VINYL	BROWN	INTACT	0.0	
837	221	2	RADIATOR	C	METAL	WHITE	INTACT	0.3	
838	221	2	DOOR	D	WOOD	WHITE	INTACT	-0.1	
839	221	2	DOOR FRAME	D	METAL	BROWN	INTACT	0.0	
840	221	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	-0.2	
841	221	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.2	
842	221	3	SHOWER WALL	A	TILE	WHITE	INTACT	9.9	
843	221	3	WALL	A	CONCRETE	WHITE	INTACT	-0.1	
844	221	3	WALL	B	PLASTER	WHITE	INTACT	0.3	
845	221	3	WALL	C	DRYWALL	WHITE	INTACT	0.1	
846	221	3	WALL	D	DRYWALL	WHITE	INTACT	0.3	
847	221	3	FLOOR	A	VINYL	WHITE	INTACT	0.1	
848	221	3	CEILING	A	CONCRETE	WHITE	INTACT	-0.1	
849	221	3	BASEBOARD	B	VINYL	BROWN	INTACT	0.0	
850	221	3	DOOR	C	WOOD	WHITE	INTACT	0.3	
851	221	3	DOOR FRAME	C	METAL	BROWN	INTACT	0.2	
852	221	3	CABINET	D	WOOD	BROWN	INTACT	0.3	
853	221	3	WALL TRIM	B	WOOD	WHITE	INTACT	0.3	
854	221	3	VENT	D	METAL	WHITE	INTACT	0.1	
855	221	4	WALL	A	DRYWALL	BEIGE	INTACT	0.1	
856	221	4	WALL	B	DRYWALL	BEIGE	INTACT	-0.1	
857	221	4	WALL	C	DRYWALL	BEIGE	INTACT	0.2	
858	221	4	WALL	D	DRYWALL	BEIGE	INTACT	0.3	
859	221	4	FLOOR	A	TILE	WHITE	INTACT	0.2	
860	221	4	CEILING	A	CONCRETE	WHITE	INTACT	-0.1	
861	221	4	BASEBOARD	A	VINYL	BROWN	INTACT	0.3	
862	221	4	ELECTRIC PANEL	A	METAL	WHITE	INTACT	0.2	
863	221	4	DOOR	A	WOOD	WHITE	INTACT	0.1	
864	221	4	DOOR FRAME	A	METAL	BROWN	INTACT	-0.2	
865	221	4	CLOSET DOOR	D	LAMINATE	WHITE	INTACT	-0.2	
866	221	4	CLOSET WALL	D	PLASTER	WHITE	INTACT	-0.2	
867	221	4	CABINET	B	WOOD	BROWN	INTACT	0.1	
868	221	4	CABINET DOOR	B	WOOD	BROWN	INTACT	-0.2	
869	315	1	WALL	A	DRYWALL	WHITE	INTACT	-0.1	
870	315	1	WALL	B	DRYWALL	WHITE	INTACT	0.1	
871	315	1	WALL	C	PLASTER	WHITE	INTACT	-0.1	
872	315	1	WALL	D	PLASTER	WHITE	INTACT	0.0	
873	315	1	FLOOR	A	TILE	WHITE	INTACT	-0.2	
874	315	1	CEILING	A	CONCRETE	WHITE	INTACT	0.1	
875	315	1	BASEBOARD	C	VINYL	BROWN	INTACT	-0.1	
876	315	1	RADIATOR	C	METAL	WHITE	INTACT	0.2	
877	315	2	WALL	A	DRYWALL	WHITE	INTACT	0.0	
878	315	2	WALL	B	PLASTER	WHITE	INTACT	0.0	
879	315	2	WALL	C	PLASTER	WHITE	INTACT	-0.1	
880	315	2	WALL	D	DRYWALL	WHITE	INTACT	0.3	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
881	315	2	FLOOR	A	TILE	WHITE	INTACT	0.3	
882	315	2	CEILING	A	CONCRETE	WHITE	INTACT	-0.2	
883	315	2	BASEBOARD	D	VINYL	BROWN	INTACT	0.3	
884	315	2	RADIATOR	C	METAL	WHITE	INTACT	0.0	
885	315	2	DOOR	D	WOOD	WHITE	INTACT	0.2	
886	315	2	DOOR FRAME	D	METAL	BROWN	INTACT	0.1	
887	315	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	0.1	
888	315	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.0	
889	315	3	WALL	A	CONCRETE	WHITE	INTACT	-0.1	
890	315	3	WALL	B	PLASTER	WHITE	INTACT	-0.2	
891	315	3	WALL	C	DRYWALL	WHITE	INTACT	0.3	
892	315	3	WALL	D	DRYWALL	WHITE	INTACT	-0.2	
893	315	3	FLOOR	A	VINYL	WHITE	INTACT	0.0	
894	315	3	CEILING	A	CONCRETE	WHITE	INTACT	-0.1	
895	315	3	BASEBOARD	B	VINYL	BROWN	INTACT	0.0	
896	315	3	DOOR	C	WOOD	WHITE	INTACT	-0.2	
897	315	3	DOOR FRAME	C	METAL	BROWN	INTACT	-0.2	
898	315	3	CABINET	D	WOOD	BROWN	INTACT	0.3	
899	315	3	SHOWER WALL	C	TILE	WHITE	INTACT	-0.1	
900	315	3	WALL TRIM	B	WOOD	WHITE	INTACT	0.0	
901	315	3	VENT	D	METAL	WHITE	INTACT	0.1	
902	315	4	WALL	A	DRYWALL	BEIGE	INTACT	-0.2	
903	315	4	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
904	315	4	WALL	C	DRYWALL	BEIGE	INTACT	0.2	
905	315	4	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
906	315	4	FLOOR	A	TILE	WHITE	INTACT	0.2	
907	315	4	CEILING	A	CONCRETE	WHITE	INTACT	0.2	
908	315	4	BASEBOARD	B	VINYL	BROWN	INTACT	0.1	
909	315	4	ELECTRIC PANEL	A	METAL	WHITE	INTACT	0.1	
910	315	4	DOOR	A	WOOD	WHITE	INTACT	-0.1	
911	315	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.2	
912	315	4	CLOSET DOOR	D	LAMINATE	WHITE	INTACT	-0.2	
913	315	4	CLOSET WALL	D	PLASTER	WHITE	INTACT	-0.1	
914	315	4	CABINET	B	WOOD	BROWN	INTACT	0.1	
915	315	4	CABINET DOOR	B	WOOD	BROWN	INTACT	0.2	
916	407	1	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
917	407	1	WALL	A	DRYWALL	WHITE	INTACT	0.2	
918	407	1	WALL	B	PLASTER	WHITE	INTACT	0.0	
919	407	1	WALL	C	PLASTER	WHITE	INTACT	-0.1	
920	407	1	WALL	D	DRYWALL	WHITE	INTACT	0.3	
921	407	1	FLOOR	A	TILE	WHITE	INTACT	0.1	
922	407	1	BASEBOARD	C	VINYL	BROWN	INTACT	0.3	
923	407	1	RADIATOR	C	METAL	WHITE	INTACT	0.2	
924	407	2	CEILING	A	CONCRETE	WHITE	INTACT	0.6	
925	407	2	WALL	A	DRYWALL	WHITE	INTACT	0.2	
926	407	2	WALL	B	DRYWALL	WHITE	INTACT	0.0	
927	407	2	WALL	C	PLASTER	WHITE	INTACT	0.2	
928	407	2	WALL	D	PLASTER	WHITE	INTACT	0.0	
929	407	2	FLOOR	A	TILE	WHITE	INTACT	0.3	
930	407	2	BASEBOARD	C	VINYL	BROWN	INTACT	0.2	
931	407	2	RADIATOR	C	METAL	WHITE	INTACT	0.3	
932	407	2	DOOR	B	WOOD	WHITE	INTACT	0.2	
933	407	2	DOOR FRAME	B	METAL	BROWN	INTACT	0.0	
934	407	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	0.1	
935	407	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.3	
936	407	3	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
937	407	3	VENT	B	METAL	WHITE	INTACT	0.5	
938	407	3	WALL	A	CONCRETE	WHITE	INTACT	0.3	
939	407	3	WALL	B	DRYWALL	WHITE	INTACT	0.3	
940	407	3	WALL	C	DRYWALL	WHITE	INTACT	0.1	
941	407	3	WALL	D	PLASTER	WHITE	INTACT	0.1	
942	407	3	FLOOR	A	VINYL	WHITE	INTACT	0.0	
943	407	3	BASEBOARD	B	VINYL	BROWN	INTACT	0.3	
944	407	3	DOOR	C	WOOD	WHITE	INTACT	0.2	
945	407	3	DOOR FRAME	C	METAL	BROWN	INTACT	0.3	
946	407	3	CABINET	B	WOOD	BROWN	INTACT	0.1	
947	407	3	SHOWER WALL	A	TILE	WHITE	INTACT	0.1	
948	407	3	WALL TRIM	D	WOOD	WHITE	INTACT	0.3	
949	407	4	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
950	407	4	WALL	A	DRYWALL	BEIGE	INTACT	0.0	
951	407	4	WALL	B	DRYWALL	BEIGE	INTACT	0.0	
952	407	4	WALL	C	DRYWALL	BEIGE	INTACT	0.2	
953	407	4	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
954	407	4	FLOOR	A	TILE	WHITE	INTACT	-0.1	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
955	407	4	BASEBOARD	A	VINYL	BROWN	INTACT	0.1	
956	407	4	ELECTRIC PANEL	A	METAL	WHITE	INTACT	-0.1	
957	407	4	DOOR	A	WOOD	WHITE	INTACT	0.1	
958	407	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.3	
959	407	4	CLOSET DOOR	B	LAMINATE	WHITE	INTACT	0.0	
960	407	4	CLOSET WALL	B	PLASTER	WHITE	INTACT	0.2	
961	407	4	CABINET	D	WOOD	BROWN	INTACT	-0.2	
962	407	4	CABINET DOOR	D	WOOD	BROWN	INTACT	0.1	
963	414	1	CEILING	A	CONCRETE	WHITE	INTACT	0.6	
964	414	1	WALL	A	DRYWALL	WHITE	INTACT	0.1	
965	414	1	WALL	B	DRYWALL	WHITE	INTACT	-0.2	
966	414	1	WALL	C	PLASTER	WHITE	INTACT	-0.2	
967	414	1	WALL	D	PLASTER	WHITE	INTACT	0.0	
968	414	1	FLOOR	A	TILE	WHITE	INTACT	0.0	
969	414	1	BASEBOARD	B	VINYL	BROWN	INTACT	-0.2	
970	414	1	RADIATOR	C	METAL	WHITE	INTACT	0.1	
971	414	2	WALL	A	DRYWALL	WHITE	INTACT	0.1	
972	414	2	WALL	B	PLASTER	WHITE	INTACT	0.0	
973	414	2	WALL	C	PLASTER	WHITE	INTACT	0.2	
974	414	2	WALL	D	DRYWALL	WHITE	INTACT	0.2	
975	414	2	FLOOR	A	TILE	WHITE	INTACT	-0.1	
976	414	2	CEILING	A	CONCRETE	WHITE	INTACT	0.3	
977	414	2	BASEBOARD	B	VINYL	BROWN	INTACT	0.2	
978	414	2	RADIATOR	C	METAL	WHITE	INTACT	0.2	
979	414	2	DOOR	D	WOOD	WHITE	INTACT	0.3	
980	414	2	DOOR FRAME	D	METAL	BROWN	INTACT	-0.2	
981	414	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	-0.1	
982	414	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.0	
983	414	3	WALL	A	CONCRETE	WHITE	INTACT	-0.1	
984	414	3	WALL	B	PLASTER	WHITE	INTACT	0.2	
985	414	3	WALL	C	DRYWALL	WHITE	INTACT	0.0	
986	414	3	WALL	D	DRYWALL	WHITE	INTACT	-0.2	
987	414	3	FLOOR	A	VINYL	WHITE	INTACT	0.1	
988	414	3	CEILING	A	CONCRETE	WHITE	INTACT	-0.2	
989	414	3	BASEBOARD	A	VINYL	BROWN	INTACT	0.0	
990	414	3	DOOR	C	WOOD	WHITE	INTACT	-0.2	
991	414	3	DOOR FRAME	C	METAL	BROWN	INTACT	0.1	
992	414	3	CABINET	D	WOOD	BROWN	INTACT	0.0	
993	414	3	SHOWER WALL	A	TILE	WHITE	INTACT	0.1	
994	414	3	WALL TRIM	B	WOOD	WHITE	INTACT	0.1	
995	414	3	VENT	D	METAL	WHITE	INTACT	0.2	
996	414	4	WALL	A	DRYWALL	BEIGE	INTACT	-0.2	
997	414	4	WALL	B	DRYWALL	BEIGE	INTACT	0.2	
998	414	4	WALL	C	DRYWALL	BEIGE	INTACT	0.0	
999	414	4	WALL	D	DRYWALL	BEIGE	INTACT	-0.2	
1000	414	4	FLOOR	A	TILE	WHITE	INTACT	0.2	
1001	414	4	CEILING	A	CONCRETE	WHITE	INTACT	0.2	
1002	414	4	BASEBOARD	A	VINYL	BROWN	INTACT	-0.2	
1003	414	4	ELECTRIC PANEL	A	METAL	WHITE	INTACT	-0.2	
1004	414	4	DOOR	A	WOOD	WHITE	INTACT	0.0	
1005	414	4	DOOR FRAME	A	METAL	BROWN	INTACT	-0.1	
1006	414	4	CLOSET DOOR	D	LAMINATE	WHITE	INTACT	0.3	
1007	414	4	CLOSET WALL	D	PLASTER	WHITE	INTACT	0.0	
1008	414	4	CABINET	B	WOOD	BROWN	INTACT	0.0	
1009	414	4	CABINET DOOR	B	WOOD	BROWN	INTACT	0.1	
1010	415	1	CEILING	A	CONCRETE	WHITE	INTACT	0.6	
1011	415	1	WALL	A	DRYWALL	WHITE	INTACT	0.3	
1012	415	1	WALL	B	DRYWALL	WHITE	INTACT	0.2	
1013	415	1	WALL	C	PLASTER	WHITE	INTACT	0.2	
1014	415	1	WALL	D	PLASTER	WHITE	INTACT	0.2	
1015	415	1	FLOOR	A	TILE	WHITE	INTACT	0.2	
1016	415	1	BASEBOARD	C	VINYL	BROWN	INTACT	0.3	
1017	415	1	RADIATOR	C	METAL	WHITE	INTACT	0.0	
1018	415	2	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
1019	415	2	WALL	A	DRYWALL	WHITE	INTACT	0.2	
1020	415	2	WALL	B	PLASTER	WHITE	INTACT	0.3	
1021	415	2	WALL	C	PLASTER	WHITE	INTACT	0.0	
1022	415	2	WALL	D	DRYWALL	WHITE	INTACT	-0.1	
1023	415	2	FLOOR	A	TILE	WHITE	INTACT	0.1	
1024	415	2	BASEBOARD	B	VINYL	BROWN	INTACT	0.0	
1025	415	2	RADIATOR	C	METAL	WHITE	INTACT	0.1	
1026	415	2	DOOR	D	WOOD	WHITE	INTACT	-0.1	
1027	415	2	DOOR FRAME	D	METAL	BROWN	INTACT	0.1	
1028	415	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	0.0	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
1029	415	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.1	
1030	415	3	CEILING	A	CONCRETE	WHITE	INTACT	0.7	
1031	415	3	WALL	A	CONCRETE	WHITE	INTACT	-0.1	
1032	415	3	WALL	B	DRYWALL	WHITE	INTACT	-0.2	
1033	415	3	WALL	C	DRYWALL	WHITE	INTACT	0.1	
1034	415	3	WALL	D	DRYWALL	WHITE	INTACT	-0.1	
1035	415	3	FLOOR	A	VINYL	WHITE	INTACT	0.0	
1036	415	3	BASEBOARD	A	VINYL	BROWN	INTACT	0.0	
1037	415	3	DOOR	C	WOOD	WHITE	INTACT	0.0	
1038	415	3	DOOR FRAME	C	METAL	BROWN	INTACT	0.2	
1039	415	3	CABINET	D	WOOD	BROWN	INTACT	0.2	
1040	415	3	SHOWER WALL	A	TILE	WHITE	INTACT	0.1	
1041	415	3	WALL TRIM	B	WOOD	WHITE	INTACT	0.3	
1042	415	3	VENT	C	METAL	WHITE	INTACT	0.3	
1043	415	4	CEILING	A	CONCRETE	WHITE	INTACT	0.6	
1044	415	4	WALL	A	DRYWALL	BEIGE	INTACT	-0.1	
1045	415	4	WALL	B	DRYWALL	BEIGE	INTACT	0.3	
1046	415	4	WALL	C	DRYWALL	BEIGE	INTACT	0.1	
1047	415	4	WALL	D	DRYWALL	BEIGE	INTACT	0.0	
1048	415	4	FLOOR	A	TILE	WHITE	INTACT	0.1	
1049	415	4	BASEBOARD	A	VINYL	BROWN	INTACT	0.2	
1050	415	4	ELECTRIC PANEL	A	METAL	WHITE	INTACT	0.3	
1051	415	4	DOOR	A	WOOD	WHITE	INTACT	0.0	
1052	415	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.0	
1053	415	4	CLOSET DOOR	D	LAMINATE	WHITE	INTACT	0.3	
1054	415	4	CLOSET WALL	D	PLASTER	WHITE	INTACT	-0.2	
1055	415	4	CABINET	B	WOOD	BROWN	INTACT	0.1	
1056	415	4	CABINET DOOR	B	WOOD	BROWN	INTACT	-0.2	
1057	504	1	CEILING	A	CONCRETE	WHITE	INTACT	0.6	
1058	504	1	WALL	B	CONCRETE	BEIGE	INTACT	0.3	
1059	504	1	WALL	C	CONCRETE	BEIGE	INTACT	0.2	
1060	504	1	BASEBOARD	B	VINYL	BROWN	INTACT	0.2	
1061	504	1	WALL	A	DRYWALL	BEIGE	INTACT	0.0	
1062	504	1	FLOOR	A	TILE	TAN	INTACT	0.2	
1063	504	1	RADIATOR	C	METAL	BEIGE	INTACT	0.2	
1064	504	1	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
1065	504	2	FLOOR	A	TILE	TAN	INTACT	0.4	
1066	504	2	BASEBOARD	C	VINYL	BROWN	INTACT	0.2	
1067	504	2	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
1068	504	2	WALL	C	CONCRETE	BEIGE	INTACT	0.1	
1069	504	2	CEILING	A	CONCRETE	WHITE	INTACT	0.1	
1070	504	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.1	
1071	504	2	RADIATOR	C	METAL	BEIGE	INTACT	0.1	
1072	504	2	DOOR FRAME	B	METAL	BROWN	INTACT	0.3	
1073	504	2	WALL	A	DRYWALL	BEIGE	INTACT	-0.1	
1074	504	2	WALL	D	CONCRETE	BEIGE	INTACT	-0.1	
1075	504	2	DOOR	B	WOOD	BEIGE	INTACT	-0.1	
1076	504	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	-0.1	
1077	504	3	FLOOR	A	VINYL	TAN	INTACT	0.3	
1078	504	3	DOOR FRAME	C	METAL	BROWN	INTACT	0.2	
1079	504	3	WALL	A	CONCRETE	BEIGE	INTACT	0.1	
1080	504	3	WALL	D	CONCRETE	BEIGE	INTACT	0.1	
1081	504	3	CEILING	A	CONCRETE	WHITE	INTACT	0.1	
1082	504	3	WALL	C	DRYWALL	BEIGE	INTACT	-0.2	
1083	504	3	BASEBOARD	C	VINYL	TAN	INTACT	-0.2	
1084	504	3	DOOR	C	WOOD	BEIGE	INTACT	0.3	
1085	504	3	CABINET	B	METAL	WHITE	INTACT	0.3	
1086	504	3	SHOWER WALL	A	TILE	WHITE	INTACT	0.2	
1087	504	3	CHAIR RAIL	B	WOOD	BEIGE	INTACT	0.0	
1088	504	3	VENT	B	METAL	BEIGE	INTACT	-0.1	
1089	504	3	WALL	B	DRYWALL	BEIGE	INTACT	-0.1	
1090	504	3	CABINET	D	WOOD	BROWN	INTACT	-0.1	
1091	504	4	FLOOR	A	TILE	TAN	INTACT	0.4	
1092	504	4	DOOR	A	WOOD	BEIGE	INTACT	0.3	
1093	504	4	WALL	C	DRYWALL	BEIGE	INTACT	0.1	
1094	504	4	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
1095	504	4	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
1096	504	4	CEILING	A	CONCRETE	WHITE	INTACT	0.3	
1097	504	4	BASEBOARD	A	VINYL	BROWN	INTACT	0.0	
1098	504	4	ELECTRIC PANEL	A	METAL	BEIGE	INTACT	0.2	
1099	504	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.2	
1100	504	4	CLOSET WALL	B	DRYWALL	BEIGE	INTACT	0.3	
1101	504	4	CABINET DOOR	D	WOOD	BROWN	INTACT	0.0	
1102	504	4	WALL	A	DRYWALL	BEIGE	INTACT	-0.1	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
1103	504	4	CABINET	D	WOOD	BROWN	INTACT	-0.1	
1104	504	4	CLOSET DOOR	B	LAMINATE	BEIGE	INTACT	-0.2	
1105	507	1	WALL	A	DRYWALL	WHITE	INTACT	0.2	
1106	507	1	WALL	B	PLASTER	WHITE	INTACT	0.1	
1107	507	1	WALL	C	PLASTER	WHITE	INTACT	0.0	
1108	507	1	WALL	D	DRYWALL	WHITE	INTACT	0.1	
1109	507	1	FLOOR	A	TILE	WHITE	INTACT	0.1	
1110	507	1	CEILING	A	CONCRETE	WHITE	INTACT	0.2	
1111	507	1	BASEBOARD	A	VINYL	BROWN	INTACT	0.1	
1112	507	1	RADIATOR	C	METAL	WHITE	INTACT	-0.2	
1113	507	2	WALL	A	DRYWALL	WHITE	INTACT	0.2	
1114	507	2	WALL	B	DRYWALL	WHITE	INTACT	-0.1	
1115	507	2	WALL	C	PLASTER	WHITE	INTACT	0.2	
1116	507	2	WALL	D	PLASTER	WHITE	INTACT	-0.1	
1117	507	2	FLOOR	A	TILE	WHITE	INTACT	0.3	
1118	507	2	CEILING	A	CONCRETE	WHITE	INTACT	0.0	
1119	507	2	BASEBOARD	B	VINYL	BROWN	INTACT	-0.2	
1120	507	2	RADIATOR	C	METAL	WHITE	INTACT	0.2	
1121	507	2	DOOR	B	WOOD	WHITE	INTACT	0.0	
1122	507	2	DOOR FRAME	B	METAL	BROWN	INTACT	0.0	
1123	507	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	-0.2	
1124	507	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.1	
1125	507	3	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
1126	507	3	WALL	A	CONCRETE	WHITE	INTACT	0.0	
1127	507	3	WALL	B	DRYWALL	WHITE	INTACT	0.0	
1128	507	3	WALL	C	DRYWALL	WHITE	INTACT	0.3	
1129	507	3	WALL	D	PLASTER	WHITE	INTACT	-0.2	
1130	507	3	FLOOR	A	VINYL	WHITE	INTACT	0.1	
1131	507	3	BASEBOARD	D	VINYL	BROWN	INTACT	0.3	
1132	507	3	DOOR	C	WOOD	WHITE	INTACT	-0.1	
1133	507	3	DOOR FRAME	C	METAL	BROWN	INTACT	-0.1	
1134	507	3	CABINET	B	WOOD	BROWN	INTACT	0.3	
1135	507	3	SHOWER WALL	A	TILE	WHITE	INTACT	-0.2	
1136	507	3	WALL TRIM	D	WOOD	WHITE	INTACT	0.1	
1137	507	3	VENT	B	METAL	WHITE	INTACT	-0.2	
1138	507	4	WALL	A	DRYWALL	BEIGE	INTACT	0.2	
1139	507	4	WALL	B	DRYWALL	BEIGE	INTACT	0.2	
1140	507	4	WALL	C	DRYWALL	BEIGE	INTACT	0.2	
1141	507	4	WALL	D	DRYWALL	BEIGE	INTACT	0.2	
1142	507	4	FLOOR	A	TILE	WHITE	INTACT	0.2	
1143	507	4	CEILING	A	CONCRETE	WHITE	INTACT	0.2	
1144	507	4	BASEBOARD	A	VINYL	BROWN	INTACT	0.1	
1145	507	4	DOOR	A	WOOD	WHITE	INTACT	0.3	
1146	507	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.1	
1147	507	4	CLOSET DOOR	B	LAMINATE	WHITE	INTACT	0.0	
1148	507	4	CLOSET WALL	B	PLASTER	WHITE	INTACT	-0.2	
1149	507	4	CABINET	D	WOOD	BROWN	INTACT	0.0	
1150	507	4	CABINET DOOR	D	WOOD	BROWN	INTACT	0.1	
1151	527	1	WALL	A	DRYWALL	WHITE	INTACT	-0.2	
1152	527	1	WALL	B	PLASTER	WHITE	INTACT	0.2	
1153	527	1	WALL	C	PLASTER	WHITE	INTACT	-0.2	
1154	527	1	WALL	D	DRYWALL	WHITE	INTACT	0.0	
1155	527	1	FLOOR	A	TILE	WHITE	INTACT	0.2	
1156	527	1	CEILING	A	CONCRETE	WHITE	INTACT	0.3	
1157	527	1	BASEBOARD	A	VINYL	BROWN	INTACT	0.1	
1158	527	1	RADIATOR	C	METAL	WHITE	INTACT	0.3	
1159	527	2	WALL	A	DRYWALL	WHITE	INTACT	-0.2	
1160	527	2	WALL	B	DRYWALL	WHITE	INTACT	0.1	
1161	527	2	WALL	C	PLASTER	WHITE	INTACT	0.2	
1162	527	2	WALL	D	PLASTER	WHITE	INTACT	0.3	
1163	527	2	FLOOR	A	TILE	WHITE	INTACT	0.2	
1164	527	2	CEILING	A	CONCRETE	WHITE	INTACT	0.0	
1165	527	2	BASEBOARD	B	VINYL	BROWN	INTACT	0.3	
1166	527	2	RADIATOR	C	METAL	WHITE	INTACT	0.1	
1167	527	2	DOOR	B	WOOD	WHITE	INTACT	-0.1	
1168	527	2	DOOR FRAME	B	METAL	BROWN	INTACT	0.2	
1169	527	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	0.3	
1170	527	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.1	
1171	527	3	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
1172	527	3	WALL	A	CONCRETE	WHITE	INTACT	0.2	
1173	527	3	WALL	B	DRYWALL	WHITE	INTACT	0.1	
1174	527	3	WALL	C	DRYWALL	WHITE	INTACT	-0.1	
1175	527	3	WALL	D	PLASTER	WHITE	INTACT	-0.2	
1176	527	3	FLOOR	A	VINYL	WHITE	INTACT	-0.1	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
1177	527	3	BASEBOARD	D	VINYL	BROWN	INTACT	0.1	
1178	527	3	DOOR	C	WOOD	WHITE	INTACT	-0.1	
1179	527	3	DOOR FRAME	C	METAL	BROWN	INTACT	0.1	
1180	527	3	CABINET	B	WOOD	BROWN	INTACT	0.2	
1181	527	3	SHOWER WALL	A	TILE	WHITE	INTACT	0.2	
1182	527	3	WALL TRIM	D	WOOD	WHITE	INTACT	-0.1	
1183	527	3	VENT	B	METAL	WHITE	INTACT	0.0	
1184	527	4	WALL	A	DRYWALL	BEIGE	INTACT	-0.1	
1185	527	4	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
1186	527	4	WALL	C	DRYWALL	BEIGE	INTACT	-0.2	
1187	527	4	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
1188	527	4	FLOOR	A	TILE	WHITE	INTACT	0.2	
1189	527	4	CEILING	A	CONCRETE	WHITE	INTACT	0.0	
1190	527	4	BASEBOARD	A	VINYL	BROWN	INTACT	-0.1	
1191	527	4	DOOR	A	WOOD	WHITE	INTACT	0.1	
1192	527	4	DOOR FRAME	A	METAL	BROWN	INTACT	-0.2	
1193	527	4	CLOSET DOOR	B	LAMINATE	WHITE	INTACT	-0.1	
1194	527	4	CLOSET WALL	B	PLASTER	WHITE	INTACT	0.3	
1195	527	4	CABINET	D	WOOD	BROWN	INTACT	0.3	
1196	527	4	CABINET DOOR	D	WOOD	BROWN	INTACT	-0.2	
1197	615	1	RADIATOR	C	METAL	BEIGE	INTACT	0.5	
1198	615	1	CEILING	A	CONCRETE	WHITE	INTACT	0.4	
1199	615	1	WALL	C	CONCRETE	BEIGE	INTACT	0.2	
1200	615	1	WALL	D	CONCRETE	BEIGE	INTACT	0.1	
1201	615	1	BASEBOARD	B	VINYL	TAN	INTACT	0.1	
1202	615	1	WALL	A	DRYWALL	BEIGE	INTACT	-0.2	
1203	615	1	FLOOR	A	TILE	TAN	INTACT	0.3	
1204	615	1	WALL	B	DRYWALL	BEIGE	INTACT	-0.1	
1205	615	2	RADIATOR	C	METAL	BEIGE	INTACT	0.7	
1206	615	2	CEILING	A	CONCRETE	WHITE	INTACT	0.6	
1207	615	2	DOOR FRAME	D	METAL	BROWN	INTACT	0.5	
1208	615	2	WALL	C	CONCRETE	BEIGE	INTACT	0.3	
1209	615	2	WALL	B	CONCRETE	BEIGE	INTACT	0.2	
1210	615	2	FLOOR	A	TILE	TAN	INTACT	0.1	
1211	615	2	WALL	A	DRYWALL	BEIGE	INTACT	0.3	
1212	615	2	DOOR	D	WOOD	BEIGE	INTACT	0.0	
1213	615	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	0.1	
1214	615	2	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
1215	615	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	-0.1	
1216	615	3	CABINET	D	METAL	WHITE	INTACT	0.5	
1217	615	3	WALL	B	CONCRETE	BEIGE	INTACT	0.4	
1218	615	3	DOOR FRAME	C	METAL	BROWN	INTACT	0.4	
1219	615	3	CEILING	A	CONCRETE	WHITE	INTACT	0.3	
1220	615	3	DOOR	C	WOOD	BEIGE	INTACT	0.1	
1221	615	3	WALL	A	CONCRETE	BEIGE	INTACT	-0.2	
1222	615	3	WALL	C	DRYWALL	BEIGE	INTACT	0.1	
1223	615	3	BASEBOARD	C	VINYL	TAN	INTACT	0.1	
1224	615	3	CABINET	D	WOOD	BROWN	INTACT	-0.1	
1225	615	3	SHOWER WALL	A	TILE	WHITE	INTACT	0.3	
1226	615	3	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
1227	615	3	FLOOR	A	VINYL	TAN	INTACT	-0.1	
1228	615	3	CHAIR RAIL	D	WOOD	BEIGE	INTACT	-0.1	
1229	615	4	CEILING	A	CONCRETE	WHITE	INTACT	0.6	
1230	615	4	FLOOR	A	TILE	TAN	INTACT	0.2	
1231	615	4	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
1232	615	4	CABINET DOOR	B	WOOD	BROWN	INTACT	0.1	
1233	615	4	WALL	A	DRYWALL	BEIGE	INTACT	0.2	
1234	615	4	WALL	C	DRYWALL	BEIGE	INTACT	0.3	
1235	615	4	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
1236	615	4	BASEBOARD	A	VINYL	TAN	INTACT	0.3	
1237	615	4	ELECTRIC PANEL	A	METAL	BEIGE	INTACT	0.2	
1238	615	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.0	
1239	615	4	CLOSET DOOR	D	LAMINATE	BEIGE	INTACT	0.3	
1240	615	4	CABINET	B	WOOD	BROWN	INTACT	0.1	
1241	615	4	CLOSET WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
1242	615	4	DOOR	A	WOOD	BEIGE	INTACT	-0.2	
1243	616	1	WALL	A	DRYWALL	WHITE	INTACT	-0.2	
1244	616	1	WALL	B	DRYWALL	WHITE	INTACT	0.3	
1245	616	1	WALL	C	PLASTER	WHITE	INTACT	0.1	
1246	616	1	WALL	D	PLASTER	WHITE	INTACT	0.2	
1247	616	1	FLOOR	A	TILE	WHITE	INTACT	0.1	
1248	616	1	CEILING	A	DRYWALL	WHITE	INTACT	0.2	
1249	616	1	BASEBOARD	A	VINYL	BROWN	INTACT	-0.2	
1250	616	1	RADIATOR	C	METAL	WHITE	INTACT	0.0	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
1251	616	2	WALL	A	DRYWALL	WHITE	INTACT	-0.1	
1252	616	2	WALL	B	PLASTER	WHITE	INTACT	-0.1	
1253	616	2	WALL	C	PLASTER	WHITE	INTACT	-0.2	
1254	616	2	WALL	D	DRYWALL	WHITE	INTACT	-0.2	
1255	616	2	FLOOR	A	TILE	WHITE	INTACT	0.2	
1256	616	2	CEILING	A	DRYWALL	WHITE	INTACT	-0.1	
1257	616	2	RADIATOR	C	METAL	WHITE	INTACT	0.0	
1258	616	2	DOOR	D	WOOD	WHITE	INTACT	0.2	
1259	616	2	DOOR FRAME	D	METAL	BROWN	INTACT	0.2	
1260	616	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	0.3	
1261	616	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.3	
1262	616	3	CEILING	A	DRYWALL	WHITE	INTACT	0.5	
1263	616	3	WALL	A	CONCRETE	WHITE	INTACT	-0.1	
1264	616	3	WALL	B	PLASTER	WHITE	INTACT	0.2	
1265	616	3	WALL	C	DRYWALL	WHITE	INTACT	-0.2	
1266	616	3	WALL	D	DRYWALL	WHITE	INTACT	0.0	
1267	616	3	FLOOR	A	TILE	WHITE	INTACT	0.1	
1268	616	3	BASEBOARD	B	VINYL	BROWN	INTACT	0.2	
1269	616	3	DOOR	C	WOOD	WHITE	INTACT	0.3	
1270	616	3	DOOR FRAME	C	METAL	BROWN	POOR	0.2	
1271	616	3	CABINET	D	WOOD	BROWN	INTACT	0.1	
1272	616	3	SHOWER WALL	A	TILE	WHITE	INTACT	0.0	
1273	616	3	WALL TRIM	B	WOOD	WHITE	INTACT	0.1	
1274	616	3	VENT	D	METAL	WHITE	INTACT	-0.2	
1275	616	4	WALL	A	DRYWALL	BEIGE	INTACT	0.1	
1276	616	4	WALL	B	DRYWALL	BEIGE	INTACT	0.2	
1277	616	4	WALL	C	DRYWALL	BEIGE	INTACT	-0.1	
1278	616	4	WALL	D	DRYWALL	BEIGE	INTACT	0.0	
1279	616	4	FLOOR	A	TILE	WHITE	INTACT	0.2	
1280	616	4	CEILING	A	DRYWALL	WHITE	INTACT	0.2	
1281	616	4	BASEBOARD	B	VINYL	BROWN	INTACT	-0.2	
1282	616	4	DOOR	A	WOOD	WHITE	INTACT	0.2	
1283	616	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.0	
1284	616	4	CLOSET DOOR	D	LAMINATE	WHITE	INTACT	-0.1	
1285	616	4	CLOSET WALL	D	PLASTER	WHITE	INTACT	0.1	
1286	616	4	CABINET	B	WOOD	BROWN	INTACT	-0.2	
1287	616	4	CABINET DOOR	B	WOOD	BROWN	INTACT	0.2	
1288	618	1	WALL	A	DRYWALL	WHITE	INTACT	0.0	
1289	618	1	WALL	B	DRYWALL	WHITE	INTACT	-0.2	
1290	618	1	WALL	C	PLASTER	WHITE	INTACT	0.0	
1291	618	1	WALL	D	PLASTER	WHITE	INTACT	0.1	
1292	618	1	FLOOR	A	TILE	WHITE	INTACT	0.3	
1293	618	1	CEILING	A	DRYWALL	WHITE	INTACT	0.3	
1294	618	1	BASEBOARD	B	VINYL	BROWN	INTACT	0.0	
1295	618	1	RADIATOR	C	METAL	WHITE	INTACT	-0.2	
1296	618	2	WALL	A	DRYWALL	WHITE	INTACT	0.3	
1297	618	2	WALL	B	PLASTER	WHITE	INTACT	-0.1	
1298	618	2	WALL	C	PLASTER	WHITE	INTACT	-0.2	
1299	618	2	WALL	D	DRYWALL	WHITE	INTACT	0.2	
1300	618	2	FLOOR	A	TILE	WHITE	INTACT	0.2	
1301	618	2	CEILING	A	DRYWALL	WHITE	INTACT	0.3	
1302	618	2	BASEBOARD	B	VINYL	BROWN	INTACT	0.3	
1303	618	2	RADIATOR	C	METAL	WHITE	INTACT	0.3	
1304	618	2	DOOR	D	WOOD	WHITE	INTACT	0.0	
1305	618	2	DOOR FRAME	D	METAL	BROWN	INTACT	0.0	
1306	618	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	0.0	
1307	618	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	-0.1	
1308	618	3	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
1309	618	3	WALL	A	CONCRETE	WHITE	INTACT	0.1	
1310	618	3	WALL	B	PLASTER	WHITE	INTACT	-0.1	
1311	618	3	WALL	C	DRYWALL	WHITE	INTACT	-0.1	
1312	618	3	WALL	D	DRYWALL	WHITE	INTACT	0.1	
1313	618	3	FLOOR	A	VINYL	WHITE	INTACT	-0.2	
1314	618	3	BASEBOARD	B	VINYL	BROWN	INTACT	0.1	
1315	618	3	DOOR	C	WOOD	WHITE	INTACT	0.2	
1316	618	3	DOOR FRAME	C	METAL	BROWN	INTACT	0.1	
1317	618	3	CABINET	D	WOOD	BROWN	INTACT	0.3	
1318	618	3	SHOWER WALL	A	TILE	WHITE	INTACT	-0.2	
1319	618	3	WALL TRIM	B	WOOD	WHITE	INTACT	0.2	
1320	618	3	VENT	D	METAL	WHITE	INTACT	-0.1	
1321	618	4	WALL	A	DRYWALL	BEIGE	INTACT	-0.1	
1322	618	4	WALL	B	DRYWALL	BEIGE	INTACT	0.3	
1323	618	4	WALL	C	DRYWALL	BEIGE	INTACT	-0.2	
1324	618	4	WALL	D	DRYWALL	BEIGE	INTACT	0.1	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
1325	618	4	FLOOR	A	TILE	WHITE	INTACT	0.2	
1326	618	4	CEILING	A	DRYWALL	WHITE	INTACT	0.1	
1327	618	4	BASEBOARD	A	VINYL	BROWN	INTACT	0.0	
1328	618	4	RADIATOR	C	METAL	WHITE	INTACT	0.2	
1329	618	4	DOOR	A	WOOD	WHITE	INTACT	0.1	
1330	618	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.1	
1331	618	4	CLOSET DOOR	D	LAMINATE	WHITE	INTACT	0.3	
1332	618	4	CLOSET WALL	D	PLASTER	WHITE	INTACT	0.2	
1333	618	4	CABINET	B	WOOD	BROWN	INTACT	-0.2	
1334	618	4	CABINET DOOR	B	WOOD	BROWN	INTACT	-0.2	
1335	627	1	WALL	A	DRYWALL	WHITE	INTACT	0.0	
1336	627	1	WALL	B	DRYWALL	WHITE	INTACT	0.1	
1337	627	1	WALL	C	PLASTER	WHITE	INTACT	0.1	
1338	627	1	WALL	D	PLASTER	WHITE	INTACT	0.2	
1339	627	1	FLOOR	A	TILE	WHITE	INTACT	0.2	
1340	627	1	CEILING	A	DRYWALL	WHITE	INTACT	-0.2	
1341	627	1	BASEBOARD	A	VINYL	BROWN	INTACT	-0.1	
1342	627	1	RADIATOR	A	METAL	WHITE	INTACT	0.1	
1343	627	2	WALL	A	DRYWALL	WHITE	INTACT	-0.1	
1344	627	2	WALL	B	PLASTER	WHITE	INTACT	0.3	
1345	627	2	WALL	C	PLASTER	WHITE	INTACT	0.0	
1346	627	2	WALL	D	DRYWALL	WHITE	INTACT	0.3	
1347	627	2	FLOOR	A	TILE	WHITE	INTACT	0.1	
1348	627	2	CEILING	A	DRYWALL	WHITE	INTACT	-0.1	
1349	627	2	BASEBOARD	C	VINYL	BROWN	INTACT	0.1	
1350	627	2	RADIATOR	C	METAL	WHITE	INTACT	0.2	
1351	627	2	DOOR	D	WOOD	WHITE	INTACT	0.2	
1352	627	2	DOOR FRAME	D	METAL	BROWN	INTACT	0.2	
1353	627	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	-0.2	
1354	627	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.1	
1355	627	3	CEILING	A	DRYWALL	WHITE	INTACT	0.4	
1356	627	3	WALL	A	CONCRETE	WHITE	INTACT	0.3	
1357	627	3	WALL	B	PLASTER	WHITE	INTACT	0.2	
1358	627	3	WALL	C	DRYWALL	WHITE	INTACT	0.3	
1359	627	3	WALL	D	DRYWALL	WHITE	INTACT	0.2	
1360	627	3	FLOOR	A	VINYL	WHITE	INTACT	0.1	
1361	627	3	BASEBOARD	B	VINYL	BROWN	INTACT	-0.2	
1362	627	3	DOOR	C	WOOD	WHITE	INTACT	0.0	
1363	627	3	DOOR FRAME	C	METAL	BROWN	INTACT	0.2	
1364	627	3	CABINET	D	WOOD	BROWN	INTACT	-0.1	
1365	627	3	SHOWER WALL	A	TILE	WHITE	INTACT	-0.1	
1366	627	3	WALL TRIM	B	WOOD	WHITE	INTACT	0.2	
1367	627	3	VENT	D	METAL	WHITE	INTACT	0.0	
1368	627	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.7	
1369	627	4	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
1370	627	4	WALL	A	DRYWALL	BEIGE	INTACT	0.0	
1371	627	4	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
1372	627	4	WALL	C	DRYWALL	BEIGE	INTACT	0.0	
1373	627	4	WALL	D	DRYWALL	BEIGE	INTACT	0.3	
1374	627	4	FLOOR	A	TILE	WHITE	INTACT	-0.2	
1375	627	4	BASEBOARD	B	VINYL	BROWN	INTACT	0.2	
1376	627	4	DOOR	A	WOOD	WHITE	INTACT	0.2	
1377	627	4	CLOSET DOOR	D	LAMINATE	WHITE	INTACT	0.1	
1378	627	4	CLOSET WALL	D	PLASTER	WHITE	INTACT	0.2	
1379	627	4	CABINET	B	WOOD	BROWN	INTACT	-0.2	
1380	627	4	CABINET DOOR	B	WOOD	BROWN	INTACT	-0.2	
1381	717	1	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
1382	717	1	RADIATOR	B	METAL	BEIGE	INTACT	0.4	
1383	717	1	WALL	C	CONCRETE	BEIGE	INTACT	0.2	
1384	717	1	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
1385	717	1	WALL	D	CONCRETE	BEIGE	INTACT	0.1	
1386	717	1	FLOOR	A	TILE	TAN	INTACT	0.1	
1387	717	1	BASEBOARD	C	VINYL	BROWN	INTACT	0.1	
1388	717	1	WALL	A	DRYWALL	BEIGE	INTACT	0.1	
1389	717	2	WALL	C	CONCRETE	BEIGE	INTACT	0.3	
1390	717	2	CEILING	A	CONCRETE	WHITE	INTACT	0.3	
1391	717	2	WALL	B	CONCRETE	BEIGE	INTACT	0.2	
1392	717	2	WALL	A	DRYWALL	BEIGE	INTACT	0.1	
1393	717	2	RADIATOR	C	METAL	BEIGE	INTACT	0.1	
1394	717	2	FLOOR	A	TILE	TAN	INTACT	-0.1	
1395	717	2	BASEBOARD	B	VINYL	BROWN	INTACT	0.1	
1396	717	2	DOOR	B	WOOD	BEIGE	INTACT	-0.2	
1397	717	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.2	
1398	717	2	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
1399	717	2	DOOR FRAME	B	METAL	BROWN	INTACT	-0.1	
1400	717	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	-0.1	
1401	717	3	CEILING	A	CONCRETE	WHITE	INTACT	0.2	
1402	717	3	FLOOR	A	VINYL	TAN	INTACT	0.1	
1403	717	3	CABINET	D	WOOD	BROWN	INTACT	0.1	
1404	717	3	WALL	A	DRYWALL	BEIGE	INTACT	-0.1	
1405	717	3	WALL	C	DRYWALL	BEIGE	INTACT	0.0	
1406	717	3	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
1407	717	3	BASEBOARD	C	VINYL	TAN	INTACT	0.2	
1408	717	3	DOOR	C	WOOD	BEIGE	INTACT	-0.1	
1409	717	3	CABINET	D	METAL	WHITE	INTACT	0.0	
1410	717	3	SHOWER WALL	A	TILE	WHITE	INTACT	0.2	
1411	717	3	CHAIR RAIL	D	WOOD	BEIGE	INTACT	0.2	
1412	717	3	WALL	B	DRYWALL	BEIGE	INTACT	-0.1	
1413	717	3	DOOR FRAME	C	METAL	BROWN	INTACT	-0.1	
1414	717	4	CEILING	A	CONCRETE	WHITE	INTACT	0.5	
1415	717	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.2	
1416	717	4	WALL	A	DRYWALL	BEIGE	INTACT	0.1	
1417	717	4	FLOOR	A	TILE	TAN	INTACT	0.1	
1418	717	4	WALL	B	DRYWALL	BEIGE	INTACT	-0.1	
1419	717	4	ELECTRIC PANEL	A	METAL	BEIGE	INTACT	-0.2	
1420	717	4	DOOR	A	WOOD	BEIGE	INTACT	0.0	
1421	717	4	CLOSET WALL	D	DRYWALL	BEIGE	INTACT	-0.2	
1422	717	4	CABINET	B	WOOD	BROWN	INTACT	-0.1	
1423	717	4	WALL	C	DRYWALL	BEIGE	INTACT	-0.1	
1424	717	4	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
1425	717	4	BASEBOARD	B	VINYL	TAN	INTACT	-0.1	
1426	717	4	CLOSET DOOR	D	LAMINATE	BEIGE	INTACT	-0.1	
1427	717	4	CABINET DOOR	B	WOOD	BROWN	INTACT	-0.1	
1428	718	1	WALL	A	DRYWALL	WHITE	INTACT	0.2	
1429	718	1	WALL	B	DRYWALL	WHITE	INTACT	0.3	
1430	718	1	WALL	C	PLASTER	WHITE	INTACT	0.2	
1431	718	1	WALL	D	PLASTER	WHITE	INTACT	0.1	
1432	718	1	FLOOR	A	TILE	WHITE	INTACT	-0.2	
1433	718	1	CEILING	A	DRYWALL	WHITE	INTACT	-0.2	
1434	718	1	BASEBOARD	B	VINYL	BROWN	INTACT	0.3	
1435	718	1	RADIATOR	C	METAL	WHITE	INTACT	-0.1	
1436	718	2	WALL	A	DRYWALL	WHITE	INTACT	-0.2	
1437	718	2	WALL	B	PLASTER	WHITE	INTACT	0.1	
1438	718	2	WALL	C	PLASTER	WHITE	INTACT	0.2	
1439	718	2	WALL	D	DRYWALL	WHITE	INTACT	0.1	
1440	718	2	FLOOR	A	TILE	WHITE	INTACT	0.0	
1441	718	2	CEILING	A	DRYWALL	WHITE	INTACT	0.1	
1442	718	2	BASEBOARD	A	VINYL	BROWN	INTACT	-0.1	
1443	718	2	RADIATOR	C	METAL	WHITE	INTACT	0.0	
1444	718	2	DOOR	D	WOOD	WHITE	INTACT	0.1	
1445	718	2	DOOR FRAME	D	METAL	BROWN	INTACT	-0.1	
1446	718	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	0.0	
1447	718	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.2	
1448	718	3	WALL	A	CONCRETE	WHITE	INTACT	0.3	
1449	718	3	WALL	B	PLASTER	WHITE	INTACT	0.1	
1450	718	3	WALL	C	DRYWALL	WHITE	INTACT	-0.1	
1451	718	3	WALL	D	DRYWALL	WHITE	INTACT	0.1	
1452	718	3	FLOOR	A	VINYL	WHITE	INTACT	-0.1	
1453	718	3	CEILING	A	DRYWALL	WHITE	INTACT	0.3	
1454	718	3	BASEBOARD	B	VINYL	BROWN	INTACT	0.3	
1455	718	3	DOOR	C	WOOD	WHITE	INTACT	0.3	
1456	718	3	DOOR FRAME	C	METAL	BROWN	INTACT	0.0	
1457	718	3	CABINET	D	WOOD	BROWN	INTACT	0.0	
1458	718	3	SHOWER WALL	A	TILE	WHITE	INTACT	-0.1	
1459	718	3	WALL TRIM	D	WOOD	WHITE	INTACT	-0.1	
1460	718	3	VENT	B	METAL	WHITE	INTACT	-0.2	
1461	718	4	WALL	A	DRYWALL	BEIGE	INTACT	0.1	
1462	718	4	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
1463	718	4	WALL	C	DRYWALL	BEIGE	INTACT	0.3	
1464	718	4	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
1465	718	4	FLOOR	A	TILE	WHITE	INTACT	-0.1	
1466	718	4	CEILING	A	DRYWALL	WHITE	INTACT	0.3	
1467	718	4	BASEBOARD	A	VINYL	BROWN	INTACT	0.1	
1468	718	4	DOOR	A	WOOD	WHITE	INTACT	0.3	
1469	718	4	DOOR FRAME	A	METAL	BROWN	INTACT	-0.2	
1470	718	4	CLOSET DOOR	D	LAMINATE	WHITE	INTACT	0.2	
1471	718	4	CLOSET WALL	D	PLASTER	WHITE	INTACT	0.0	
1472	718	4	CABINET	B	WOOD	BROWN	INTACT	-0.2	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
1473	718	4	CABINET DOOR	B	WOOD	BROWN	INTACT	-0.1	
1474	800	1	WALL	A	DRYWALL	WHITE	INTACT	0.1	
1475	800	1	WALL	B	PLASTER	WHITE	INTACT	-0.1	
1476	800	1	WALL	C	PLASTER	WHITE	INTACT	0.0	
1477	800	1	WALL	D	DRYWALL	WHITE	INTACT	0.3	
1478	800	1	FLOOR	A	TILE	WHITE	INTACT	0.1	
1479	800	1	CEILING	A	DRYWALL	WHITE	INTACT	0.3	
1480	800	1	BASEBOARD	D	VINYL	BROWN	INTACT	-0.1	
1481	800	1	RADIATOR	C	METAL	WHITE	INTACT	0.1	
1482	800	2	WALL	A	DRYWALL	WHITE	INTACT	0.1	
1483	800	2	WALL	B	DRYWALL	WHITE	INTACT	0.2	
1484	800	2	WALL	C	PLASTER	WHITE	INTACT	0.0	
1485	800	2	WALL	D	PLASTER	WHITE	INTACT	-0.1	
1486	800	2	FLOOR	A	TILE	WHITE	INTACT	0.3	
1487	800	2	CEILING	A	DRYWALL	WHITE	INTACT	0.0	
1488	800	2	BASEBOARD	B	VINYL	BROWN	INTACT	0.3	
1489	800	2	RADIATOR	C	METAL	WHITE	INTACT	0.2	
1490	800	2	DOOR	D	WOOD	WHITE	INTACT	0.2	
1491	800	2	DOOR FRAME	D	METAL	BROWN	INTACT	0.3	
1492	800	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	0.2	
1493	800	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	-0.2	
1494	800	3	WALL	A	CONCRETE	WHITE	INTACT	-0.1	
1495	800	3	WALL	B	DRYWALL	WHITE	INTACT	-0.2	
1496	800	3	WALL	C	DRYWALL	WHITE	INTACT	-0.1	
1497	800	3	WALL	D	PLASTER	WHITE	INTACT	0.1	
1498	800	3	FLOOR	A	VINYL	WHITE	INTACT	0.3	
1499	800	3	CEILING	A	DRYWALL	WHITE	INTACT	0.2	
1500	800	3	BASEBOARD	D	VINYL	BROWN	INTACT	0.2	
1501	800	3	DOOR	C	WOOD	WHITE	INTACT	-0.2	
1502	800	3	DOOR FRAME	C	METAL	BROWN	INTACT	0.2	
1503	800	3	CABINET	B	WOOD	BROWN	INTACT	0.1	
1504	800	3	SHOWER WALL	A	TILE	WHITE	INTACT	0.0	
1505	800	3	WALL TRIM	D	WOOD	WHITE	INTACT	0.2	
1506	800	3	VENT	B	METAL	WHITE	INTACT	-0.1	
1507	800	4	WALL	A	DRYWALL	BEIGE	INTACT	0.0	
1508	800	4	WALL	B	DRYWALL	BEIGE	INTACT	0.2	
1509	800	4	WALL	C	DRYWALL	BEIGE	INTACT	0.3	
1510	800	4	WALL	D	DRYWALL	BEIGE	INTACT	0.2	
1511	800	4	FLOOR	A	TILE	WHITE	INTACT	-0.1	
1512	800	4	CEILING	A	DRYWALL	WHITE	INTACT	0.0	
1513	800	4	BASEBOARD	A	VINYL	BROWN	INTACT	-0.2	
1514	800	4	DOOR	A	WOOD	WHITE	INTACT	0.1	
1515	800	4	DOOR FRAME	A	METAL	BROWN	INTACT	-0.2	
1516	800	4	CLOSET DOOR	B	LAMINATE	WHITE	INTACT	0.0	
1517	800	4	CLOSET WALL	B	PLASTER	WHITE	INTACT	-0.2	
1518	800	4	CABINET	D	WOOD	BROWN	INTACT	0.2	
1519	800	4	CABINET DOOR	D	WOOD	BROWN	INTACT	0.0	
1520	810	1	WALL	A	DRYWALL	WHITE	INTACT	0.3	
1521	810	1	WALL	B	PLASTER	WHITE	INTACT	0.0	
1522	810	1	WALL	C	PLASTER	WHITE	INTACT	0.2	
1523	810	1	WALL	D	DRYWALL	WHITE	INTACT	0.2	
1524	810	1	FLOOR	A	TILE	WHITE	INTACT	-0.2	
1525	810	1	CEILING	A	DRYWALL	WHITE	INTACT	0.3	
1526	810	1	BASEBOARD	B	VINYL	BROWN	INTACT	0.2	
1527	810	1	RADIATOR	C	METAL	WHITE	INTACT	0.3	
1528	810	2	WALL	A	DRYWALL	WHITE	INTACT	0.3	
1529	810	2	WALL	B	DRYWALL	WHITE	INTACT	0.3	
1530	810	2	WALL	C	PLASTER	WHITE	INTACT	-0.1	
1531	810	2	WALL	D	PLASTER	WHITE	INTACT	-0.2	
1532	810	2	FLOOR	A	TILE	WHITE	INTACT	-0.1	
1533	810	2	CEILING	A	DRYWALL	WHITE	INTACT	0.2	
1534	810	2	BASEBOARD	B	VINYL	BROWN	INTACT	0.2	
1535	810	2	RADIATOR	C	METAL	WHITE	INTACT	-0.2	
1536	810	2	DOOR	B	WOOD	WHITE	INTACT	0.3	
1537	810	2	DOOR FRAME	B	METAL	BROWN	INTACT	-0.1	
1538	810	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	-0.1	
1539	810	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.3	
1540	810	3	WALL	A	CONCRETE	WHITE	INTACT	-0.2	
1541	810	3	WALL	B	DRYWALL	WHITE	INTACT	0.0	
1542	810	3	WALL	C	DRYWALL	WHITE	INTACT	0.2	
1543	810	3	WALL	D	PLASTER	WHITE	INTACT	-0.1	
1544	810	3	FLOOR	A	TILE	WHITE	INTACT	0.3	
1545	810	3	CEILING	A	DRYWALL	WHITE	INTACT	0.1	
1546	810	3	BASEBOARD	D	VINYL	BROWN	INTACT	0.3	

Address:	Ravoux Hi Rise				
Unit:	280 Ravoux Street				

Sample Number:	Apartment #	Room #	BLDG Component	Location	Substrate	Color	Condition	Reading	Hazard Key
1547	810	3	DOOR	C	WOOD	WHITE	INTACT	-0.2	
1548	810	3	DOOR FRAME	C	METAL	BROWN	INTACT	0.0	
1549	810	3	CABINET	B	WOOD	BROWN	INTACT	0.3	
1550	810	3	SHOWER WALL	A	TILE	WHITE	INTACT	-0.1	
1551	810	3	WALL TRIM	D	WOOD	WHITE	INTACT	0.2	
1552	810	3	VENT	B	METAL	WHITE	INTACT	0.0	
1553	810	4	WALL	A	DRYWALL	BEIGE	INTACT	0.2	
1554	810	4	WALL	B	DRYWALL	BEIGE	INTACT	0.3	
1555	810	4	WALL	C	DRYWALL	BEIGE	INTACT	0.1	
1556	810	4	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
1557	810	4	FLOOR	A	TILE	WHITE	INTACT	0.2	
1558	810	4	CEILING	A	DRYWALL	WHITE	INTACT	0.1	
1559	810	4	BASEBOARD	A	VINYL	BROWN	INTACT	0.0	
1560	810	4	DOOR	A	WOOD	WHITE	INTACT	0.2	
1561	810	4	DOOR FRAME	A	METAL	BROWN	INTACT	-0.1	
1562	810	4	CLOSET DOOR	B	LAMINATE	WHITE	INTACT	-0.2	
1563	810	4	CLOSET WALL	B	PLASTER	WHITE	INTACT	-0.2	
1564	810	4	CABINET	D	WOOD	BROWN	INTACT	0.0	
1565	810	4	CABINET DOOR	D	WOOD	BROWN	INTACT	-0.1	
1566	820	1	WALL	D	CONCRETE	BEIGE	INTACT	0.4	
1567	820	1	WALL	C	CONCRETE	BEIGE	INTACT	0.3	
1568	820	1	RADIATOR	C	METAL	BEIGE	INTACT	0.2	
1569	820	1	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
1570	820	1	BASEBOARD	B	VINYL	BROWN	INTACT	0.1	
1571	820	1	WALL	A	DRYWALL	BEIGE	INTACT	-0.2	
1572	820	1	FLOOR	A	TILE	TAN	INTACT	0.3	
1573	820	1	CEILING	A	DRYWALL	WHITE	INTACT	-0.1	
1574	820	2	WALL	B	CONCRETE	BEIGE	INTACT	0.3	
1575	820	2	WALL	C	CONCRETE	BEIGE	INTACT	0.2	
1576	820	2	DOOR FRAME	D	METAL	BROWN	INTACT	0.2	
1577	820	2	BASEBOARD	D	VINYL	BROWN	INTACT	0.1	
1578	820	2	RADIATOR	C	METAL	BEIGE	INTACT	0.1	
1579	820	2	WALL	A	DRYWALL	BEIGE	INTACT	0.0	
1580	820	2	WALL	D	DRYWALL	BEIGE	INTACT	0.3	
1581	820	2	FLOOR	A	TILE	TAN	INTACT	0.0	
1582	820	2	DOOR	D	WOOD	BEIGE	INTACT	-0.2	
1583	820	2	CLOSET DOOR	A	LAMINATE	BEIGE	INTACT	0.3	
1584	820	2	CLOSET WALL	A	DRYWALL	BEIGE	INTACT	0.1	
1585	820	2	CEILING	A	DRYWALL	WHITE	INTACT	-0.1	
1586	820	3	WALL	A	CONCRETE	BEIGE	INTACT	0.2	
1587	820	3	WALL	B	CONCRETE	BEIGE	INTACT	0.1	
1588	820	3	CEILING	A	CONCRETE	WHITE	INTACT	0.1	
1589	820	3	BASEBOARD	B	VINYL	TAN	INTACT	0.1	
1590	820	3	CABINET	D	WOOD	BROWN	INTACT	0.1	
1591	820	3	SHOWER WALL	A	TILE	WHITE	INTACT	0.1	
1592	820	3	WALL	D	DRYWALL	BEIGE	INTACT	0.3	
1593	820	3	FLOOR	A	VINYL	TAN	INTACT	-0.1	
1594	820	3	DOOR	B	WOOD	BEIGE	INTACT	0.3	
1595	820	3	DOOR FRAME	B	METAL	BROWN	INTACT	0.1	
1596	820	3	CABINET	D	METAL	WHITE	INTACT	0.0	
1597	820	3	WALL	C	DRYWALL	BEIGE	INTACT	-0.1	
1598	820	3	CHAIR RAIL	D	WOOD	BEIGE	INTACT	-0.1	
1599	820	4	WALL	B	DRYWALL	BEIGE	INTACT	0.1	
1600	820	4	FLOOR	A	TILE	TAN	INTACT	0.1	
1601	820	4	DOOR	A	WOOD	BEIGE	INTACT	0.1	
1602	820	4	DOOR FRAME	A	METAL	BROWN	INTACT	0.1	
1603	820	4	WALL	A	DRYWALL	BEIGE	INTACT	-0.1	
1604	820	4	WALL	D	DRYWALL	BEIGE	INTACT	-0.1	
1605	820	4	CEILING	A	CONCRETE	WHITE	INTACT	0.1	
1606	820	4	ELECTRIC PANEL	A	METAL	BEIGE	INTACT	-0.2	
1607	820	4	CLOSET WALL	D	DRYWALL	BEIGE	INTACT	0.0	
1608	820	4	CABINET	B	WOOD	BROWN	INTACT	0.0	
1609	820	4	CABINET DOOR	B	WOOD	BROWN	INTACT	0.0	
1610	820	4	WALL	C	DRYWALL	BEIGE	INTACT	-0.1	
1611	820	4	BASEBOARD	A	VINYL	BROWN	INTACT	-0.1	
1612	820	4	CLOSET DOOR	D	LAMINATE	BEIGE	INTACT	-0.1	

A lead-dust hazard is surface dust exceeding the levels shown below on one or more of the following components:

- Floors: 40µg/Square Foot
- Window Sills: 250µg/Square Foot
- Window Trough: 400 µg/Square Foot

A soil-lead hazard is bare soil with a lead content exceeding the following:

- 100 parts per million in bare soil

Analytical Report
Analysis of Wipe for Lead Determination

TESTED FOR: PSI, Inc
 2401 Pilot Knob Road
 Mendota Heights, MN 551201121
 Attn: Michael Tjaden

Project ID: 0673226-11
 St. Paul PHA
 Ravoux High Rise
 280 Ravoux Street
 St. Paul, MN

Date Received: 11/11/2010 **Date Analyzed:** 11/15/2010 **Date of Issue:** 11/16/2010

Analyst: LM **Work Order:** 1011377 **Page:** 1 of 1


Lab Sample #	Client Sample #	Area (ft ²)	Lead (µg)	Lead (µg/ft ²)	Reporting Limit (µg/ft ²)
001A	280-C-1	1		< 20	20
002A	280-C-2	1		< 20	20
003A	280-C-3	1		< 20	20
004A	280-C-4	1.451		< 14	14
005A	280-C-5	1.778		< 11	11
006A	280-C-6	1		< 20	20
007A	280-C-7	1		< 20	20

Analytical Method: PSI WI-503-815 modified from EPA SW846 7420, 3rd Edition, Nov. 1986

Analysis was performed by flame AA using a PE AAnalyst 400.

Reporting limit = 20µg Pb/Area sampled (ft²)

Respectfully submitted,
 PSI, Inc.



AIHA Lab ID #100373; NYELAP Lab ID #10930; CA Lab ID #2377.

Unless otherwise noted, all samples were acceptable upon receipt.

Sample results are not corrected for blanks.

All quality control sample results are within the acceptance range, unless noted.

All results are based on 2 significant figures. Results relate only to items tested.

Client submitted data is the determining factor in the accuracy of calculated results.

The attached Chain of Custody is incorporated into and becomes a part of the final report.

This report may not be reproduced, except in full, without written approval of PSI, Inc.

Approved Signatory
 Maureen Sammons

Analytical Report
Analysis of Wipe for Lead Determination

TESTED FOR: PSI, Inc
 2401 Pilot Knob Road
 Mendota Heights, MN 551201121
 Attn: Michael Tjaden

Project ID: 0673226-11
 St. Paul PHA
 Ravoux High Rise
 280 Ravoux Street
 St. Paul, MN

Date Received: 11/11/2010 **Date Analyzed:** 11/16/2010 **Date of Issue:** 11/17/2010

Analyst: KP **Work Order:** 1011375 **Page:** 1 of 4


Lab Sample #	Client Sample #	Area (ft ²)	Lead (µg)	Lead (µg/ft ²)	Reporting Limit (µg/ft ²)
001A	280-1	1.451		< 14	14
002A	280-2	1		< 20	20
003A	280-3	1.451		< 14	14
004A	280-4	1		< 20	20
005A	280-5	1		< 20	20
006A	280-6	1.451		< 14	14
007A	280-7	1		< 20	20
008A	280-8	1		< 20	20
009A	280-9	1.451		< 14	14
010A	280-10	1		< 20	20
011A	280-11	1		< 20	20
012A	280-12	1.451		< 14	14
013A	280-13	1		< 20	20
014A	280-14	1		< 20	20
015A	280-15		< 20		
016A	280-16	1.451		< 14	14
017A	280-17	1		< 20	20
018A	280-18	1		< 20	20
019A	280-19	1.451		< 14	14

Analytical Method: PSI WI-503-815 modified from EPA SW846 7420, 3rd Edition, Nov. 1986

Analysis was performed by flame AA using a PE AAnalyst 400.

Reporting limit = 20µg Pb/Area sampled (ft²)

Respectfully submitted,
 PSI, Inc.



AIHA Lab ID #100373; NYELAP Lab ID #10930; CA Lab ID #2377.

Unless otherwise noted, all samples were acceptable upon receipt.

Sample results are not corrected for blanks.

All quality control sample results are within the acceptance range, unless noted.

All results are based on 2 significant figures. Results relate only to items tested.

Client submitted data is the determining factor in the accuracy of calculated results.

The attached Chain of Custody is incorporated into and becomes a part of the final report.

This report may not be reproduced, except in full, without written approval of PSI, Inc.

Approved Signatory
 Maureen Sammons

Analytical Report
Analysis of Wipe for Lead Determination

TESTED FOR: PSI, Inc
 2401 Pilot Knob Road
 Mendota Heights, MN 551201121
 Attn: Michael Tjaden

Project ID: 0673226-11
 St. Paul PHA
 Ravoux High Rise
 280 Ravoux Street
 St. Paul, MN

Date Received: 11/11/2010 **Date Analyzed:** 11/16/2010 **Date of Issue:** 11/17/2010

Analyst: KP **Work Order:** 1011375 **Page:** 2 of 4


Lab Sample #	Client Sample #	Area (ft ²)	Lead (µg)	Lead (µg/ft ²)	Reporting Limit (µg/ft ²)
020A	280-20	1		< 20	20
021A	280-21	1		< 20	20
022A	280-22	1.451		< 14	14
023A	280-23	1		< 20	20
024A	280-24	1		< 20	20
025A	280-25	1.451		< 14	14
026A	280-26	1		< 20	20
027A	280-27	1		< 20	20
028A	280-28	1.451		< 14	14
029A	280-29	1		< 20	20
030A	280-30	1		< 20	20
031A	280-31	1.451		< 14	14
032A	280-32	1		< 20	20
033A	280-33	1		< 20	20
034A	280-34	1.451		< 14	14
035A	280-35	1		< 20	20
036A	280-36	1		< 20	20
037A	280-37	1.451		< 14	14
038A	280-38	1		< 20	20

Analytical Method: PSI WI-503-815 modified from EPA SW846 7420, 3rd Edition, Nov. 1986

Analysis was performed by flame AA using a PE AAnalyst 400.

Reporting limit = 20µg Pb/Area sampled (ft²)

Respectfully submitted,
 PSI, Inc.



AIHA Lab ID #100373; NYELAP Lab ID #10930; CA Lab ID #2377.

Unless otherwise noted, all samples were acceptable upon receipt.

Sample results are not corrected for blanks.

All quality control sample results are within the acceptance range, unless noted.

All results are based on 2 significant figures. Results relate only to items tested.

Client submitted data is the determining factor in the accuracy of calculated results.

The attached Chain of Custody is incorporated into and becomes a part of the final report.

This report may not be reproduced, except in full, without written approval of PSI, Inc.

Approved Signatory
 Maureen Sammons

Analytical Report
Analysis of Wipe for Lead Determination

TESTED FOR: PSI, Inc
 2401 Pilot Knob Road
 Mendota Heights, MN 551201121
 Attn: Michael Tjaden

Project ID: 0673226-11
 St. Paul PHA
 Ravoux High Rise
 280 Ravoux Street
 St. Paul, MN

Date Received: 11/11/2010 **Date Analyzed:** 11/16/2010 **Date of Issue:** 11/17/2010

Analyst: KP **Work Order:** 1011375 **Page:** 3 of 4


Lab Sample #	Client Sample #	Area (ft ²)	Lead (µg)	Lead (µg/ft ²)	Reporting Limit (µg/ft ²)
039A	280-39	1		< 20	20
040A	280-40	1.451		< 14	14
041A	280-41	1		< 20	20
042A	280-42	1		< 20	20
043A	280-43	1.451		< 14	14
044A	280-44	1		< 20	20
045A	280-45	1		< 20	20
046A	280-46	1.451		< 14	14
047A	280-47	1		< 20	20
048A	280-48	1		< 20	20
049A	280-49	1.451		< 14	14
050A	280-50	1		< 20	20
051A	280-51	1		< 20	20
052A	280-52		< 20		
053A	280-53	1.451		< 14	14
054A	280-54	1		< 20	20
055A	280-55	1		< 20	20
056A	280-56	1.451		< 14	14
057A	280-57	1		< 20	20

Analytical Method: PSI WI-503-815 modified from EPA SW846 7420, 3rd Edition, Nov. 1986

Analysis was performed by flame AA using a PE AAnalyst 400.

Reporting limit = 20µg Pb/Area sampled (ft²)

Respectfully submitted,
 PSI, Inc.



AIHA Lab ID #100373; NYELAP Lab ID #10930; CA Lab ID #2377.

Unless otherwise noted, all samples were acceptable upon receipt.

Sample results are not corrected for blanks.

All quality control sample results are within the acceptance range, unless noted.

All results are based on 2 significant figures. Results relate only to items tested.

Client submitted data is the determining factor in the accuracy of calculated results.

The attached Chain of Custody is incorporated into and becomes a part of the final report.

This report may not be reproduced, except in full, without written approval of PSI, Inc.

Approved Signatory
 Maureen Sammons

Analytical Report
Analysis of Wipe for Lead Determination

TESTED FOR: PSI, Inc
 2401 Pilot Knob Road
 Mendota Heights, MN 551201121
 Attn: Michael Tjaden

Project ID: 0673226-11
 St. Paul PHA
 Ravoux High Rise
 280 Ravoux Street
 St. Paul, MN

Date Received: 11/11/2010 **Date Analyzed:** 11/16/2010 **Date of Issue:** 11/17/2010

Analyst: KP **Work Order:** 1011375 **Page:** 4 of 4


Lab Sample #	Client Sample #	Area (ft ²)	Lead (µg)	Lead (µg/ft ²)	Reporting Limit (µg/ft ²)
058A	280-58	1		< 20	20
059A	280-59	1.451		< 14	14
060A	280-60	1		< 20	20
061A	280-61	1		< 20	20

Analytical Method: PSI WI-503-815 modified from EPA SW846 7420, 3rd Edition, Nov. 1986

Analysis was performed by flame AA using a PE AAnalyst 400.

Reporting limit = 20µg Pb/Area sampled (ft²)

Respectfully submitted,
 PSI, Inc.



AIHA Lab ID #100373; NYELAP Lab ID #10930; CA Lab ID #2377.

Unless otherwise noted, all samples were acceptable upon receipt.

Sample results are not corrected for blanks.

All quality control sample results are within the acceptance range, unless noted.

All results are based on 2 significant figures. Results relate only to items tested.

Client submitted data is the determining factor in the accuracy of calculated results.

The attached Chain of Custody is incorporated into and becomes a part of the final report.

This report may not be reproduced, except in full, without written approval of PSI, Inc.

Approved Signatory
 Maureen Sammons

Analytical Report
Analysis of Soil for Lead Determination

TESTED FOR: **PSI, Inc**
2401 Pilot Knob Road
Mendota Heights, MN 551201121
Attn: Michael Tjaden

Project ID: **0673226-11**
St. Paul PHA
Ravoux High Rise
280 Ravoux Street
St. Paul, MN

Date Received: **11/11/2010** Date Analyzed: **11/12/2010** Date of Issue: **11/12/2010**

Analyst: **LM** Work Order: **1011376** Page: **1 of 1**

Lab Sample #	Client Sample #	Lead (mg/kg)	Reporting Limit (mg/kg)
001A	280-S-1	20	20

Analytical Method: PSI WI-503-815 modified from EPA SW846 7420, 3rd Edition, Nov. 1986

Analysis was performed by flame AA using a PE AAnalyst 400.

Reporting limit = 20µg Pb per representative subsample.

Results are based on a representative subsample of the total sample submitted by the client.

AIHA Lab ID #100373; NYELAP Lab ID #10930; CA Lab ID #2377.

Unless otherwise noted, all samples were acceptable upon receipt.

Sample results are not corrected for blanks.

All quality control sample results are within the acceptance range, unless noted.


All results are based on 2 significant figures. Results relate only to items tested.

Client submitted data is the determining factor in the accuracy of calculated results.

The attached Chain of Custody is incorporated into and becomes a part of the final report.

This report may not be reproduced, except in full, without written approval of PSI, Inc.

Respectfully submitted,
PSI, Inc.



Approved Signatory
Maureen Sammons

WIPE SAMPLE LOG

Project Name:	St. Paul PHA
Project Number:	673226-10
Date:	
Risk Assessor:	Mike Tjaden Eric Brazeau
	Ravoux Hi-Rise
Address:	280 Ravoux Street / St. Paul, MN

Sample Number:	APT #	BLDG Component	Room #	Location	Substrate	Measurements	
280-1	810	sill	2	C	stone	5.5 x 38	
↓-2	↓	floor	2	A	tile	12 x 12	
280-3	800	sill	2	C	stone	5.5 x 38	
↓-4	↓	floor	2	A	tile	12 x 12	
↓-5	↓	floor	1	A	tile	12 x 12	
↓-6	718	sill	2	C	stone	5.5 x 38	
↓-7	↓	floor	2	A	tile	12 x 12	
↓-8	↓	↓	1	A	tile	12 x 12	
↓-9	718	sill	1	C	stone	5.5 x 38	
↓-10	↓	floor	2	A	tile	12 x 12	
↓-11	↓	↓	1	A	tile	12 x 12	
↓-12	827	sill	1	C	stone	5.5 x 38	
↓-13	↓	floor	2	A	tile	12 x 12	
↓-14	↓	↓	1	A	↓	12 x 12	
↓-15	Blank						12 x 12
↓-16	818	sill	2	C	stone	5.5 x 38	
↓-17	↓	floor	2	A	tile	12 x 12	
↓-18	↓	↓	1	A	↓	12 x 12	
↓-19	816	sill	1	C	stone	5.5 x 38	
↓-20	↓	floor	2	A	tile	12 x 12	
↓-21	↓	↓	1	A	↓	12 x 12	
↓-22	8527	sill	2	C	stone	5.5 x 38	
↓-23	↓	floor	2	A	tile	12 x 12	
↓-24	↓	↓	1	A	↓	12 x 12	
↓-25	507	sill	1	C	stone	5.5 x 38	
↓-26	↓	floor	2	A	tile	12 x 12	
↓-27	↓	↓	1	A	↓	12 x 12	
↓-28	415	sill	2	C	stone	5.5 x 38	
↓-29	↓	floor	2	A	tile	12 x 12	

Address: 280 Ravoux Street / St. Paul, MN

Sample Number:	APT #	BLDG Component	Room #	Location	Substrate	Measurements	
280-30	415	Floor	1	A	tile	12 x 12	
280-31	414	Sill	2	C	stone	5.5 x 38	
-32	↓	Floor	2	A	tile	12 x 12	
-33	↓	↓	1	A	↓	12 x 12	
-34	407	Sill	2	C	stone	5.5 x 38	
-35	↓	Floor	2	A	tile	12 x 12	
-36	↓	↓	1	A	↓	12 x 12	
-37	315	Sill	2	C	stone	5.5 x 38	
-38	↓	Floor	2	A	tile	12 x 12	
-39	↓	↓	1	A	↓	12 x 12	
-40	221	Sill	2	C	stone	5.5 x 38	
-41	↓	Floor	2	A	tile	12 x 12	
-42	↓	↓	1	A	↓	12 x 12	
-43	214	Sill	2	C	stone	5.5 x 38	
-44	↓	Floor	2	A	tile	12 x 12	
-45	↓	↓	1	A	↓	12 x 12	
-46	211	Sill	2	C	stone	5.5 x 38	
-47	↓	Floor	2	A	tile	12 x 12	
-48	↓	↓	1	A	↓	12 x 12	
-49	201	Sill	2	C	stone	5.5 x 38	
-50	↓	Floor	2	A	tile	12 x 12	
-51	↓	↓	1	A	↓	12 x 12	
-52	Blank						12 x 12
-53	119	Sill	2	C	stone	5.5 x 38	
-54	↓	Floor	2	A	tile	12 x 12	
-55	↓	↓	1	A	↓	12 x 12	
-56	115	Sill	2	C	stone	5.5 x 38	
-57	↓	Floor	2	A	tile	12 x 12	
-58	↓	↓	1	A	↓	12 x 12	
-59	109	Sill	2	C	stone	5.5 x 38	
-60	↓	Floor	2	A	tile	12 x 12	
-61	↓	↓	1	A	↓	12 x 12	
						x	
						x	
						x	

Analytical Report
Analysis of Paint for Lead Determination

TESTED FOR: PSI, Inc
 2401 Pilot Knob Road
 Mendota Heights, MN 551201121
 Attn: Michael Tjaden

Project ID: 0673273-1
 St. Paul PHA
 Ravoux High Rise
 St. Paul, MN

Date Received: 5/10/2011 **Date Analyzed:** 5/11/2011 **Date of Issue:** 5/11/2011

Analyst: LM **Work Order:** 1105206 **Page:** 1 of 1

Lab Sample #	Client Sample #	% Lead by Weight	Reporting Limit % Lead by Weight
001A	L1	< 0.010	0.010

Analytical Method: PSI WI-503-815 modified from EPA SW846 7420, 3rd Edition, Nov. 1986

Analysis was performed by flame AA using a PE AAnalyst 400.

Reporting limit = 30µg Pb per representative subsample.

Results are based on a representative subsample of the total sample submitted by the client.

AIHA Lab ID #100373; NYELAP ID #10930; CA Lab ID #2377.

Unless otherwise noted, all samples were acceptable upon receipt.

Sample results are not corrected for blanks.

All quality control sample results are within the acceptance range, unless noted.


All results are based on 2 significant figures. Results relate only to items tested.

Client submitted data is the determining factor in the accuracy of calculated results.

The attached Chain of Custody is incorporated into and becomes a part of the final report.

This report may not be reproduced, except in full, without written approval of PSI, Inc.

Respectfully submitted,
 PSI, Inc.



Approved Signatory
 Maureen Sammons


HAZARD IDENTIFICATION KEY AND RECOMMENDATIONS **A-3**

These hazards must be corrected in order to ensure the safety of your children and prevent any further exposure. All identified lead hazards with the cause and methods of treatment are described in the following tables:

HAZ #	HAZARD KEY	Component	Recommendations (What to Do to Reduce or Eliminate The Hazard)
1	PAINT HAZARD	Window, movable parts and/or troughs Jamb, Wells, Sash	<p>Do this now: Windows should remain closed until this hazard is eliminated. If windows must be opened, restrict children from touching window parts. HEPA-vacuum area.</p> <p>(Good): HEPA- vacuum loose particles visible in the trough portion of the window and clean sills and floor beneath the window using cleaning instructions in Section E. Repeat this treatment each time the windows are opened and/or closed.</p> <p>(Better): Remove sashes and stops, plane all friction-affected edges. When jambs and/or parting beads are a hazard, wet-sand to remove loose paint and repaint or encapsulate. When troughs are a hazard, wet-sand to remove loose paint, repaint, encapsulate or cover with metal or plastic. Install jamb liners or sash kit. Replace stops.</p> <p>Permanent (Best): Replace windows.</p> <p>Note: All windows in a room may not have been tested. If a window is not specifically addressed and appears to have a similar painting history, it should receive the same treatment as other tested windows in that room.</p>
2	PAINT HAZARD	Window Stops, Casing, Trim, Frame	<p>Do this now: Windows should remain closed until this hazard is eliminated. If windows must be opened, restrict children from touching window parts. HEPA-vacuum adjacent areas.</p> <p>(Good): Regularly clean adjacent sill using cleaning instructions in Section E. Repeat this treatment each time the windows are opened and/or closed.</p> <p>(Better): Remove inside stops and sashes, wet-sand or plane sash edges where they meet with stops and edge of sill. Re-paint, encapsulate or replace stops. Finish by cleaning adjacent sill using cleaning instructions in Section E.</p> <p>Permanent (Best): Replace windows.</p>
3	PAINT HAZARD	Window sill Apron	<p>Do this now: Cover outer edge of sill with duct or masking tape and restrict child access. HEPA-vacuum surface and adjacent areas.</p> <p>(Good): Scrape and repaint.</p> <p>(Better): Scrape and encapsulate. Line outer edge with plastic.</p> <p>Permanent (Best): Remove and replace.</p>
4	PAINT HAZARD	Stairway <input type="checkbox"/> Treads <input type="checkbox"/> Risers <input type="checkbox"/> Stringer <input type="checkbox"/> Skirt board <input type="checkbox"/> Rail	<p>Do this now: Clean exposed surfaces and beneath stairs if applicable using cleaning instructions in Section E. HEPA-vacuum surface and adjacent areas.</p> <p>(Good): Treads/Risers: Paint and install vinyl stair runner. /// Stringers/Baseboards/Rails: Paint.</p> <p>(Better): Treads/Risers: Encapsulate and install vinyl stair runner. /// Stringers/Baseboards/Rails: Encapsulate.</p> <p>Permanent (Best): Remove and replace.</p>
5	PAINT HAZARD	Wood Trim: Chair-rail	<p>Do this now: Clean exposed surfaces and adjacent areas using cleaning instructions in Section E. HEPA-vacuum surface and adjacent areas.</p> <p>(Good): Remove loose paint and repaint and adjust or remove the impacting object.</p> <p>(Better): When the source is deterioration, remove loose paint and encapsulate the damaged area. When the source is impact, repair the damage and cover the affected surface with plastic, vinyl or similar material at the point of impact. Adjust or remove the impacting object.</p> <p>Permanent (Best): Remove and replace the damaged component</p>
6	PAINT HAZARD	Wood Trim: Baseboards, chair rails, miscellaneous trim	<p>Do this now: Clean exposed surfaces and adjacent areas using cleaning instructions in Section E. HEPA-vacuum surface and adjacent areas.</p> <p>(Good): Remove loose paint and repaint and adjust or remove the impacting object.</p> <p>(Better): When the source is deterioration, remove loose paint and encapsulate the damaged area. When the source is impact, repair the damage and cover the affected surface with plastic, vinyl or similar material at the point of impact. Adjust or remove the impacting object.</p> <p>Permanent (Best): Remove and replace the damaged component.</p>
7	PAINT HAZARD	Door casing Trim	<p>Do this now: Clean exposed surfaces and adjacent areas using cleaning instructions in Section E. HEPA-vacuum surface and adjacent areas.</p> <p>(Good): Remove loose paint and repaint and adjust or remove the impacting object.</p> <p>(Better): When the source is deterioration, remove loose paint and encapsulate the damaged area. When the source is impact, repair the damage and cover the affected surface with plastic, vinyl or similar material at the point of impact. Adjust or remove the impacting object.</p> <p>Permanent (Best): Remove and replace the damaged component.</p>
8	PAINT HAZARD	Door Frame Jamb	<p>Do this now: Clean exposed surfaces and adjacent areas using cleaning instructions in Section E. HEPA-vacuum carpet or wet-mop bare floor.</p> <p>(Good): Plane leading edge of door, scrape and repaint jamb.</p> <p>(Better): Plane leading edge of door, scrape and encapsulate jamb.</p> <p>Permanent (Best): Replace door assembly.</p>
9	PAINT HAZARD	Door	<p>Do this now: Clean exposed surfaces and adjacent areas using cleaning instructions in Section E.</p> <p>(Good): Plane leading edge of door, eliminating all friction points. Install felt liner on stops. Scrape and repaint door. Re-hang door with new hardware if needed to eliminate further friction and/or impact problems.</p> <p>(Better): Plane leading edge of door, eliminating all friction points. Install felt liner on stops. Scrape and encapsulate door. Re-hang door with new hardware if needed to eliminate further friction and/or impact problems.</p> <p>Permanent (Best): Remove and replace door.</p>

HAZ #	HAZARD KEY	Component	Recommendations (What to Do to Reduce or Eliminate The Hazard)
10	PAINT HAZARD	Door stop	Do this now: Clean adjacent areas using cleaning instructions in Section C and HEPA-vacuum carpet or wet-mop bare floor. Reclean floor after any of the following treatments. (Good): Apply felt or foam liner to impact surface of stop (Better): Paint or encapsulate stop and apply felt or foam liner Permanent (Best): Remove and replace stop
11	PAINT HAZARD	Door threshold	Do this now: Cover threshold with duct tape until further treatment can be completed. Clean adjacent areas using cleaning instructions in Section E and HEPA-vacuum carpet or wet-mop bare floor. Reclean floor after any of the following treatments. (Good): Remove loose paint, repaint and cover with vinyl or sheet metal. Plane lower edge of door. (Better): Remove loose paint, encapsulate & cover with vinyl or sheet metal. Plane door lower edge. Permanent (Best): Remove and replace.
12	PAINT HAZARD	Floor	Do this now: Limit access if possible. Place temporary covering or runners over high traffic areas. Wet mop until and after any of the following treatments are completed. (Good): Remove and repair damaged areas and install non-skid runners over high traffic areas (Better): Remove loose paint, encapsulate and install carpet Permanent (Best): Remove loose paint, encapsulate and install permanent non-permeable floor
13	PAINT HAZARD	Plaster or Wallboard	Do this now: Prevent further disturbance and restrict children from access or instruct to avoid. Wet mop until and after any of the following treatments are completed. (Good): If deterioration is limited to a small area, repair damage and repaint wall. If deterioration is over a large area, do not attempt to repair. Use certified workers to complete the work. (Better): Use certified workers to repair and encapsulate Permanent (Best): Enclose wall with drywall, tape and finish with joint compound
14	PAINT HAZARD	Storage components Cabinets	Do this now: If component is used for food, cooking or eating utensils, linen or clothing, remove and clean these items and store in a non-contaminated area until one of the following treatments are completed. Wet-clean any adjacent floors, counters and other surfaces until and after any of the following treatments are completed. (Good): Repair, repaint and line all surfaces with vinyl, plastic or similar covering. Adjust doors, hinges and other hardware to further eliminate friction or impact. (Better): Repair, encapsulate and line all surfaces with vinyl, plastic or similar covering. Permanent (Best): Remove and replace
15	PAINT HAZARD	Storage components Shelving	Do this now: If component is used for food, cooking or eating utensils, linen or clothing, remove and clean these items and store in a non-contaminated area until one of the following treatments are completed. Wet-clean any adjacent floors, counters and other surfaces until and after any of the following treatments are completed. (Good): Repair, repaint and line all surfaces with vinyl, plastic or similar covering. Adjust doors, hinges and other hardware to further eliminate friction or impact. (Better): Repair, encapsulate and line all surfaces with vinyl, plastic or similar covering. Permanent (Best): Remove and replace
16	PAINT HAZARD	Radiator, Bath Tub and Sink	Do this now: Restrict children from contact. Clean adjacent areas using cleaning instructions in Section E and HEPA-vacuum carpet or wet-mop bare floor. Reclean floor after any of the following treatments. (Good): Scrape and re-paint. Wet surfaces frequently during scraping. (Better): Encapsulate or strip all painted surfaces. Permanent (Best): Remove and replace.
17	PAINT HAZARD	Siding and Trim:	Do this now: If accessible, restrict children from contact (Good): Repair with patch or filler, then re-paint (Better): Scrape and encapsulate all exposed wood surfaces. Permanent (Best): Remove and replace component
18	PAINT HAZARD	Structural component	Do this now: If accessible, restrict children from contact. (Good): Repair with patch or filler, then re-paint. (Better): Repair with patch or filler, then encapsulate. Permanent (Best): Remove and replace component.
19	PAINT HAZARD	Porch Ceiling	Do this now: Instruct children from playing on porch until hazard is treated. (Good): Scrape and re-paint. Wet surfaces frequently during scraping. (Better): Scrape and encapsulate all exposed wood surfaces. Permanent (Best): Install vinyl siding underlayment if house is being sided, or, install ½ inch from board, OSB or other rigid, permanent barrier. Caulk at all edges and unions.
20	SOIL HAZARD	Play or other areas	Do this now: If swings, sand boxes or other children's objects are present, relocate all to another area of the yard. Instruct children not to dig or play in the contaminated area. (Good): Rototill lead containing soil and cover with sod. (Better): Rototill lead containing soil and seed. Permanent (Best): Remove soil to a depth of six inches, replace with clean, uncontaminated fill and seed, sod or install plantings.
21	SOIL HAZARD	House perimeter	Do this now: Instruct children not to dig or play in the contaminated area. (Good): Rototill lead containing soil, cover with organic mulch and install plantings. (Better): Rototill lead containing soil, compact and install landscaping cloth and stone or gravel. Permanent (Best): Remove soil to a depth of six inches, replace with clean, uncontaminated fill or gravel/stone.

HAZ #	HAZARD KEY	Component	Recommendations (What to Do to Reduce or Eliminate The Hazard)
22	DUST HAZARD	Floors or Window Sills	<p>Important Note: Dust sampling is not performed on all floors and window sills during a risk assessment. For this reason it is important to clean all floors and horizontal surfaces such as window sills, ledges and counter tops regularly.</p> <p>Do this now: Clean all floors, window sills and horizontal surfaces using the cleaning instructions included in Section E. Encourage frequent hand washing.</p> <p>Good: Continue regular cleaning. Windows should remain closed until this hazard is eliminated. If windows must be opened, restrict children from touching window parts. HEPA- vacuum loose particles visible in the trough portion of the window and clean sills and floor beneath each day using cleaning instructions in Section E. Continue to encourage frequent hand washing.</p> <p>Best: This hazard will not be permanently corrected by cleaning until corrections are made to the windows which are creating the hazard.</p>
23	HOBBY HAZARD		<p>Do this now: Restrict children from access to hobby tools and equipment.</p> <p>(Good): Perform a thorough cleaning of all horizontal surfaces around the hobby area using cleaning guidelines included in Section E of this report.</p> <p>(Better): Install permanent drywall enclosure with operable door and security lock around hobby area.</p> <p>Permanent (Best): Move this activity to an exterior secured shed. Note: this hazard will not be permanently corrected and exposures are still possible if accessed by a child.</p>
24	PAINT HAZARD	Wood Wainscoting	<p>Do this now: Restrict children from access to the surface.</p> <p>(Good): Repaint.</p> <p>(Better): Encapsulate the surface.</p> <p>Permanent (Best): Move any existing moldings, chair-rails or other protruding components and enclose with drywall.</p>
25	PAINT HAZARD	Free Standing Component	<p>Do this now: Restrict children from further access.</p> <p>(Good): If component is to be retained, place outside in grassy area on disposable plastic and scrape/repaint.</p> <p>(Better): Scrape/Paint as described above and move to an area inaccessible to a child.</p> <p>Permanent (Best): Dispose of the component.</p>
26	PAINT HAZARD	Exterior window sashes and frames	<p>Do this now: Windows should remain closed until this hazard is eliminated. If windows must be opened, restrict children from touching window parts. HEPA-vacuum adjacent areas.</p> <p>(Good): Regularly clean adjacent sill using cleaning instructions in Section E. Repeat this treatment each time the windows are opened and/or closed.</p> <p>(Better): Remove inside stops and sashes, wet-sand or plane exterior sash edges where they meet with parting bead. Wet-sand parting beads and repaint or encapsulate. Re-paint, encapsulate or replace stops. Finish by cleaning adjacent sill using cleaning instructions in Section E.</p> <p>Permanent (Best): Replace windows.</p>
27	CURRENT NON-HAZARD	Various	<p>Regularly observe for deterioration and use the cleaning guidelines within this report. Maintain the integrity of the paint surface as needed.</p>

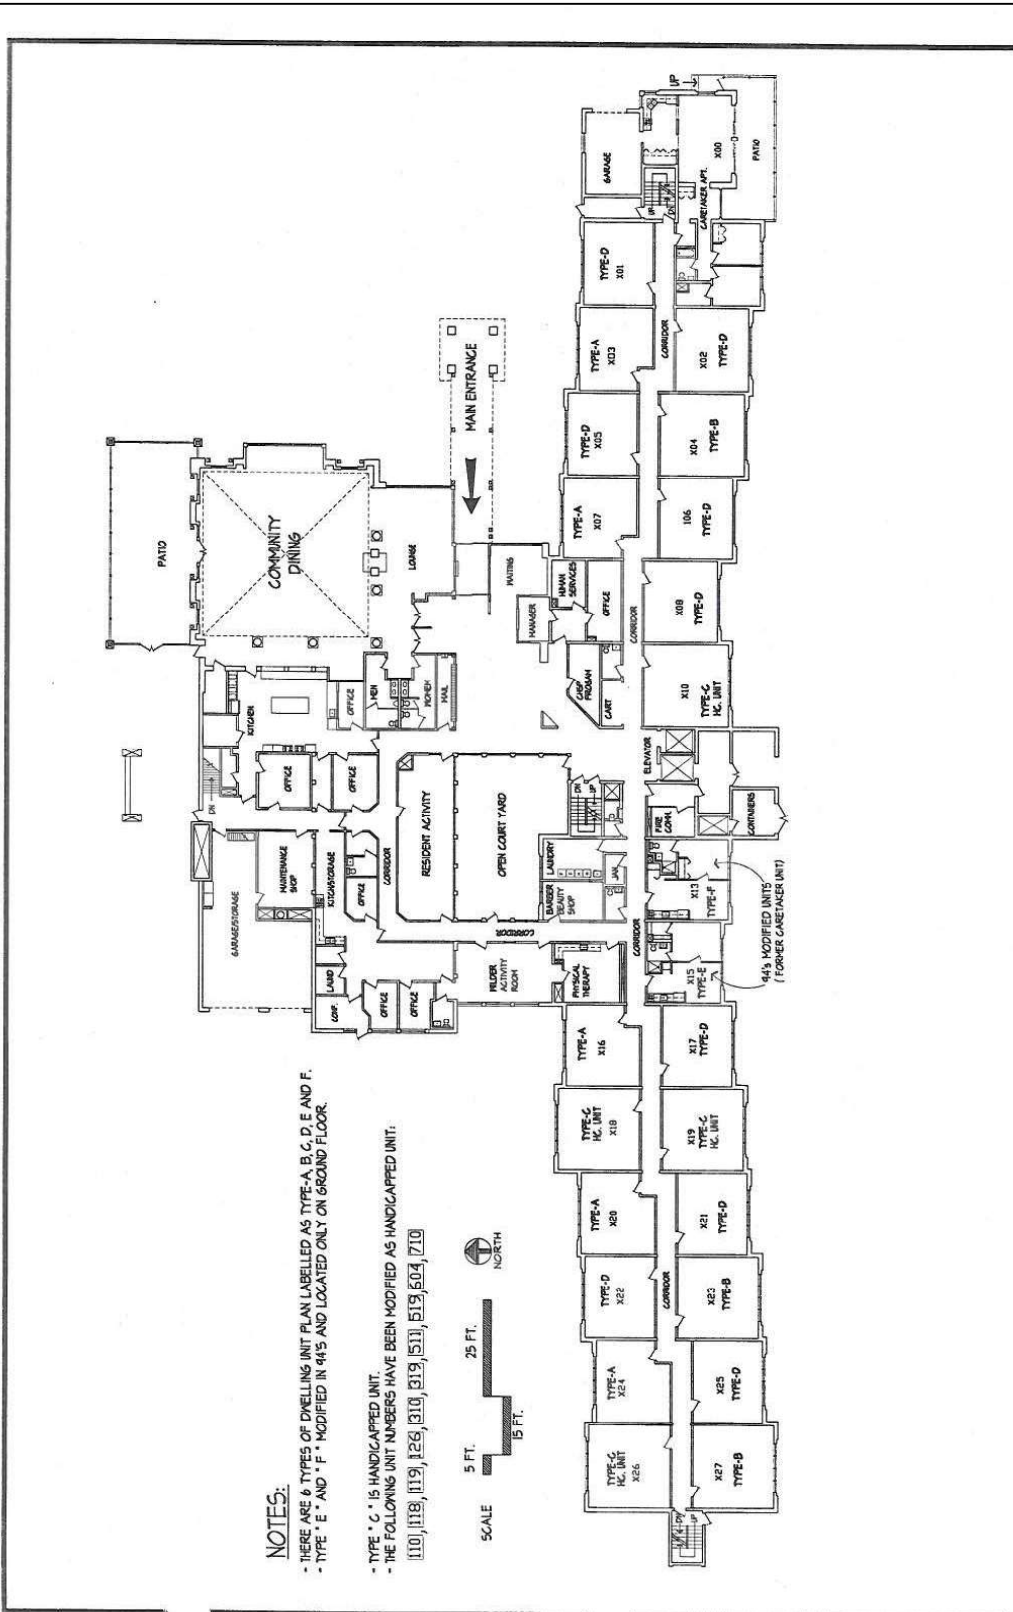

NOTES:
 - HERE ARE 6 TYPES OF DWELLING UNIT PLAN LABELLED AS TYPE-A, B, C, D, E AND F.
 - TYPE "E" AND "F" MODIFIED IN 445 AND LOCATED ONLY ON GROUND FLOOR.
 - TYPE "C" IS HANDICAPPED UNIT.
 - THE FOLLOWING UNIT NUMBERS HAVE BEEN MODIFIED AS HANDICAPPED UNIT:
 (110), (118), (119), (126), (310), (313), (511), (513), (604), (710)



PHA OF SAINT PAUL
 400 CEDAR STREET, SUITE 600
 ST. PAUL, MN 55101
 PHONE (612) 290-5664
 FAX (612) 290-5666

FIRST FLOOR PLAN

RA-YOUX HI-RISE (MN 1-16)
 280 RAVOUX STREET

NOTE:
 ANY DEVIATIONS OR CORRECTIONS OF THIS PLAN SHOULD BE FORWARDED TO KIRSTEN SPECK AT CENTRAL OFFICE.


DRAWN BY: FBV:	
DATE:	10/24/16
REVISIONS:	

psi Information
 To Build On
 Engineering • Consulting • Testing
 Environmental Services
 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120
 PHONE: (651) 646-8148 FAX: (651) 646-8258

PHA Hi-Rise Risk Assessment

Ravoux Hi-Rise
 280 Ravoux Avenue
 St. Paul, Minnesota

Date:	2-23-11
File Name:	Exterior
Project Number:	0673226-11

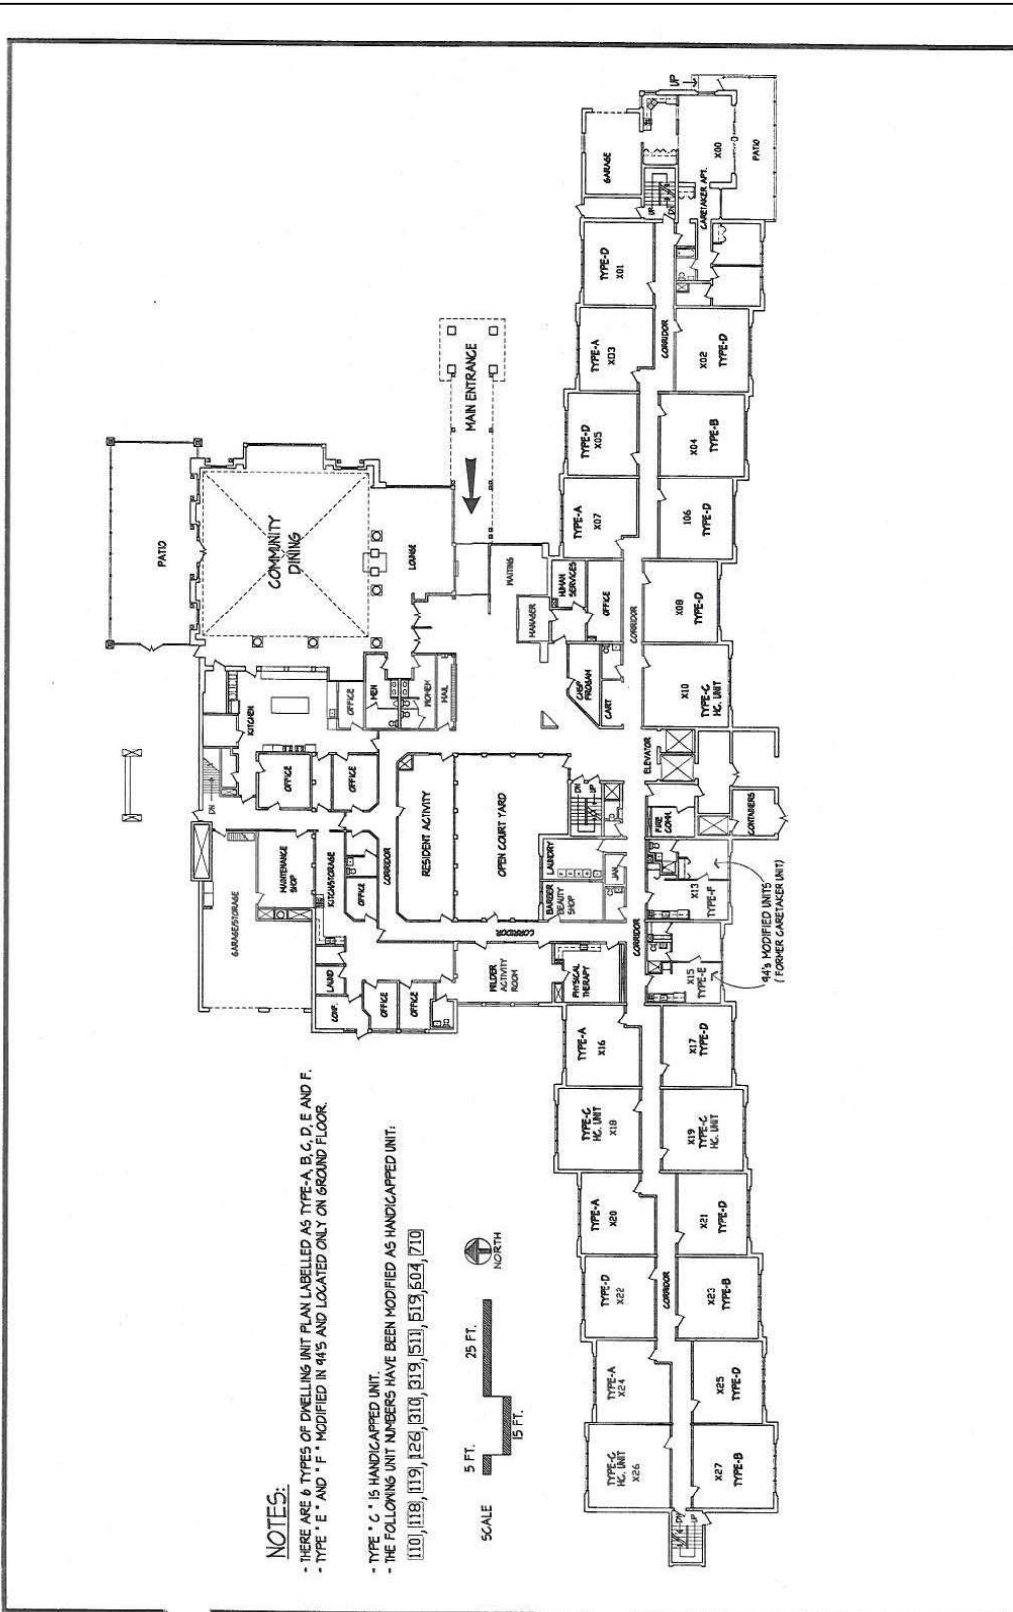

NOTES:
 - HERE ARE 6 TYPES OF DWELLING UNIT PLAN LABELLED AS TYPE-A, B, C, D, E AND F.
 - TYPE "E" AND "F" MODIFIED IN 445 AND LOCATED ONLY ON GROUND FLOOR.
 - TYPE "C" IS HANDICAPPED UNIT.
 - THE FOLLOWING UNIT NUMBERS HAVE BEEN MODIFIED AS HANDICAPPED UNIT:
 (110), (118), (119), (126), (310), (313), (511), (513), (504), (710)



PHA OF SAINT PAUL
 400 CEDAR STREET, SUITE 600
 ST. PAUL, MN 55101
 PHONE (612) 290-5664
 FAX (612) 290-5666

FIRST FLOOR PLAN

RA-YOUX HI-RISE (MN 1-16)
 280 RAVOUX STREET

NOTE:
 ANY DEVIATIONS OR CORRECTIONS OF THIS PLAN SHOULD BE FORWARDED TO KIRSTEN SPECK AT CENTRAL OFFICE.


DRAWN BY: FBV:	
DATE:	10/24/16
REVISIONS:	

psi Information
 To Build On
 Engineering • Consulting • Testing
 Environmental Services
 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120
 PHONE: (651) 646-8148 FAX: (651) 646-8258

PHA Hi-Rise Risk Assessment


Ravoux Hi-Rise
 280 Ravoux Avenue
 St. Paul, Minnesota

Date:	2-23-11
File Name:	Common 1st Floor
Project Number:	0673226-11

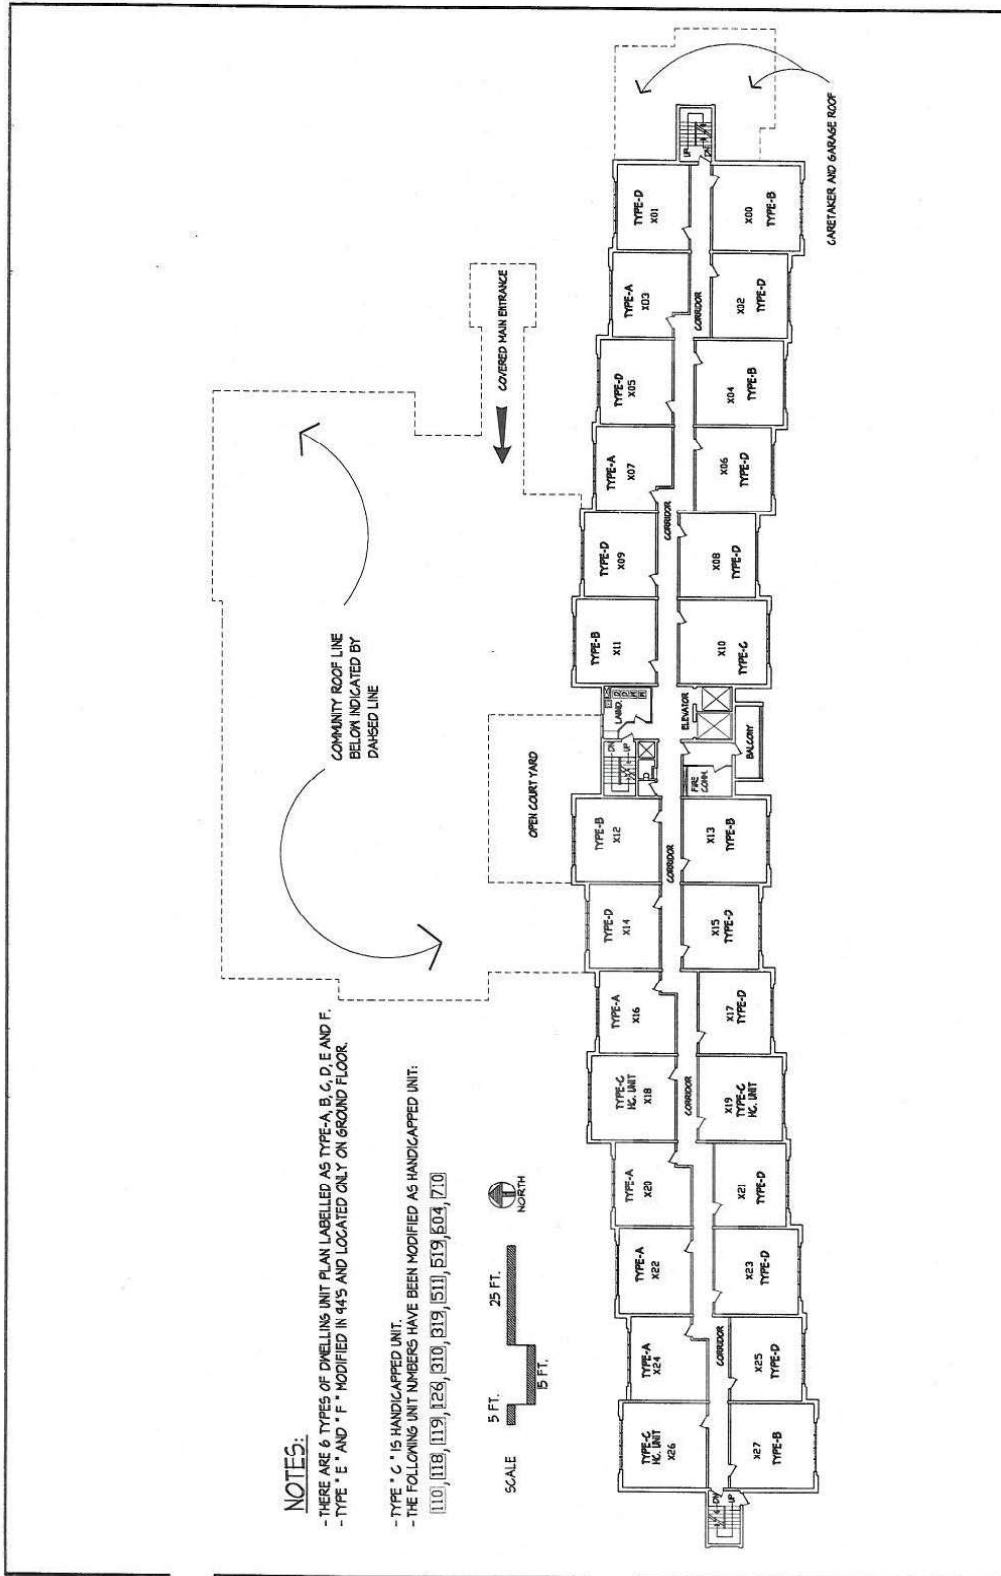

NOTES:

- THERE ARE 6 TYPES OF DWELLING UNIT PLAN LABELLED AS TYPE-A, B, C, D, E AND F.
- TYPE "E" AND "F" MODIFIED IN 44'S AND LOCATED ONLY ON GROUND FLOOR.
- TYPE "C" IS HANDICAPPED UNIT.
- THE FOLLOWING UNIT NUMBERS HAVE BEEN MODIFIED AS HANDICAPPED UNIT:
110, 118, 119, 123, 310, 319, 511, 519, 604, 710



PHA OF SAINT PAUL
 480 CEDAR STREET, SUITE 600
 ST. PAUL, MN 55011
 PHONE (612) 240-5644
 FAX (612) 240-5666

**TYPICAL FLOOR PLAN
 2ND THRU 8TH FLOOR**
RAVOUX HI-RISE (MN 1-16)
280 RAVOUX STREET

NOTE:
 ANY DEVIATIONS OR CORRECTIONS OF
 THIS PLAN SHOULD BE FORWARDED TO
 KRISTEN SPECK AT CENTRAL OFFICE.


DRAWN BY: F6V.	REVISIONS:
DATE: 10/24/06	


psi *Information To Build On*
 Engineering • Consulting • Testing
 Environmental Services
 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120
 PHONE: (651) 646-8148 FAX: (651) 646-8258


PHA Hi-Rise Risk Assessment


Ravoux Hi-Rise
 280 Ravoux Avenue
 St. Paul, Minnesota


Date:	2-23-11
File Name:	Hallway
Project Number:	0673226-11

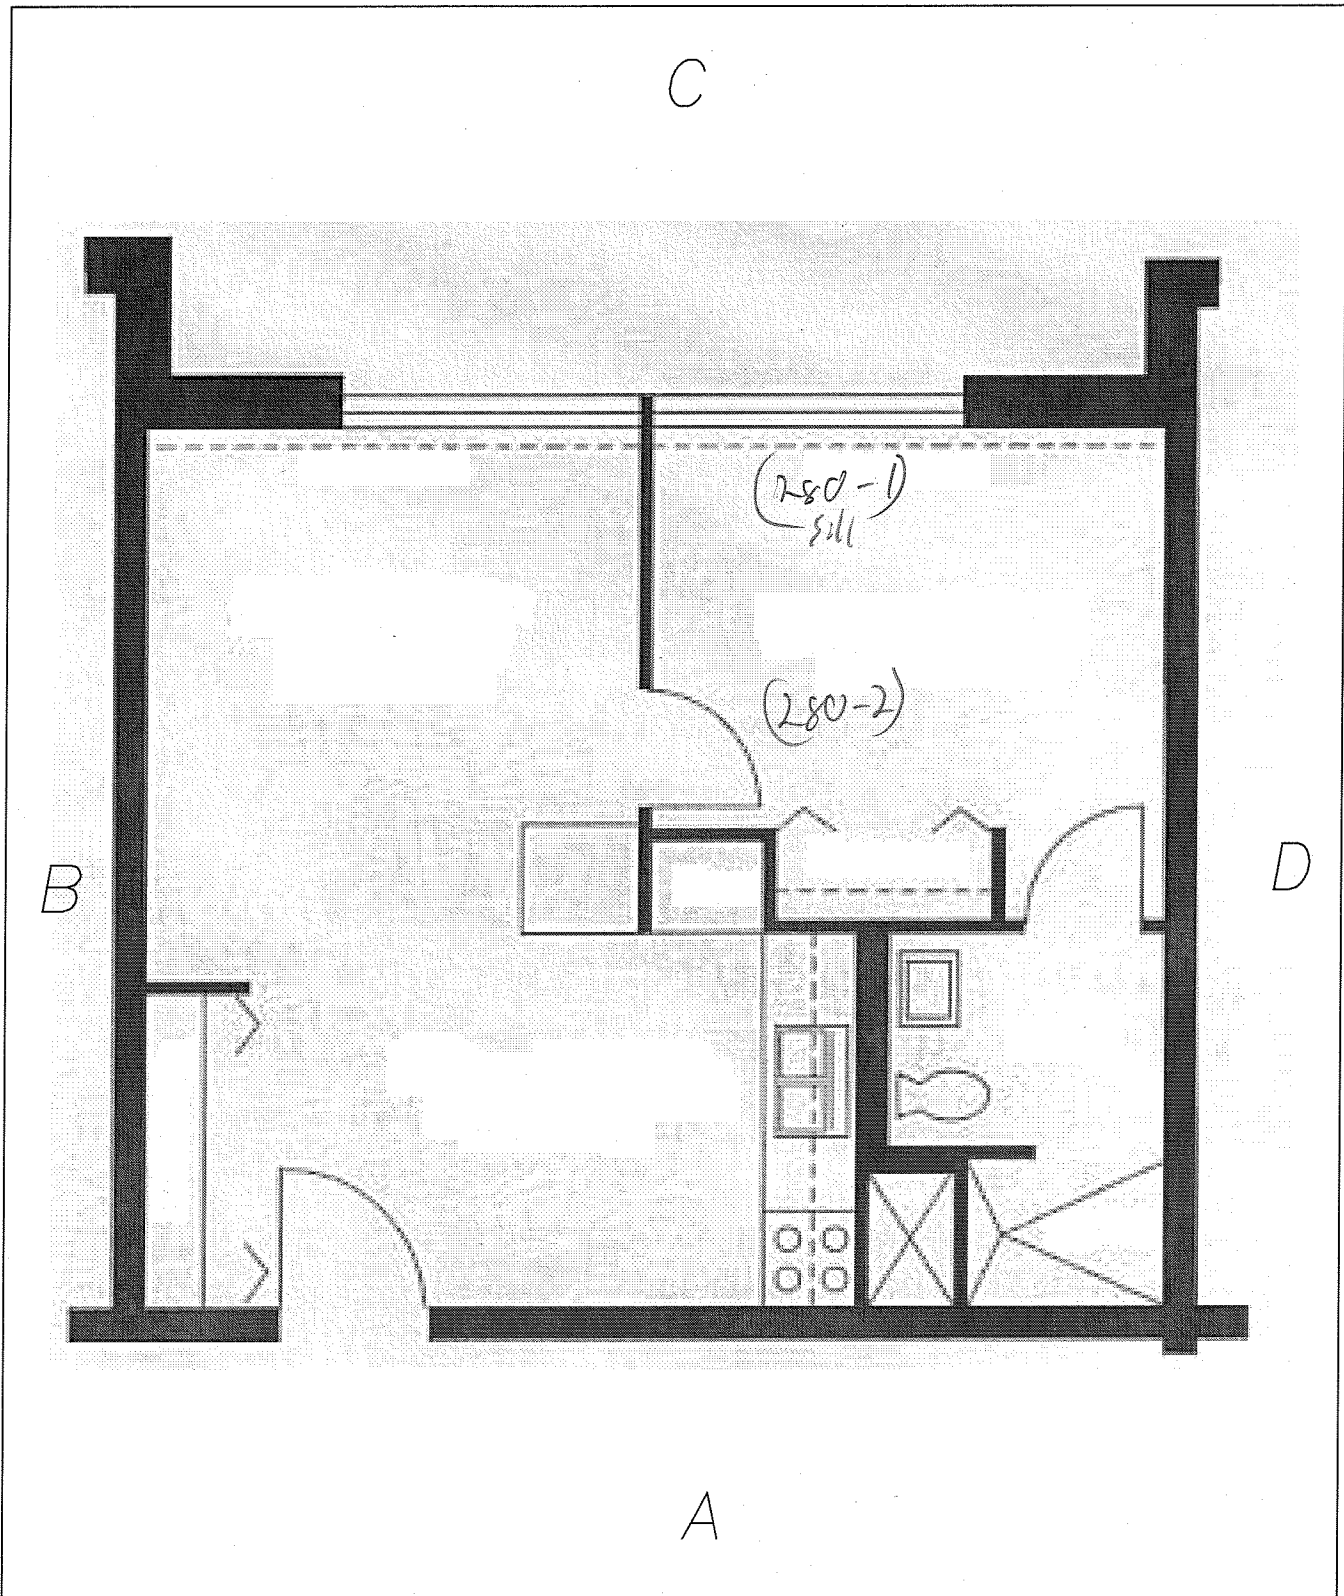

 Information To Build On Engineering • Consulting • Testing <i>Environmental Services</i> 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120 PHONE: (651) 646-8148 FAX: (651) 646-8258	PHA Hi-Rise Risk Assessment	Unit: <u>810</u>
	Ravoux- Hi-Rise 280 Ravoux Street St. Paul, Minnesota 55103	Date: 11-05-10
		File Name: Type B-2 Studio
		Project Number: 0673226-11

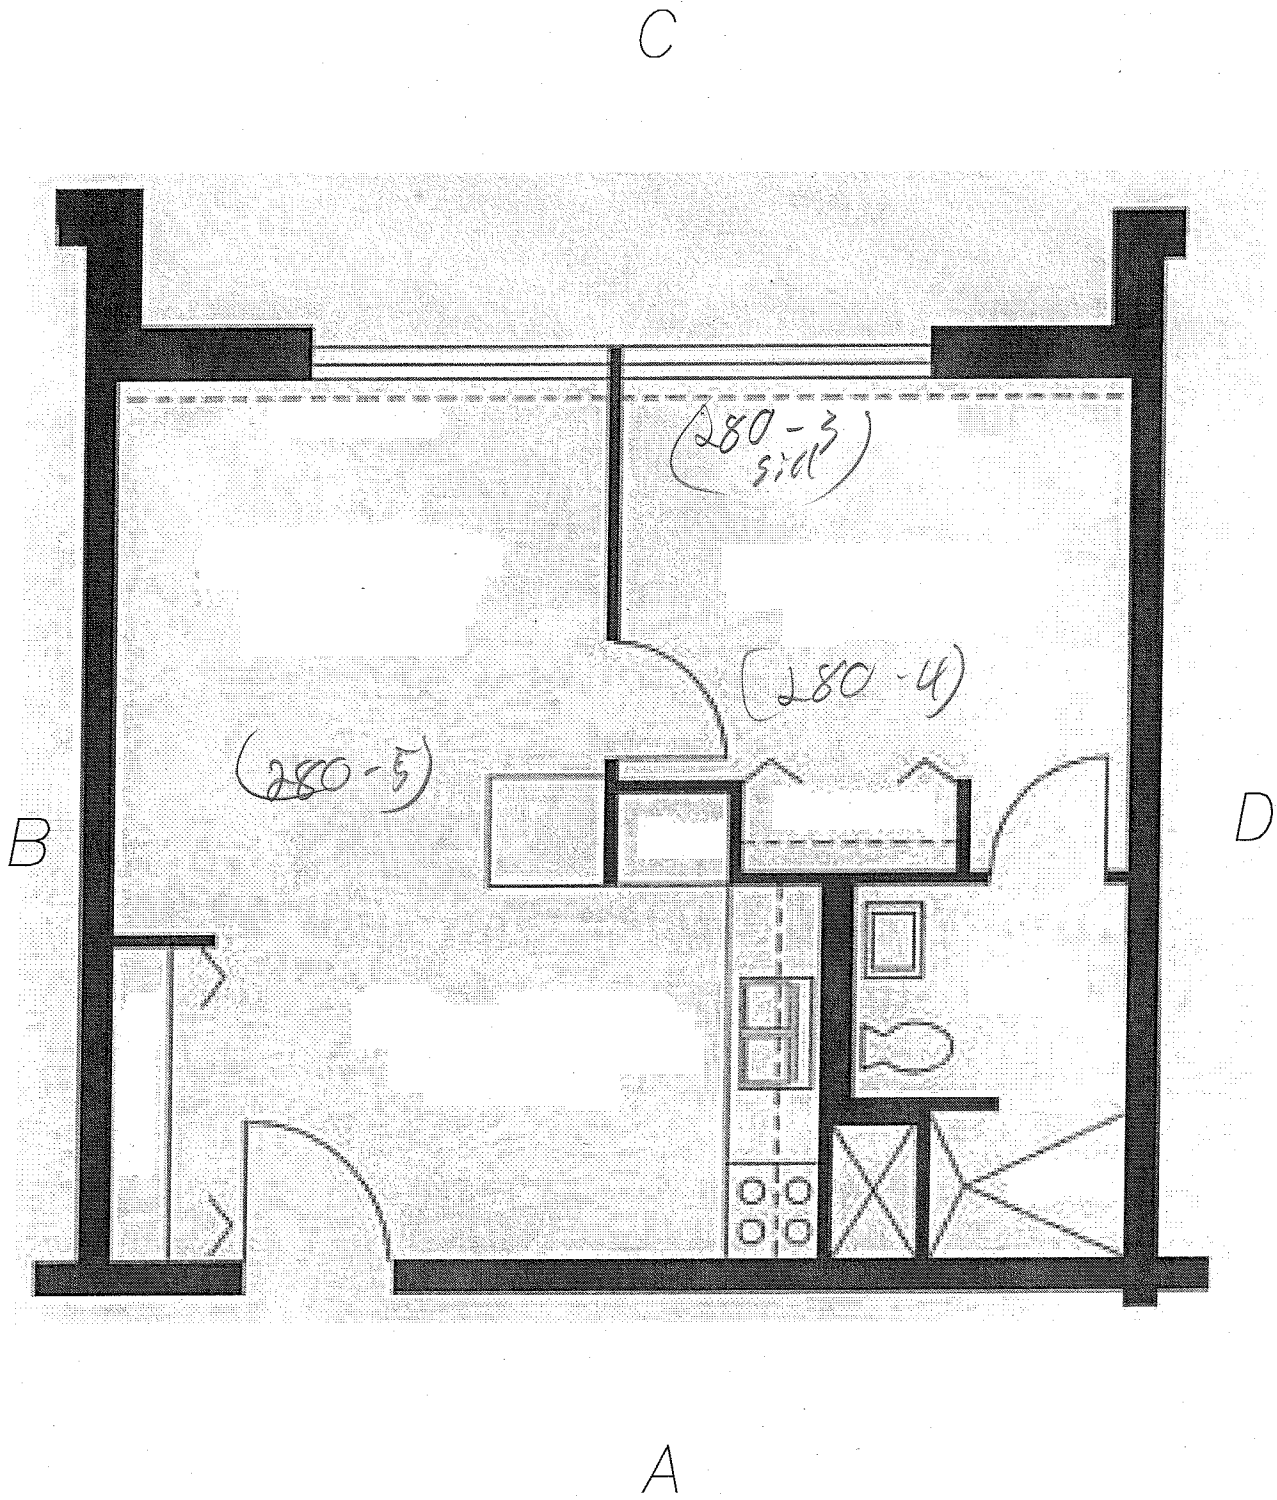

 Information To Build On Engineering • Consulting • Testing <u>Environmental Services</u> 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120 PHONE: (651) 646-8148 FAX: (651) 646-8258	PHA Hi-Rise Risk Assessment		Unit: <i>800</i>
			Date: 11-05-10
	Ravoux- Hi-Rise 280 Ravoux Street St. Paul, Minnesota 55103		File Name: Type B-2 Studio
			Project Number: 0673226-11

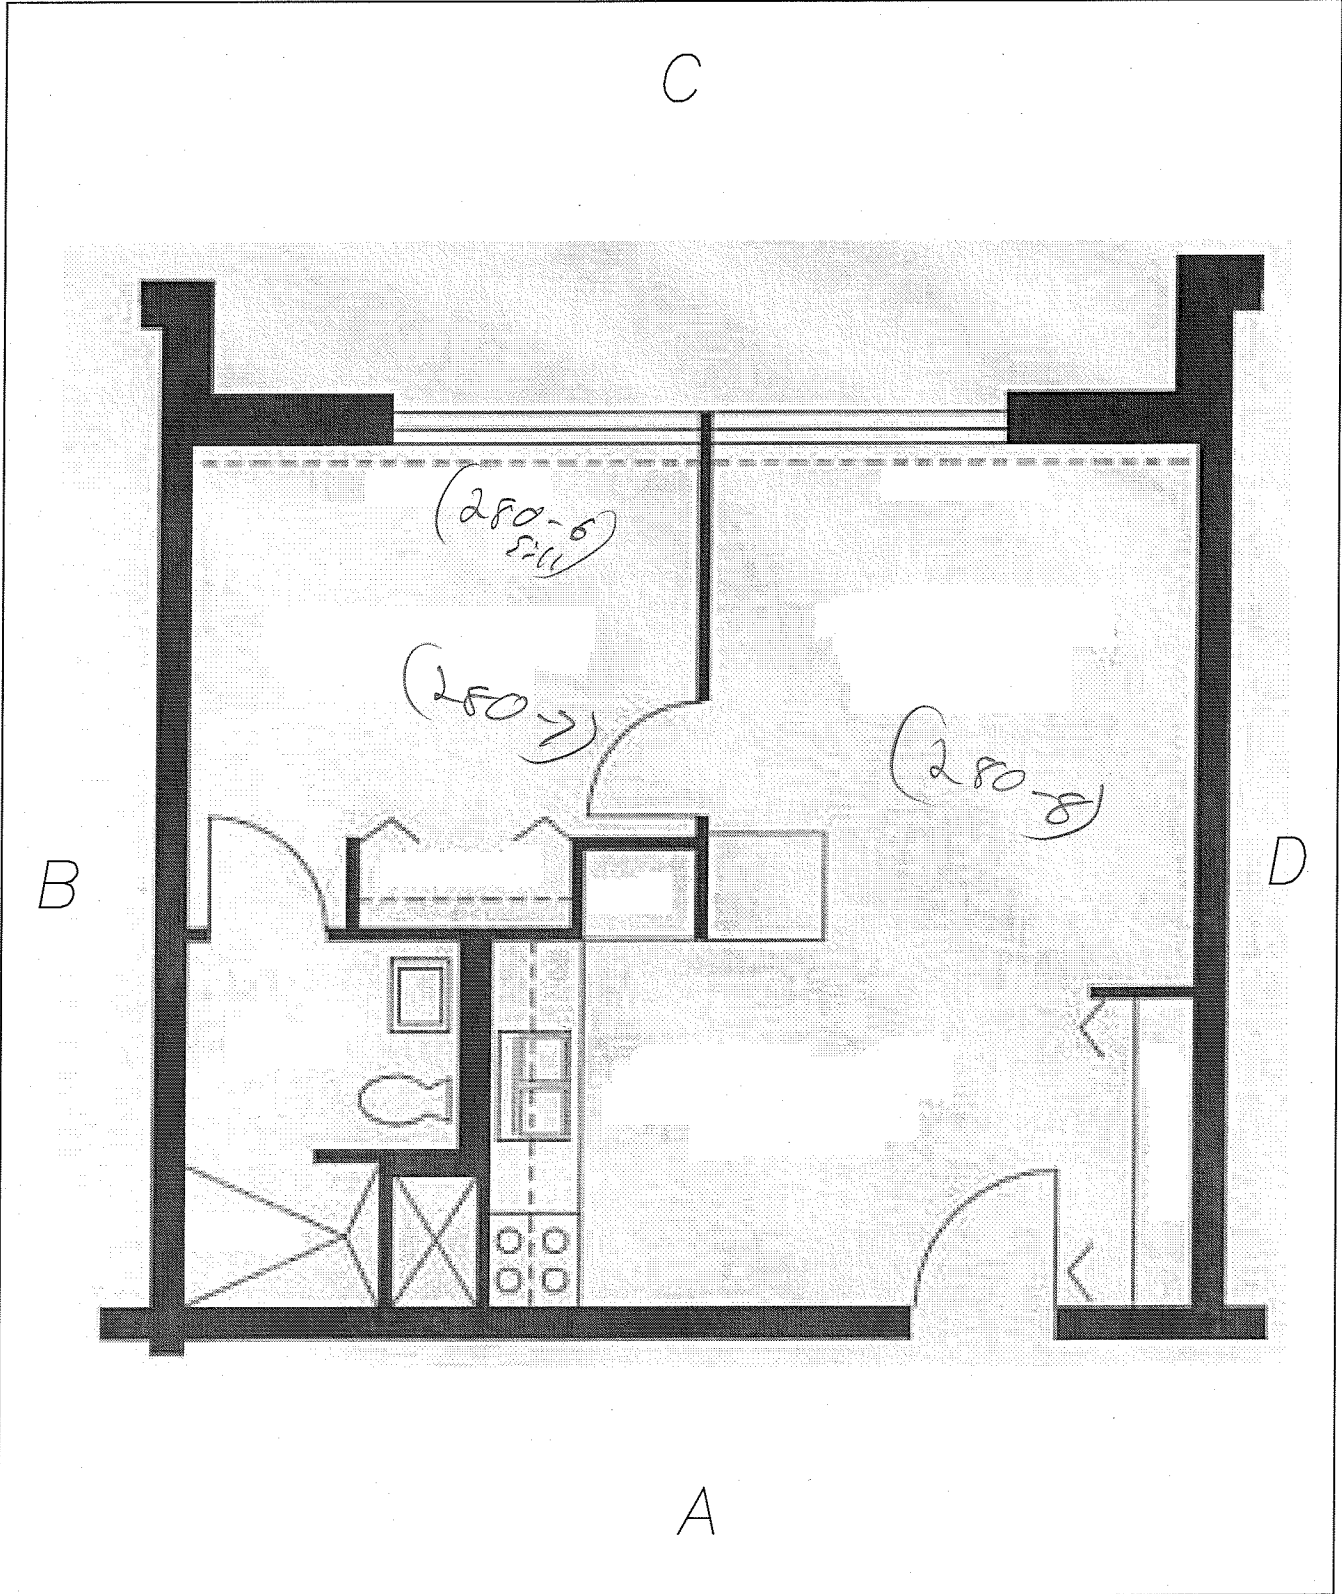

psi Information
To Build On
Engineering • Consulting • Testing

Environmental Services

2401 Pilot Knob Road, #138, Mendota Heights, MN 55120
PHONE: (651) 646-8148 FAX: (651) 646-8258

PHA Hi-Rise Risk Assessment

Ravoux- Hi-Rise
280 Ravoux Street
St. Paul, Minnesota 55103

Unit:

718

Date:


11-05-10

File Name:

Type B-1
Studio

Project Number:

0673226-11

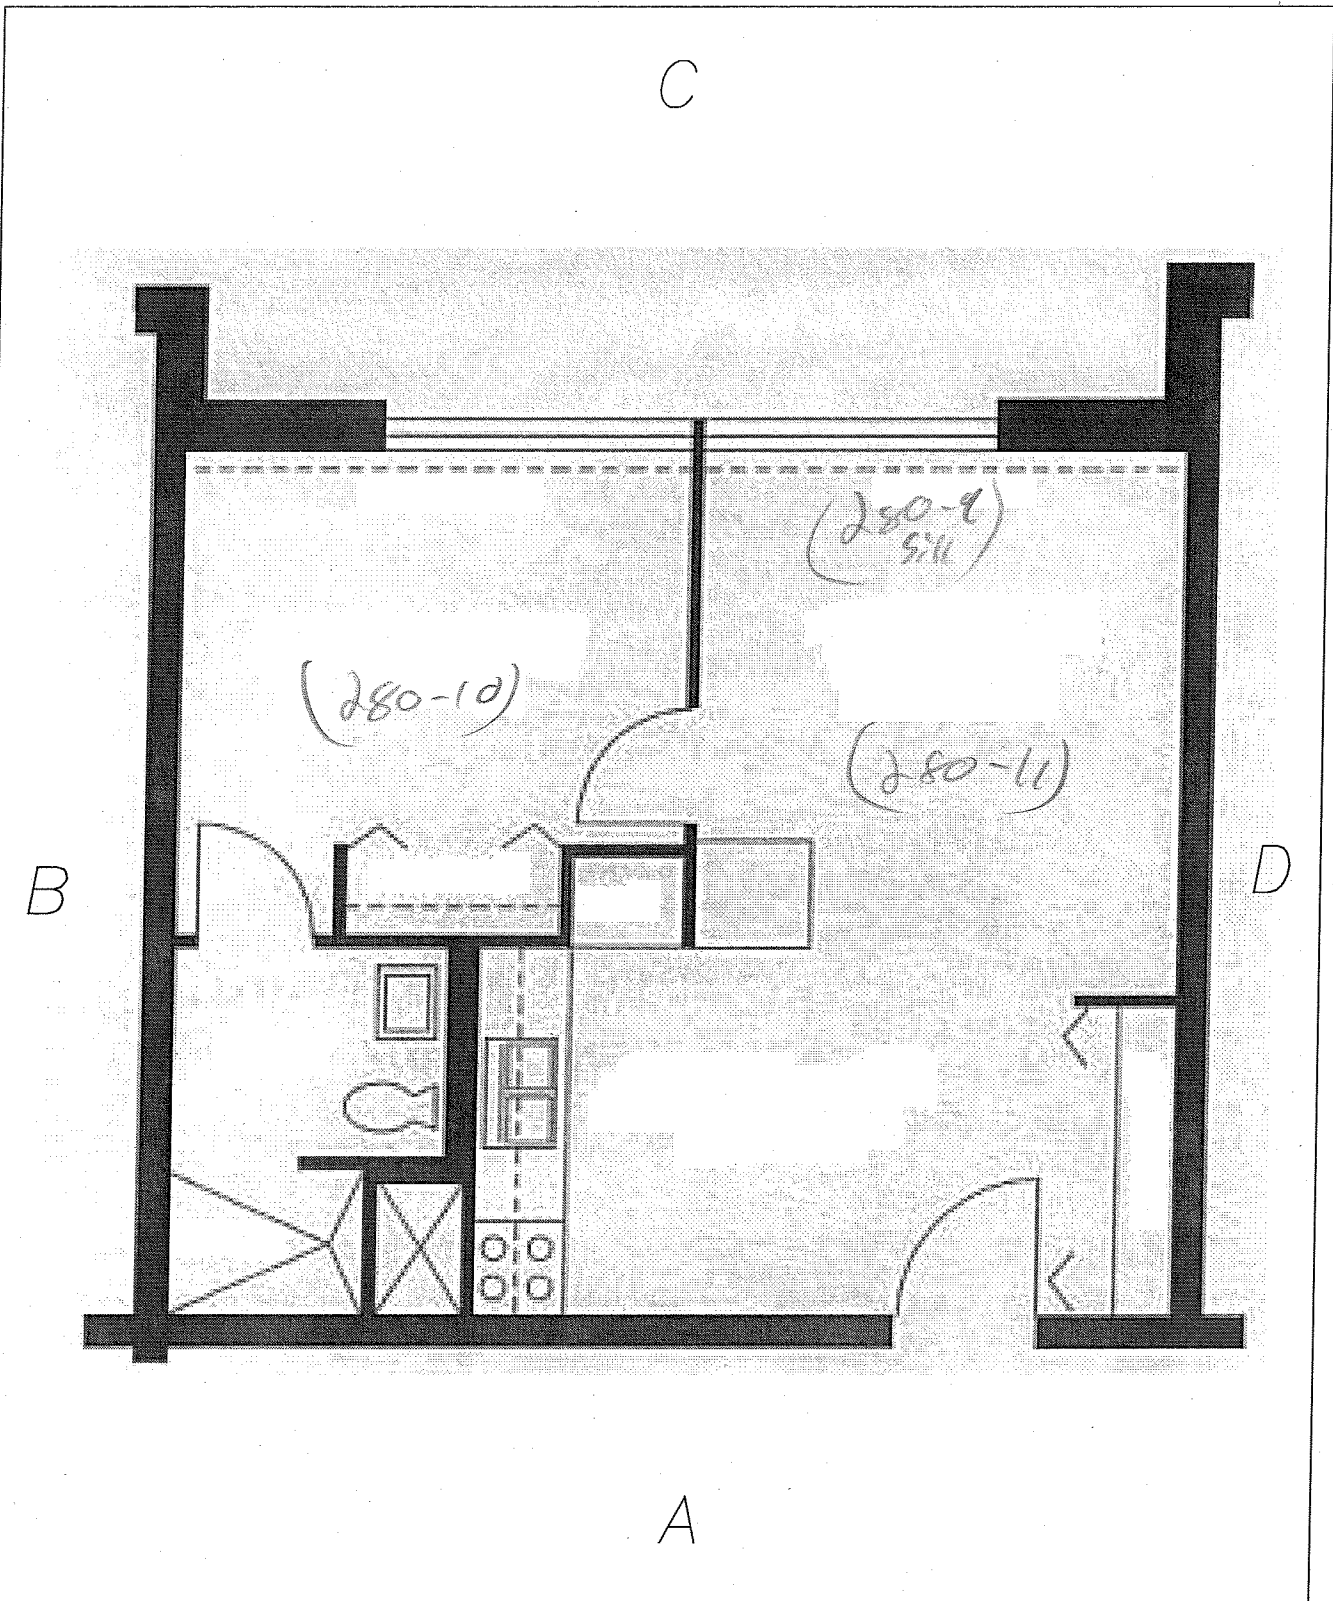

psi Information
To Build On
Engineering • Consulting • Testing


Environmental Services


2401 Pilot Knob Road, #138, Mendota Heights, MN 55120
PHONE: (651) 646-8148 FAX: (651) 646-8258


PHA Hi-Rise Risk Assessment


Ravoux- Hi-Rise
280 Ravoux Street
St. Paul, Minnesota 55103


Unit:	213
Date:	11-05-10
File Name:	Type B-1 Studio
Project Number:	0673226-11

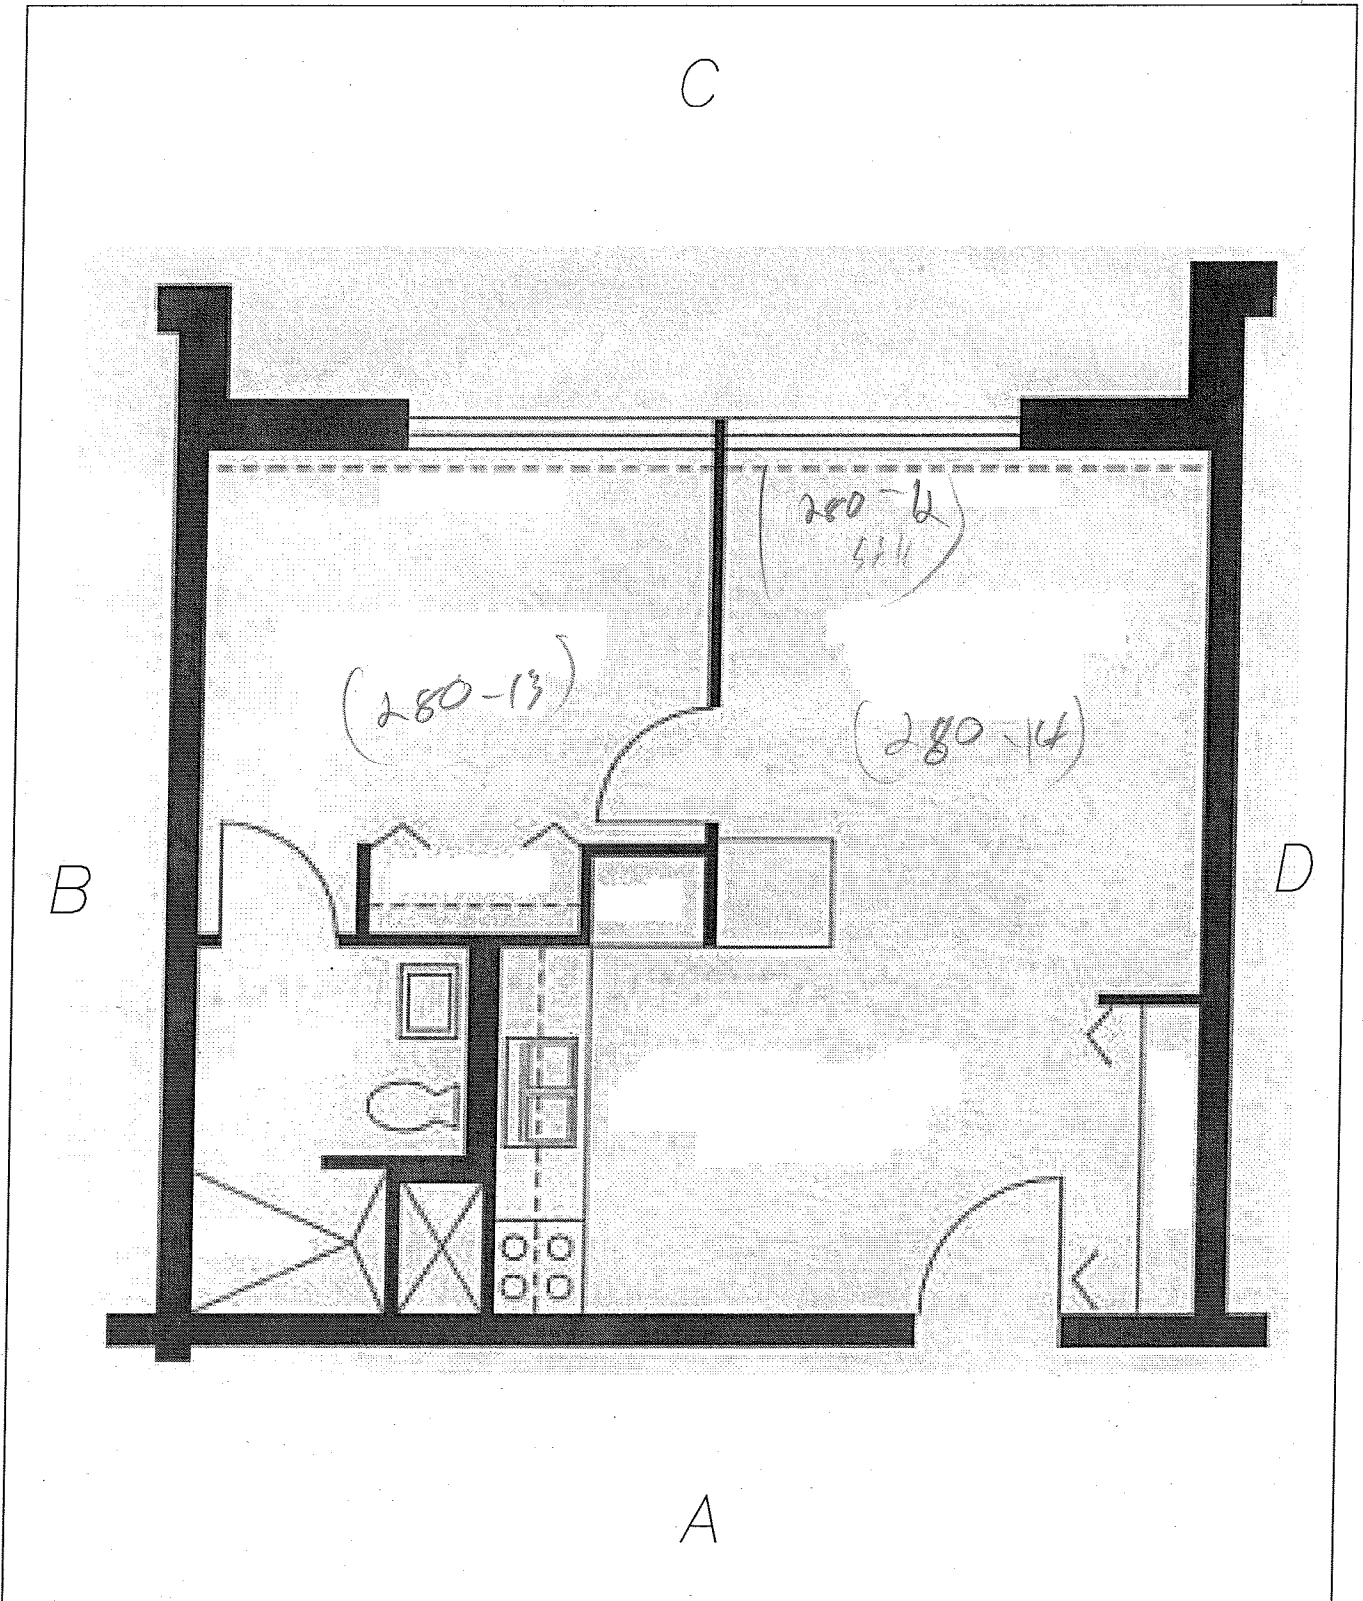


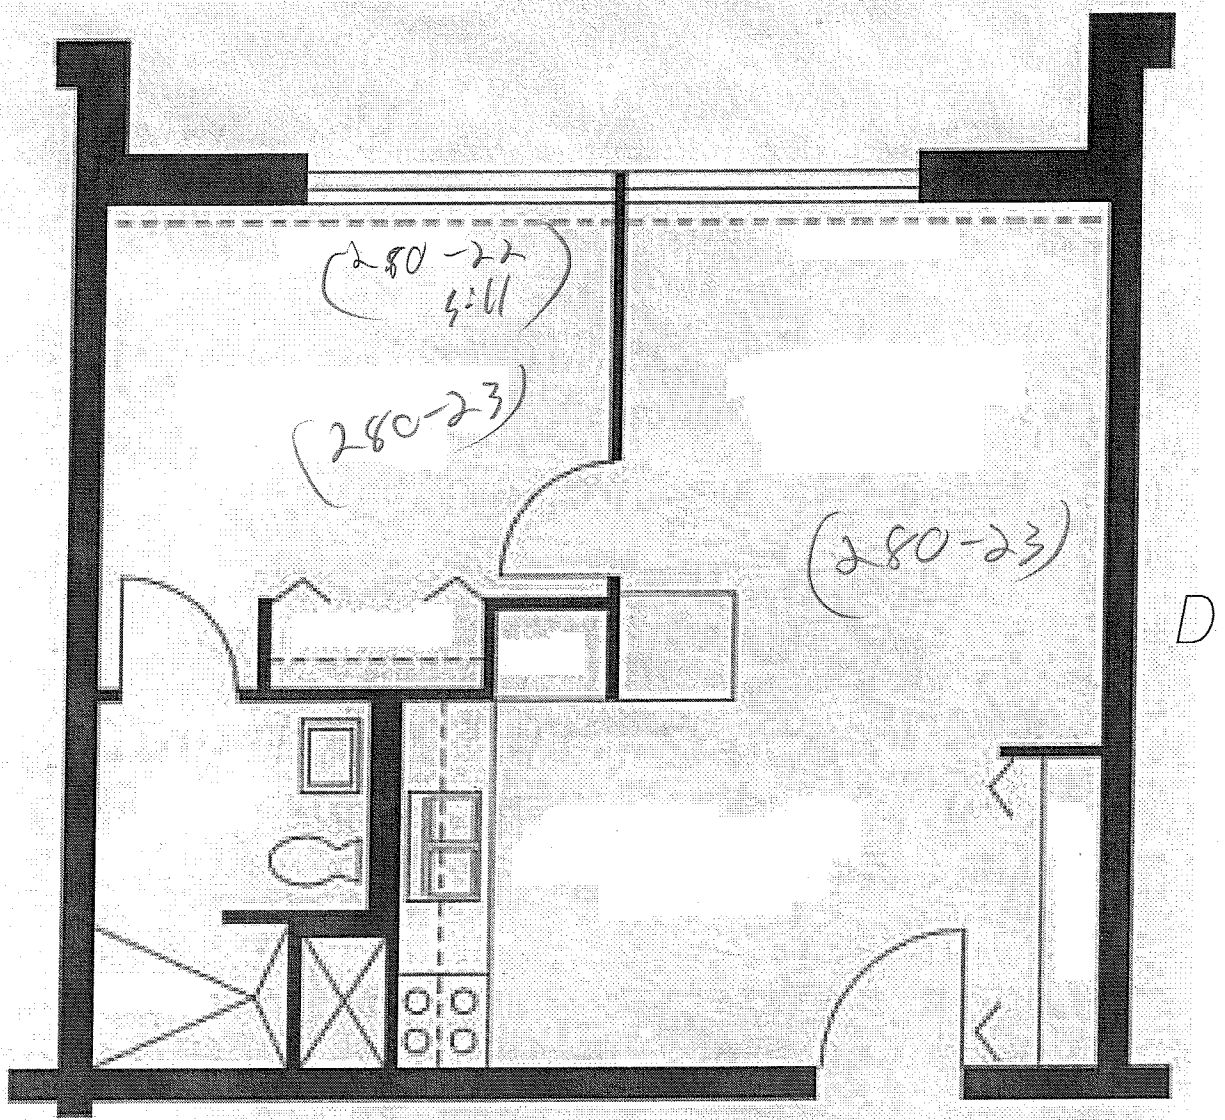
 Information To Build On <i>Engineering • Consulting • Testing</i> <u>Environmental Services</u> 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120 PHONE: (651) 646-8148 FAX: (651) 646-8258	PHA Hi-Rise Risk Assessment	Unit: 627
	Ravoux- Hi-Rise 280 Ravoux Street St. Paul, Minnesota 55103	Date: 11-05-10
	Project Number: 0673226-11	

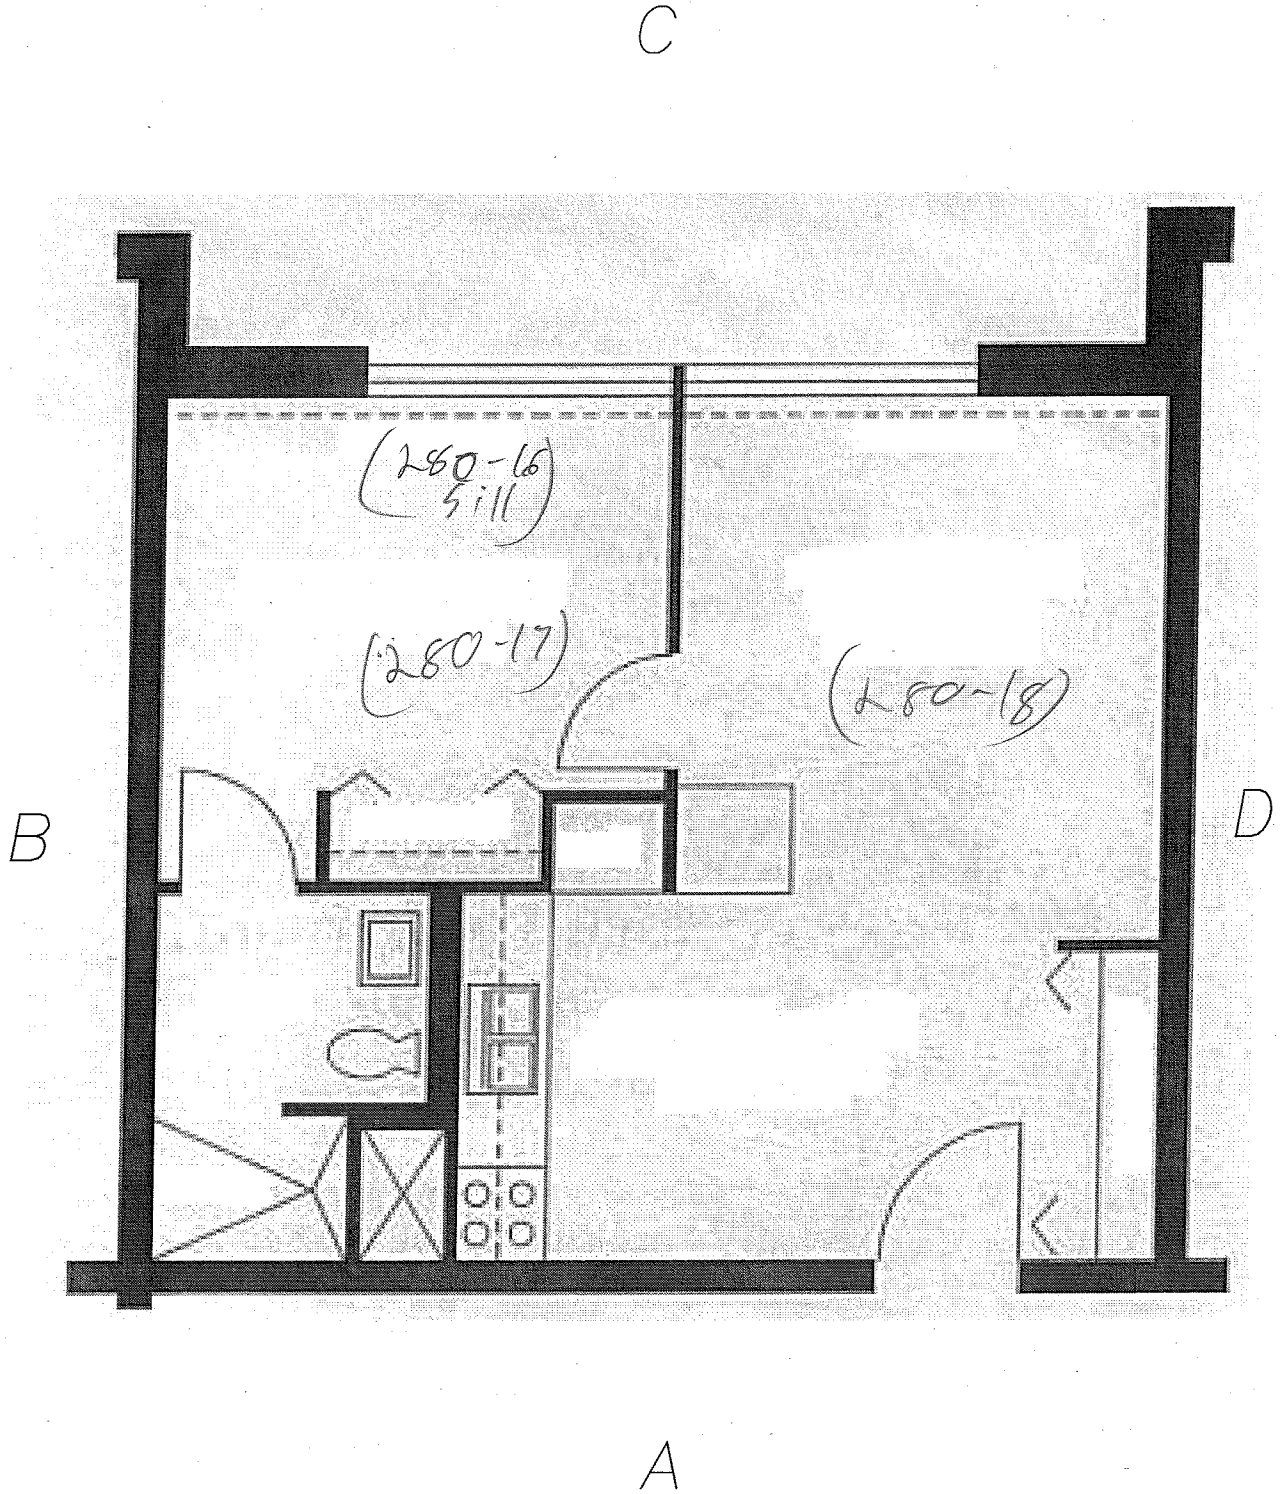

 Information To Build On Engineering • Consulting • Testing <u>Environmental Services</u> 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120 PHONE: (651) 646-8148 FAX: (651) 646-8258	PHA Hi-Rise Risk Assessment	Unit: 618
	Ravoux- Hi-Rise 280 Ravoux Street St. Paul, Minnesota 55103	Date: 11-05-10
		File Name: Type B-1 Studio
		Project Number: 0673226-11

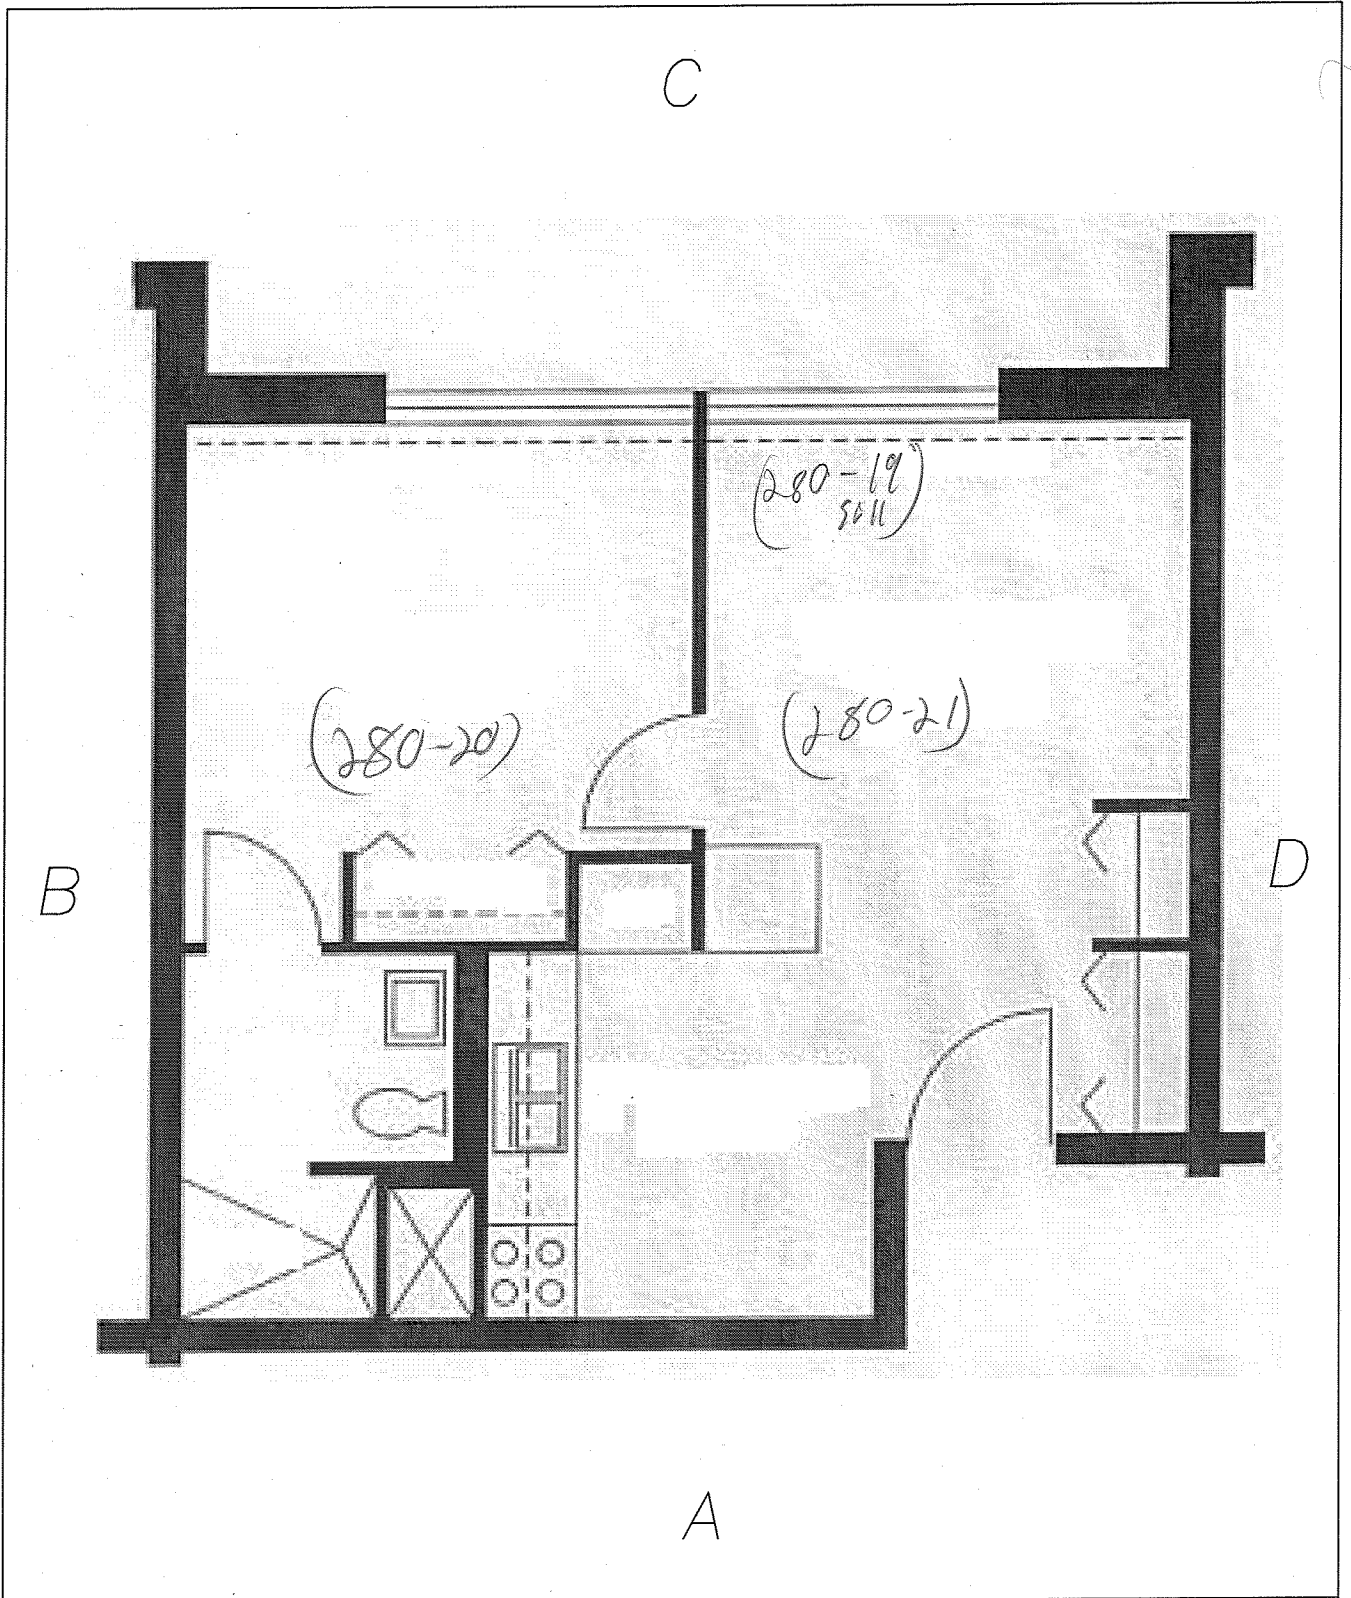

 Information To Build On <i>Engineering • Consulting • Testing</i> <i>Environmental Services</i> 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120 PHONE: (651) 646-8148 FAX: (651) 646-8258	PHA Hi-Rise Risk Assessment	Unit: <u>616</u>
	Ravoux - Hi-Rise 280 Ravoux Street St. Paul, Minnesota 55103	Date: 11-05-10
	Project Number: 0673226-11	



psi Information
To Build On
Engineering • Consulting • Testing

Environmental Services

2401 Pilot Knob Road, #138, Mendota Heights, MN 55120
PHONE: (651) 646-8148 FAX: (651) 646-8258

PHA Hi-Rise Risk Assessment


Ravoux- Hi-Rise
280 Ravoux Street
St. Paul, Minnesota 55103


Unit: 527


Date: 11-05-10

File Name: Type B-1 Studio

Project Number: 0673226-11

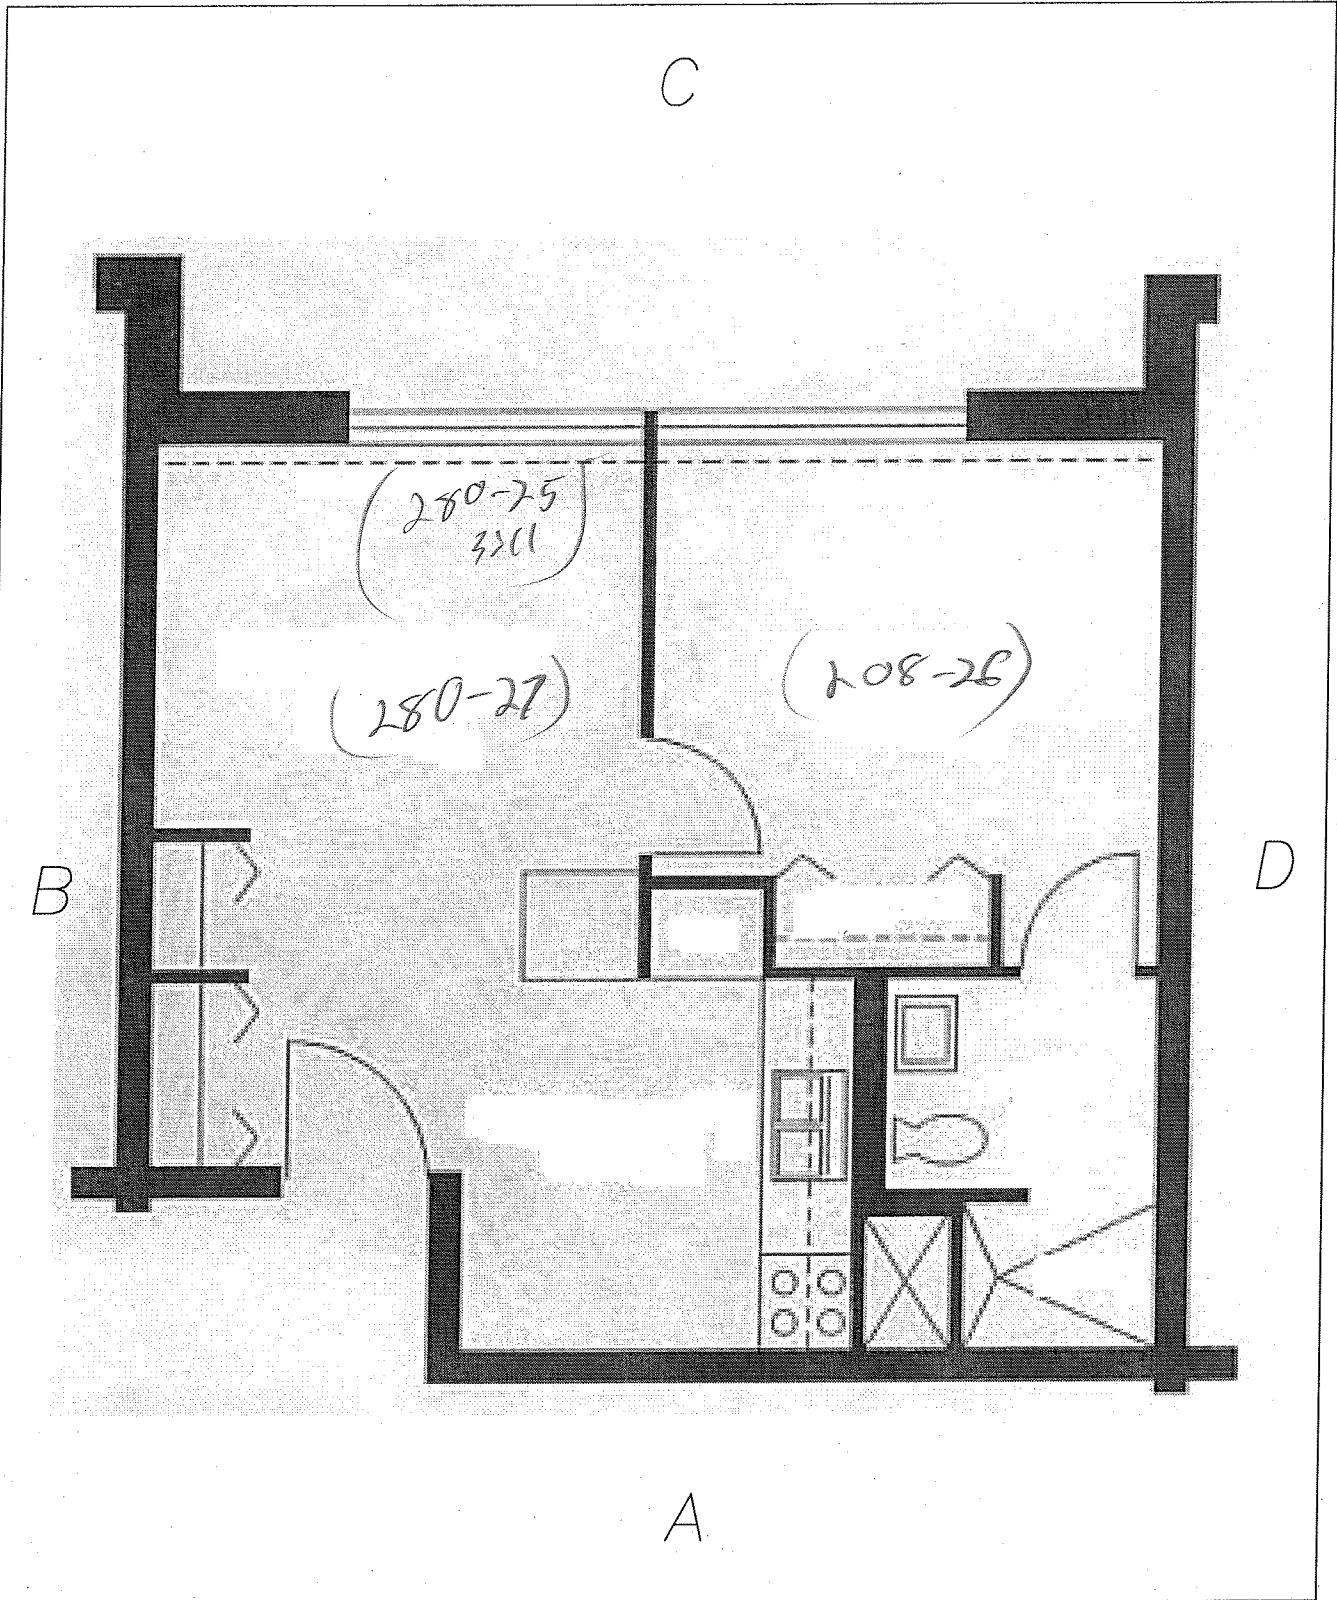

 Information To Build On Engineering • Consulting • Testing <i>Environmental Services</i> 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120 PHONE: (651) 646-8148 FAX: (651) 646-8258	PHA Hi-Rise Risk Assessment		Unit: 507
	Ravoux- Hi-Rise 280 Ravoux Street St. Paul, Minnesota 55103		Date: 11-05-10
			File Name: Unit Layout A-2 Single Bedroom
			Project Number: 0673226-11

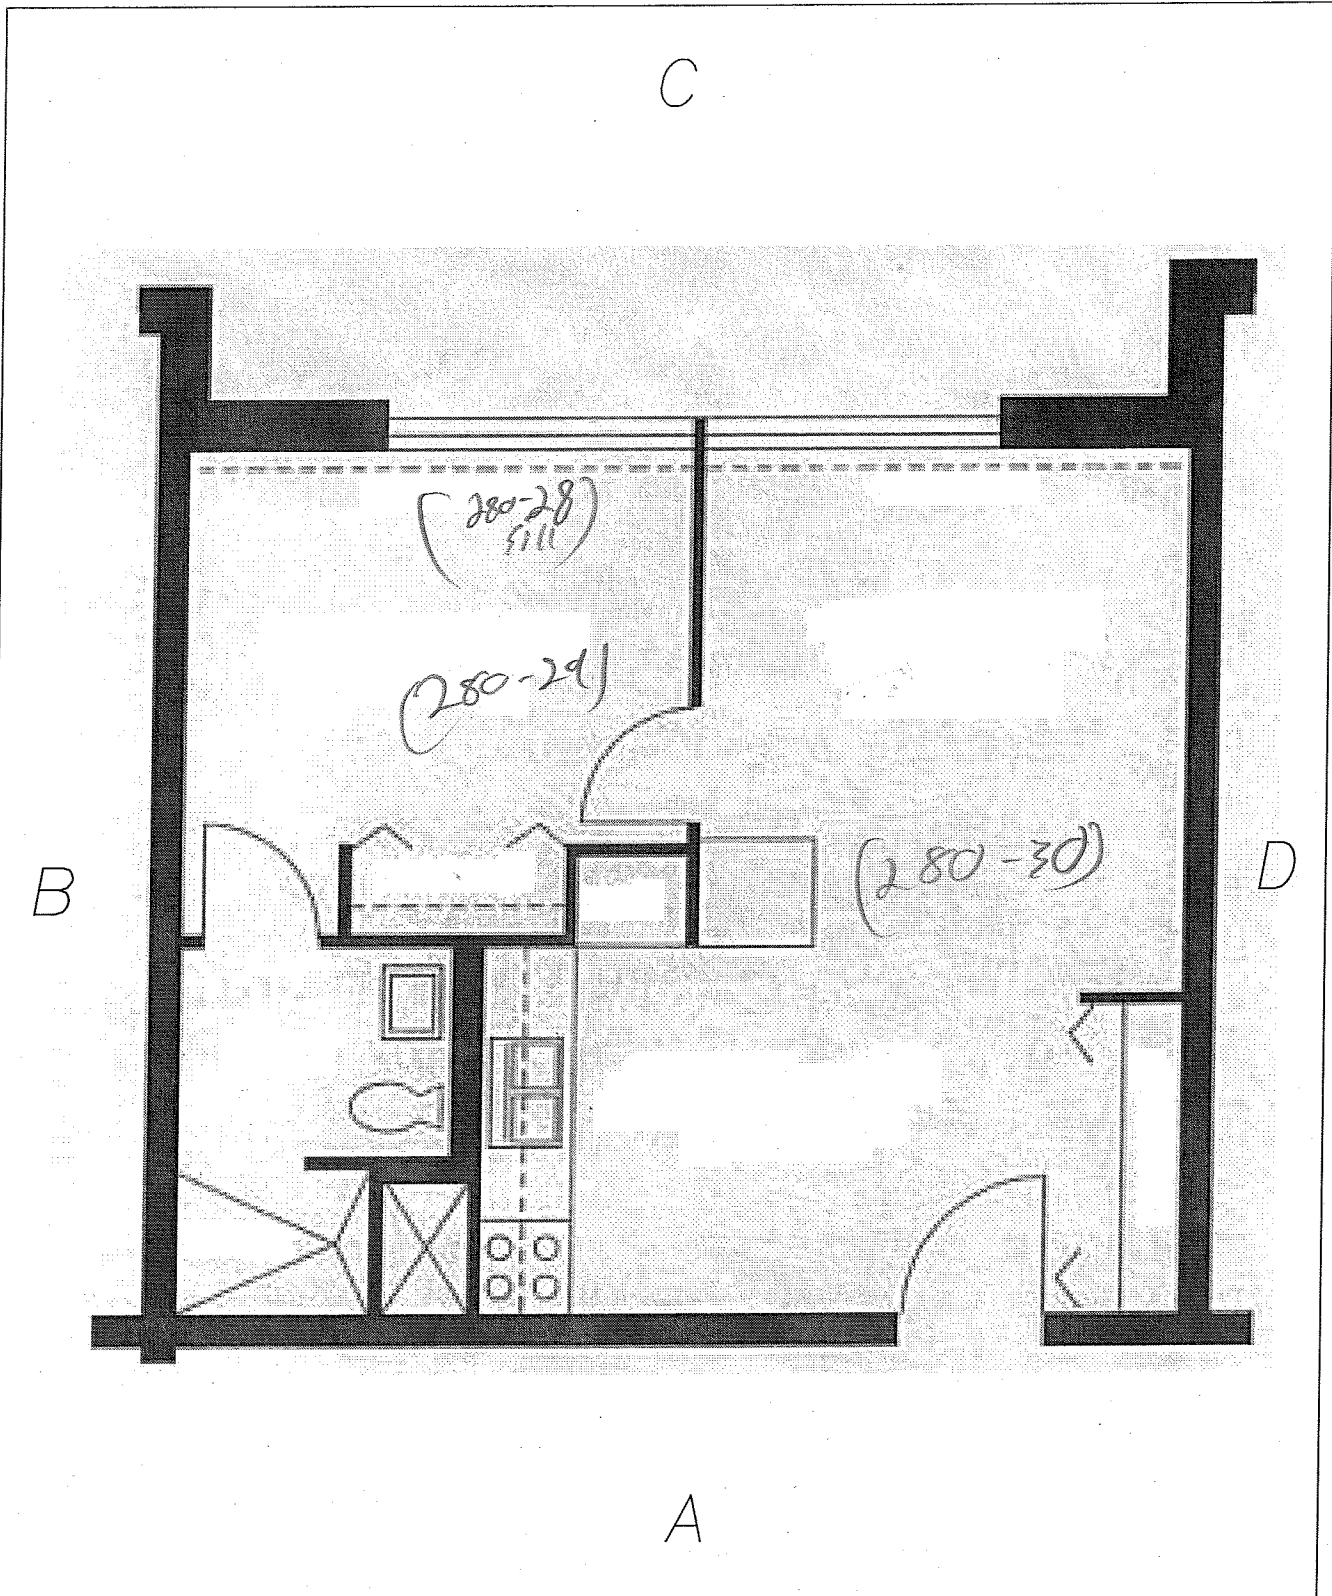



psi Information
 To Build On
 Engineering • Consulting • Testing
 Environmental Services
 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120
 PHONE: (651) 646-8148 FAX: (651) 646-8258


PHA Hi-Rise Risk Assessment

Ravoux- Hi-Rise
 280 Ravoux Street
 St. Paul, Minnesota 55103

Unit: 415
 Date: 11-05-10
 File Name: Type B-1 Studio
 Project Number: 0673226-11

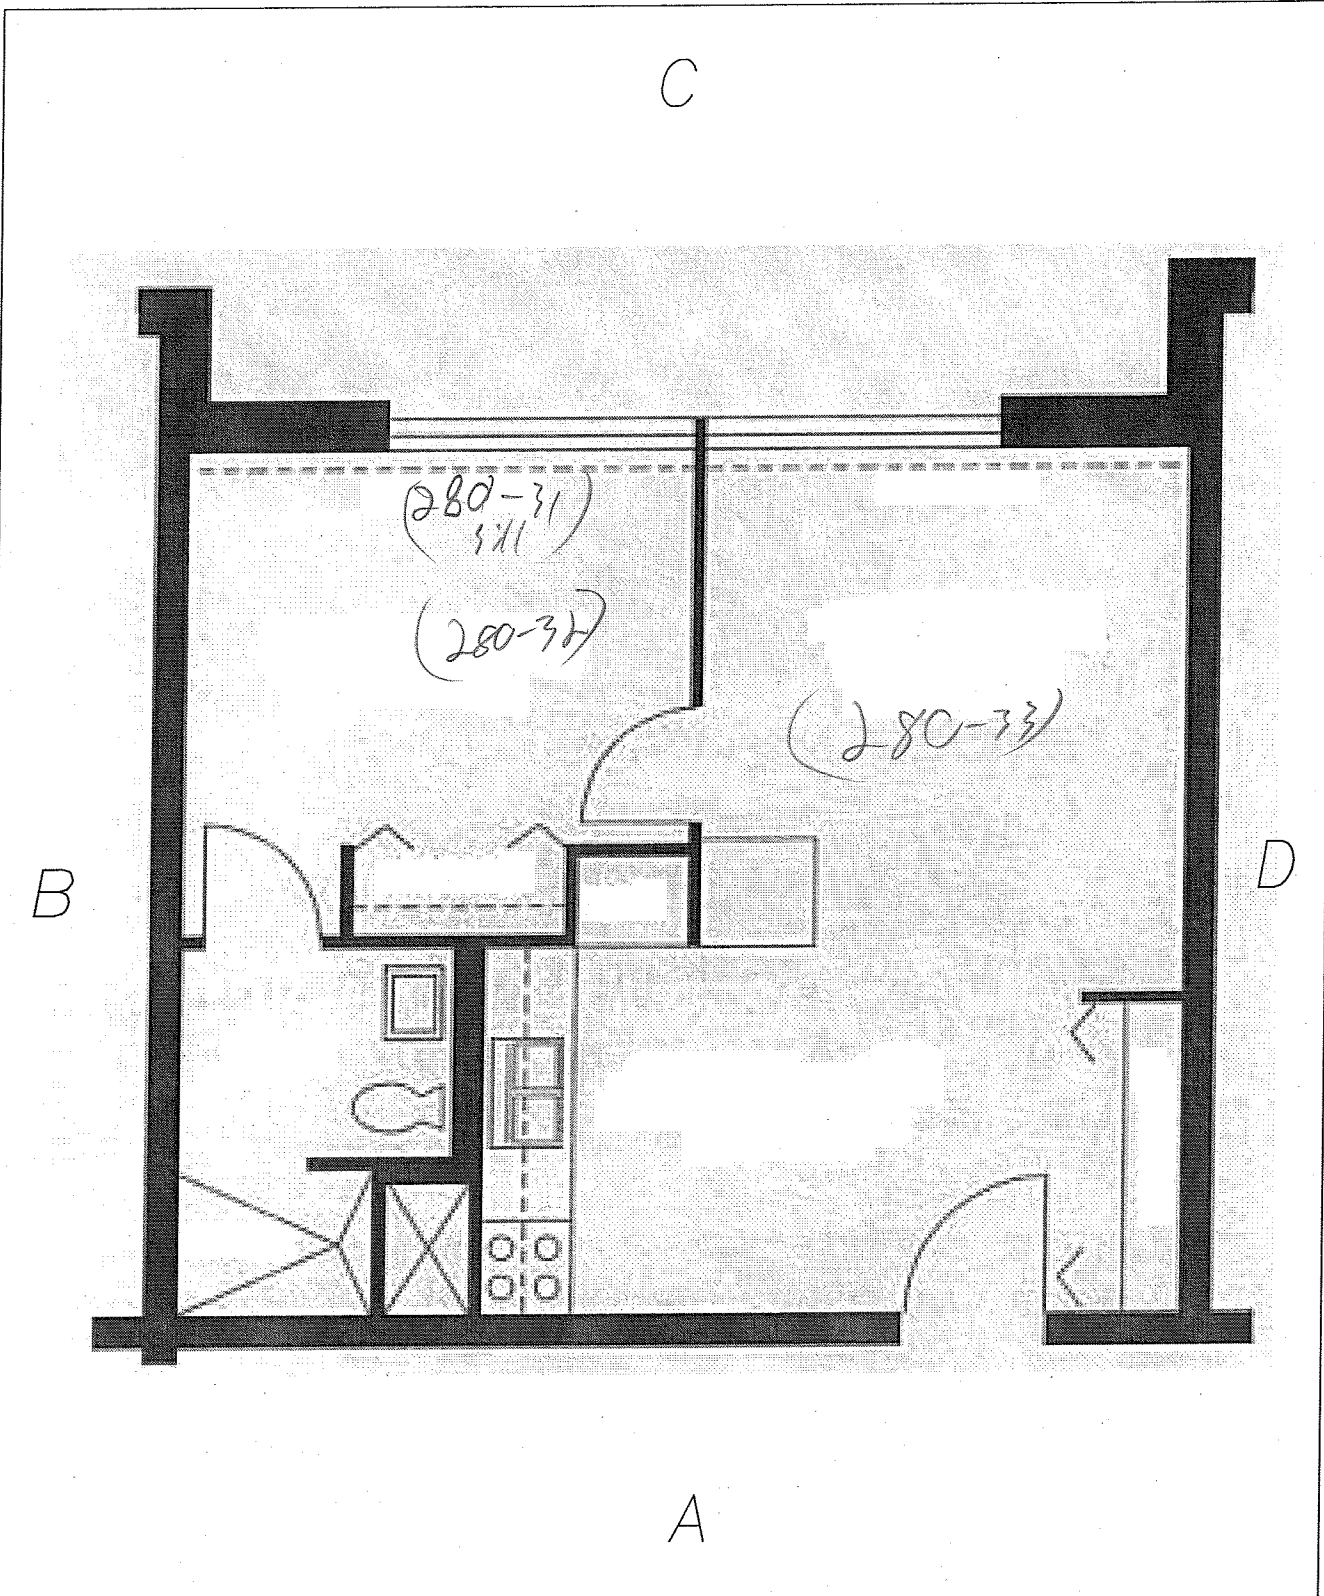

 Information To Build On Engineering • Consulting • Testing <i>Environmental Services</i> 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120 PHONE: (651) 646-8148 FAX: (651) 646-8258	PHA Hi-Rise Risk Assessment		Unit: <i>4004</i>
			Date: 11-05-10
	Ravoux- Hi-Rise 280 Ravoux Street St. Paul, Minnesota 55103		File Name: Type B-1 Studio
			Project Number: 0673226-11

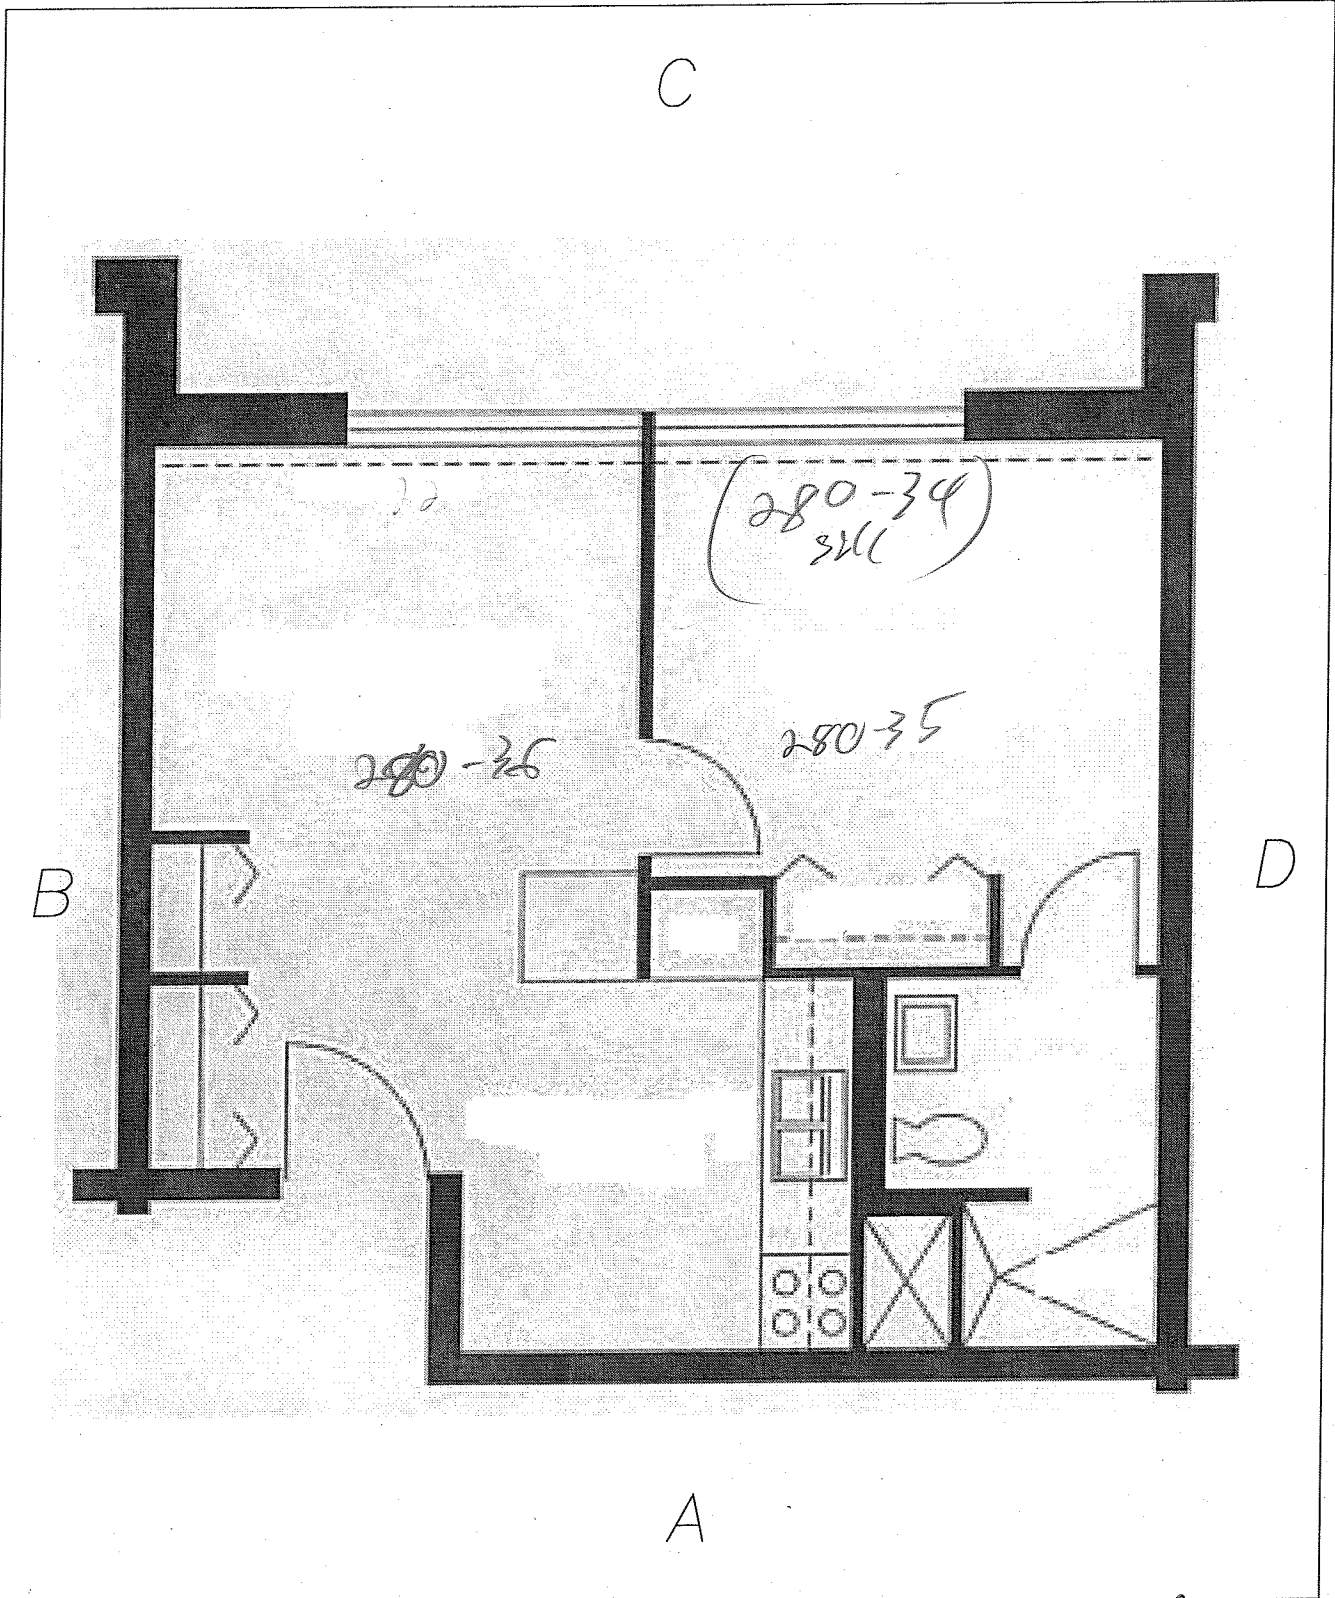



psi Information
To Build On
 Engineering • Consulting • Testing
 Environmental Services
 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120
 PHONE: (651) 646-8148 FAX: (651) 646-8258


PHA Hi-Rise Risk Assessment

Ravoux- Hi-Rise
 280 Ravoux Street
 St. Paul, Minnesota 55103

Unit: 407
 Date: 11-05-10
 File Name: Unit Layout A-2 Single Bedroom
 Project Number: 0673226-11

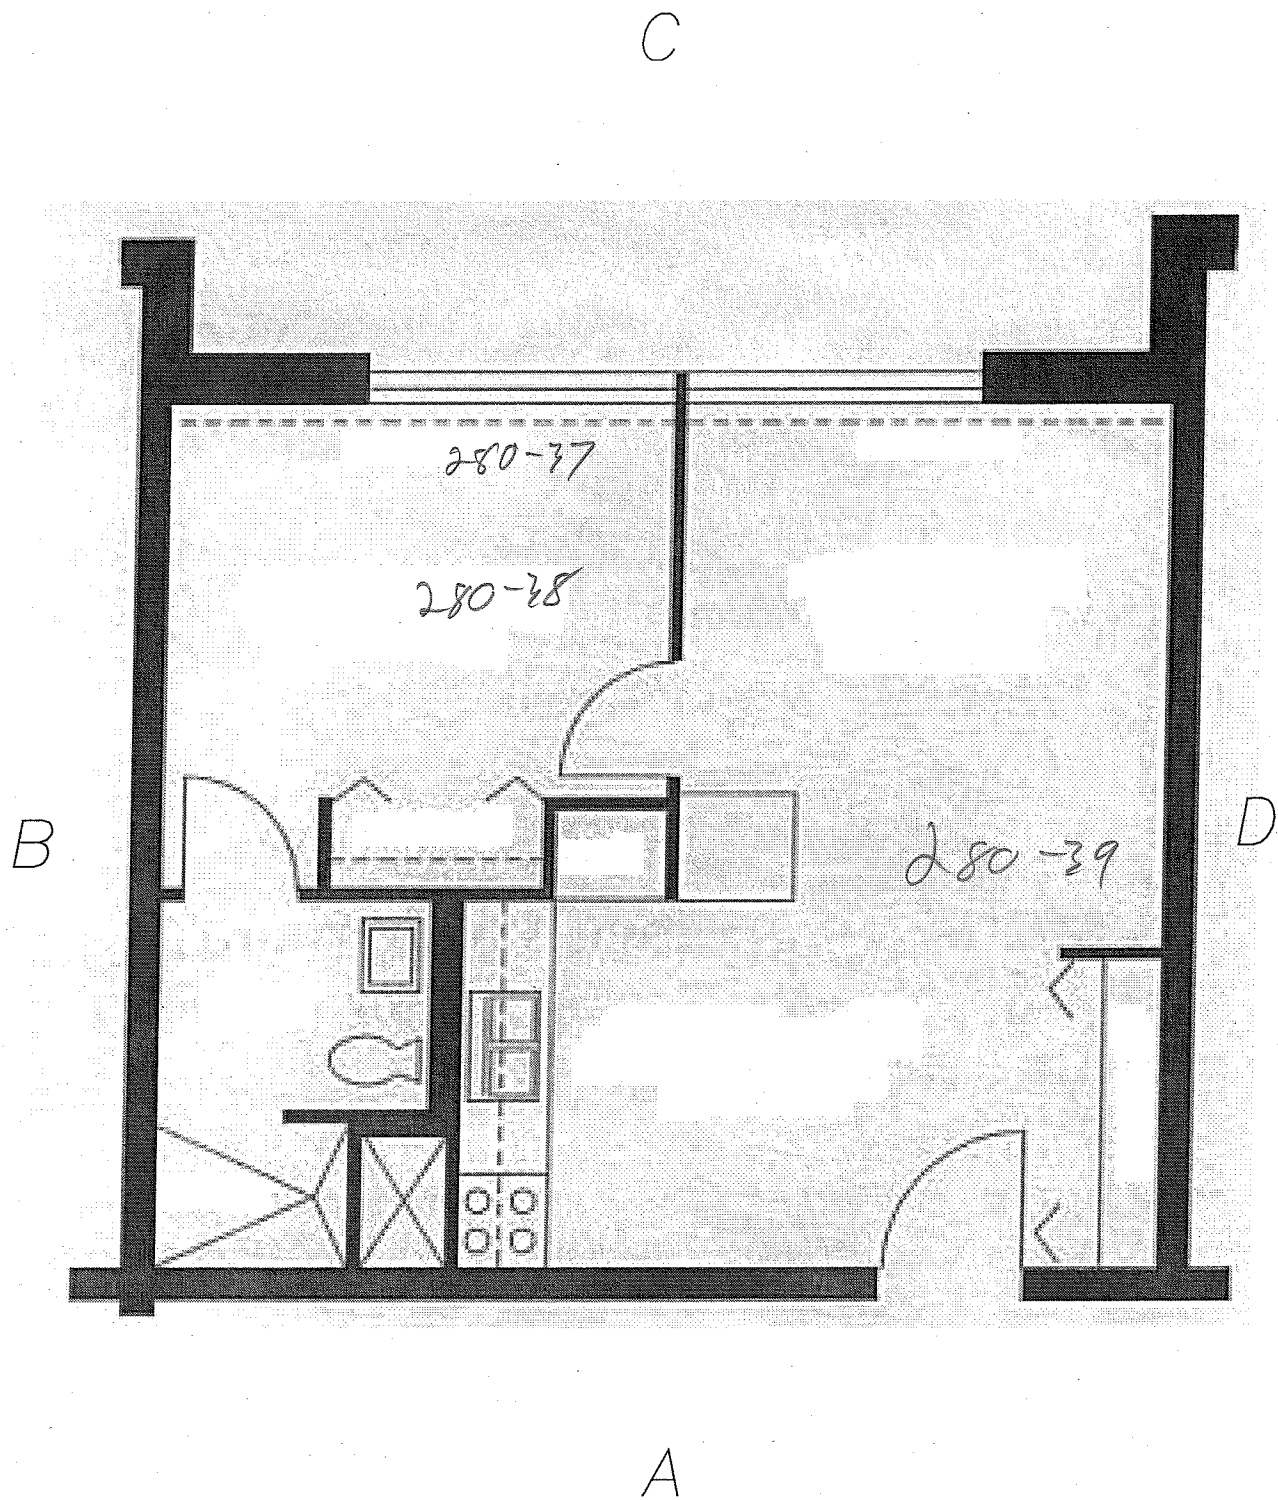

 Information To Build On <i>Engineering • Consulting • Testing</i> <u>Environmental Services</u> 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120 PHONE: (651) 646-8148 FAX: (651) 646-8258	PHA Hi-Rise Risk Assessment	Unit: 215
	Ravoux- Hi-Rise 280 Ravoux Street St. Paul, Minnesota 55103	Date: 11-05-10
	Project Number: 0673226-11	File Name: Type B-1 Studio

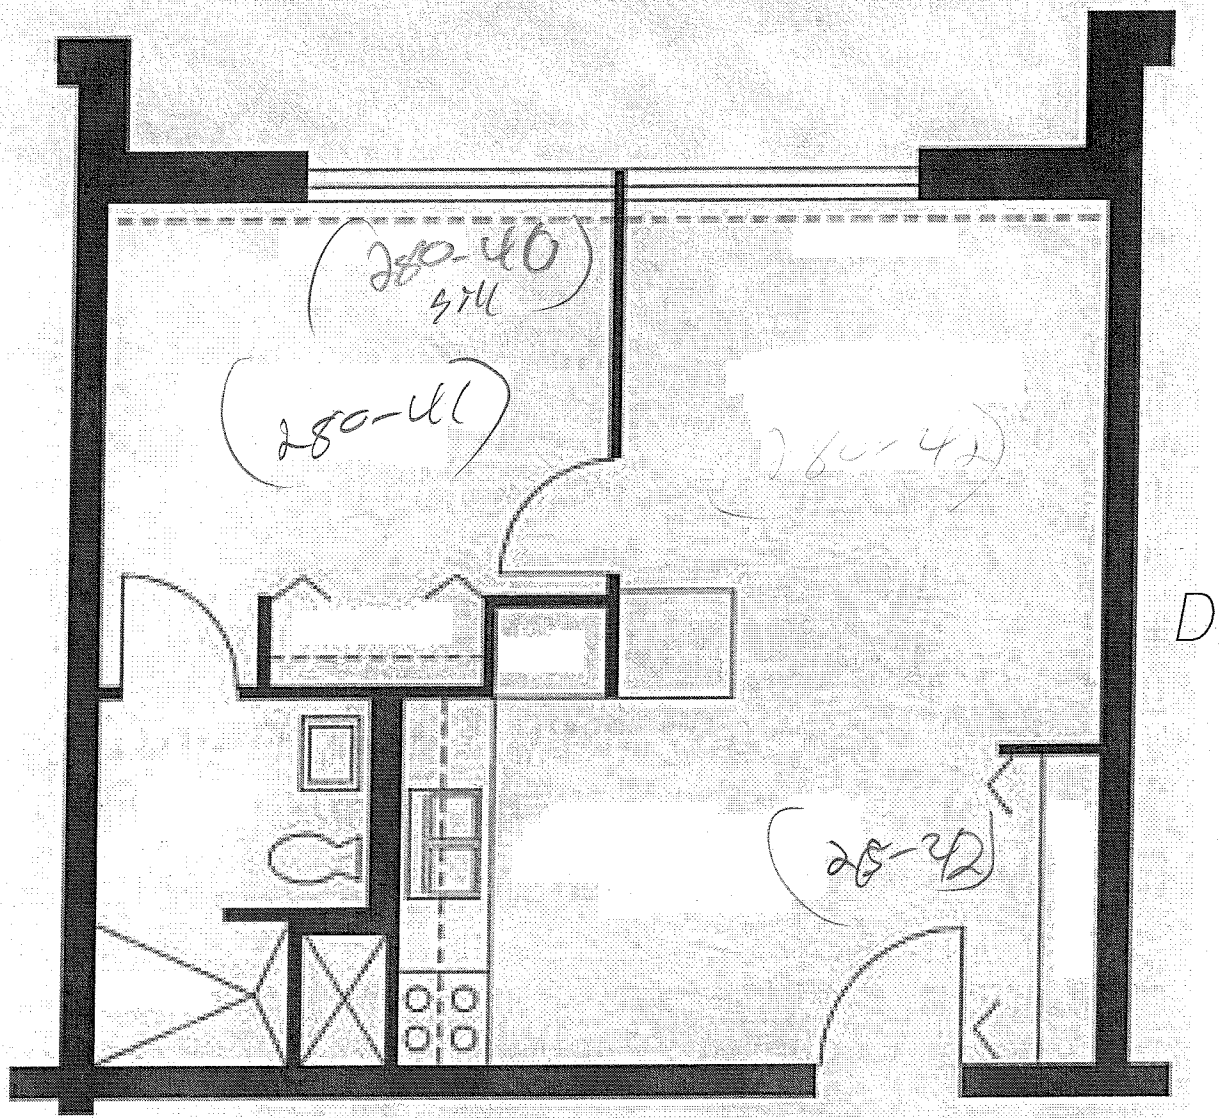

psi Information
To Build On
Engineering • Consulting • Testing

Environmental Services

2401 Pilot Knob Road, #138, Mendota Heights, MN 55120
PHONE: (651) 646-8148 FAX: (651) 646-8258

PHA Hi-Rise Risk Assessment

Ravoux- Hi-Rise
280 Ravoux Street
St. Paul, Minnesota 55103

Unit:

221

Date:


11-05-10

File Name:

Type B-1
Studio

Project Number:

0673226-11

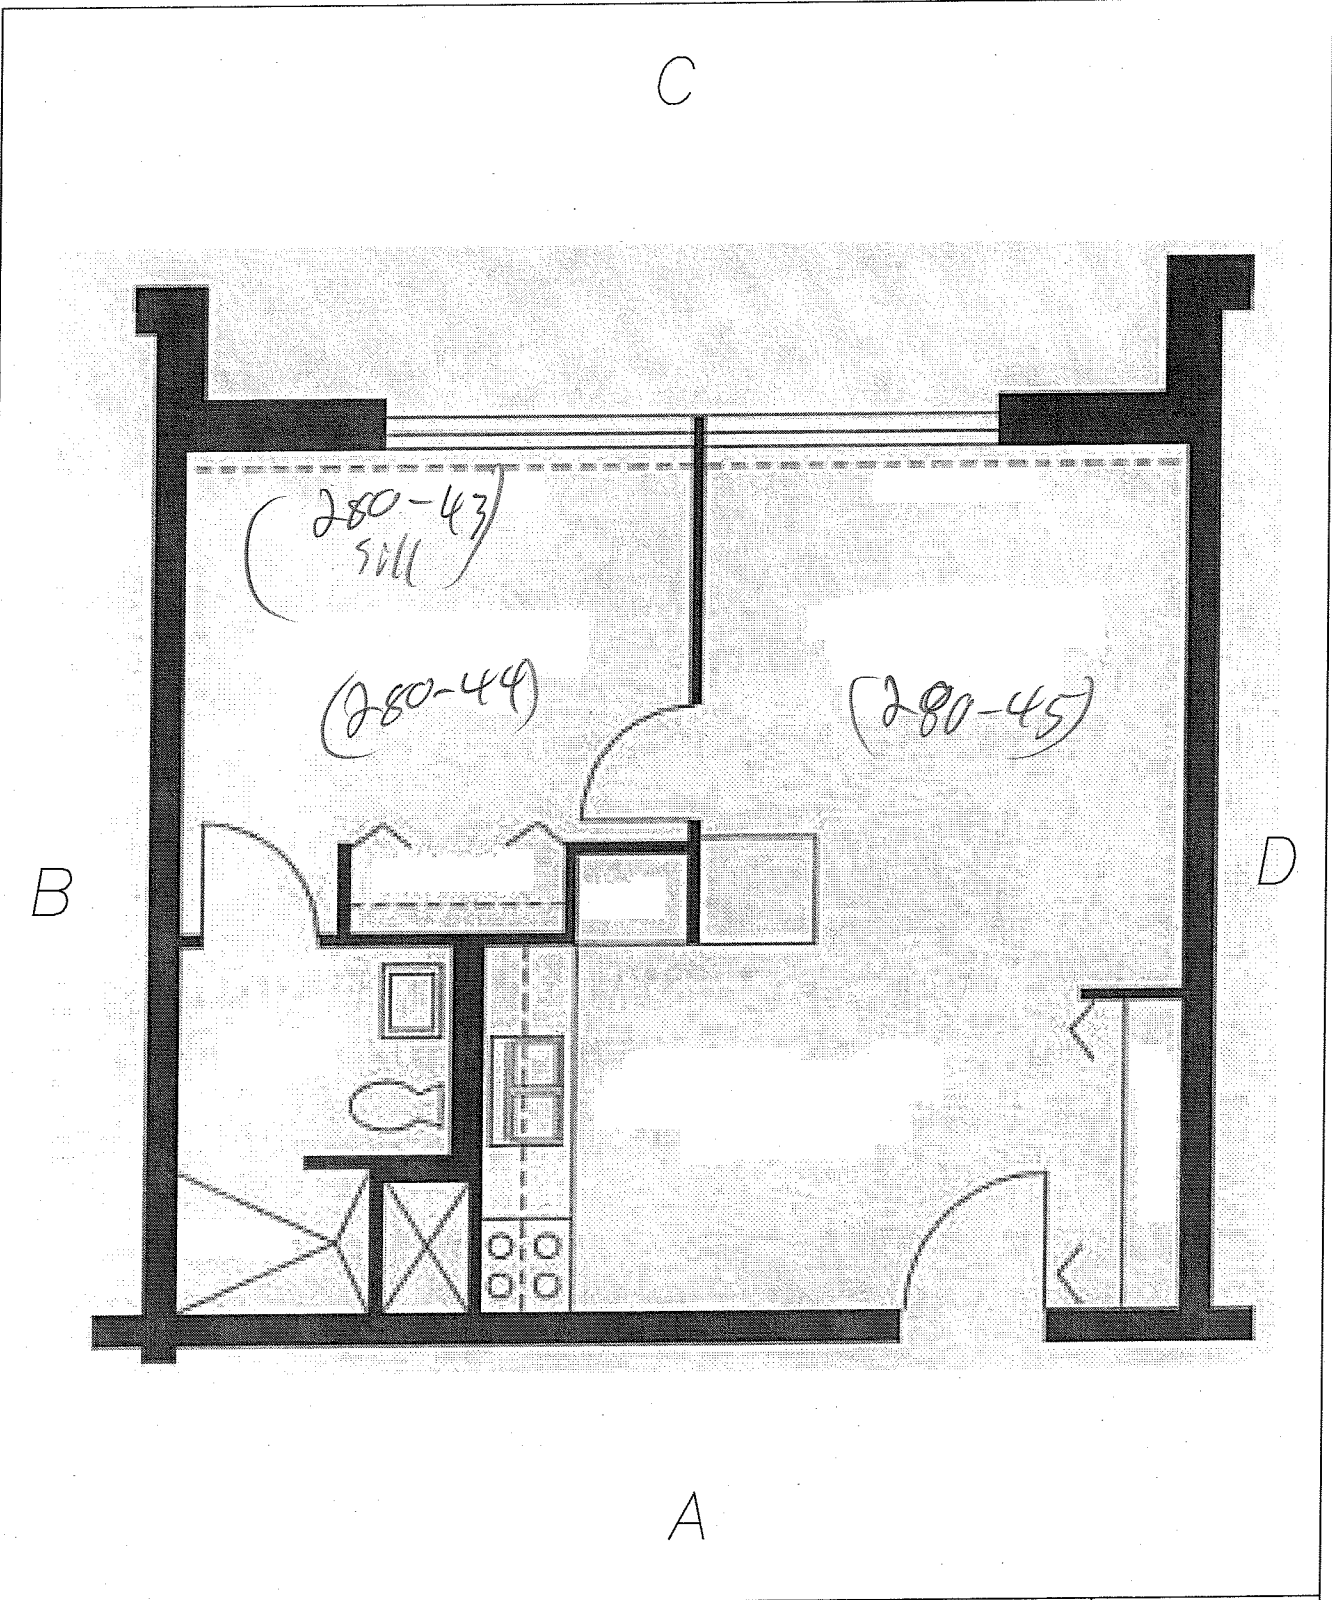


psi Information
To Build On
 Engineering • Consulting • Testing
 Environmental Services
 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120
 PHONE: (651) 646-8148 FAX: (651) 646-8258

PHA Hi-Rise Risk Assessment

Ravoux- Hi-Rise
 280 Ravoux Street
 St. Paul, Minnesota 55103

Unit:	214
Date:	11-05-10
File Name:	Type B-1 Studio
Project Number:	0673226-11

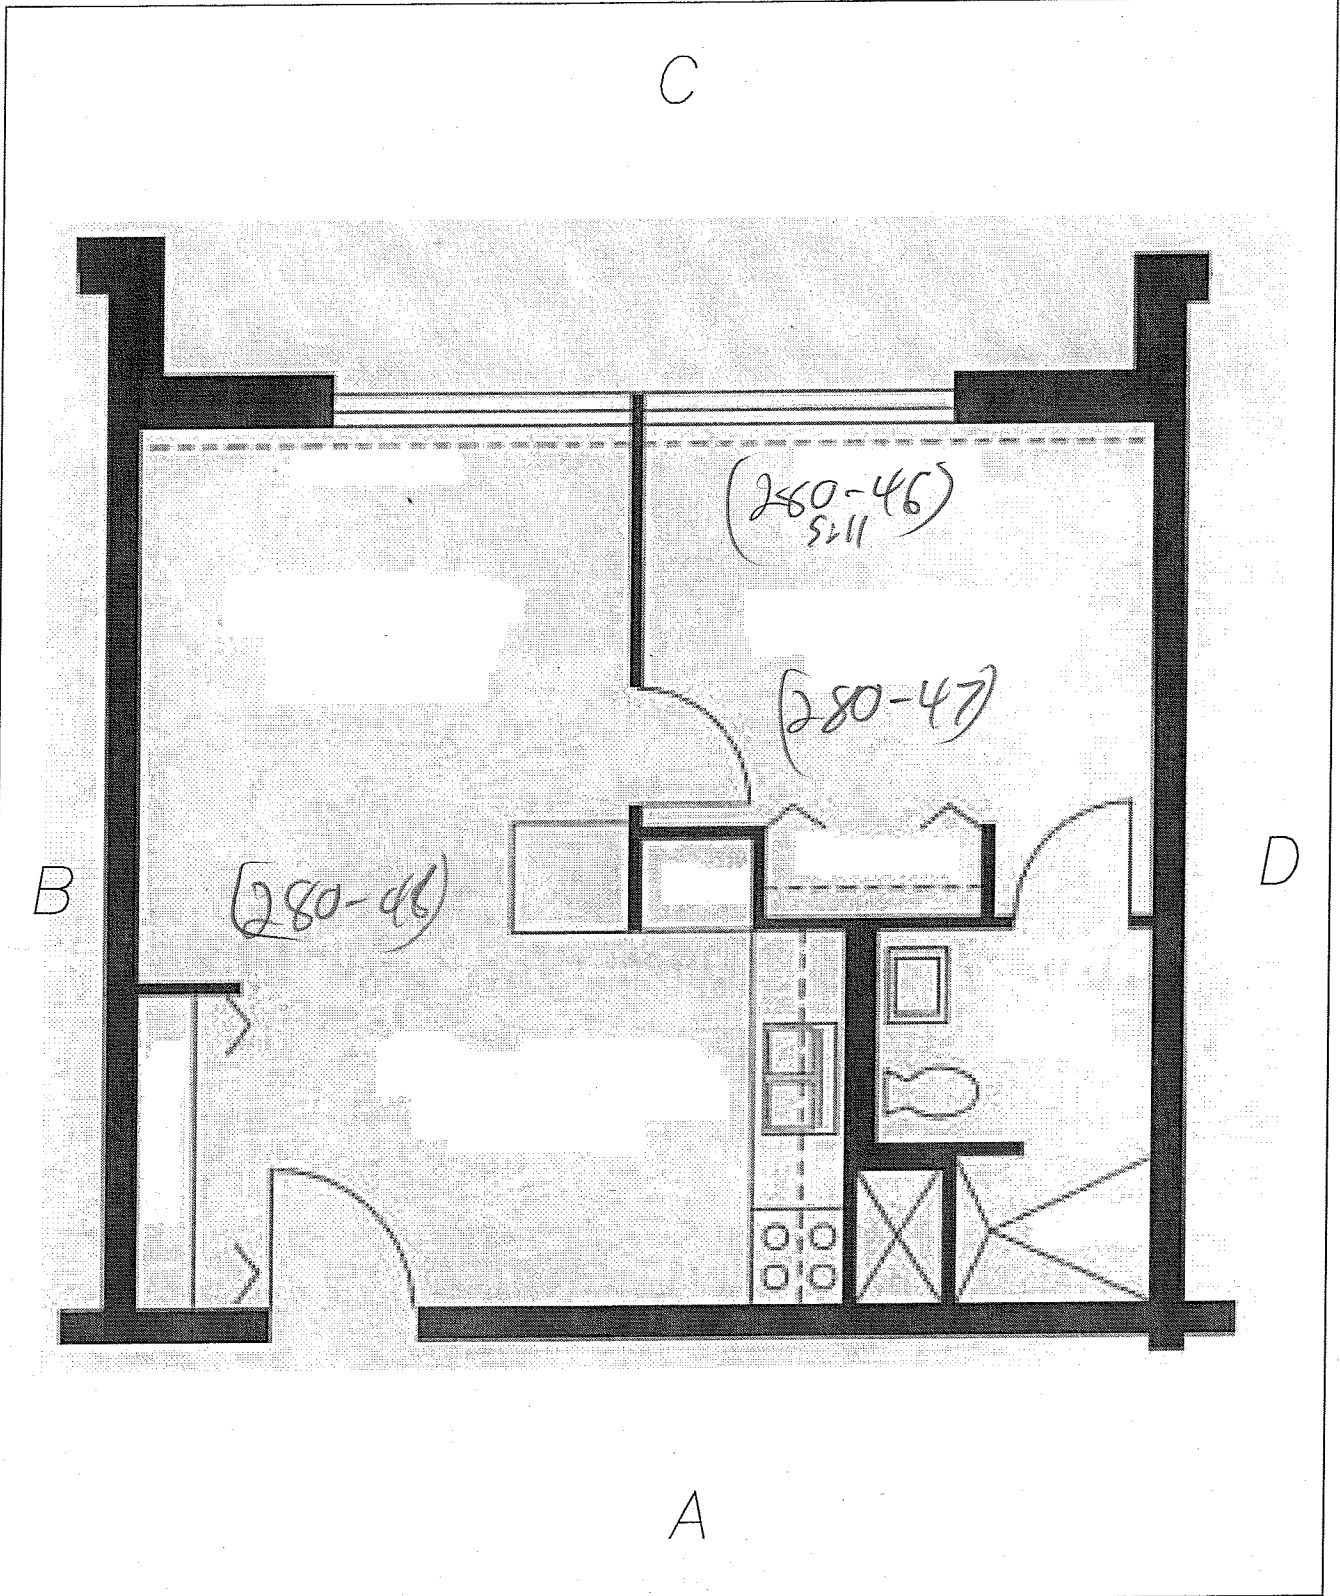


psi Information
 To Build On
 Engineering • Consulting • Testing
 Environmental Services
 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120
 PHONE: (651) 646-8148 FAX: (651) 646-8258

PHA Hi-Rise Risk Assessment

Ravoux- Hi-Rise
 280 Ravoux Street
 St. Paul, Minnesota 55103

Unit:	211
Date:	11-05-10
File Name:	Type B-2 Studio
Project Number:	0673226-11

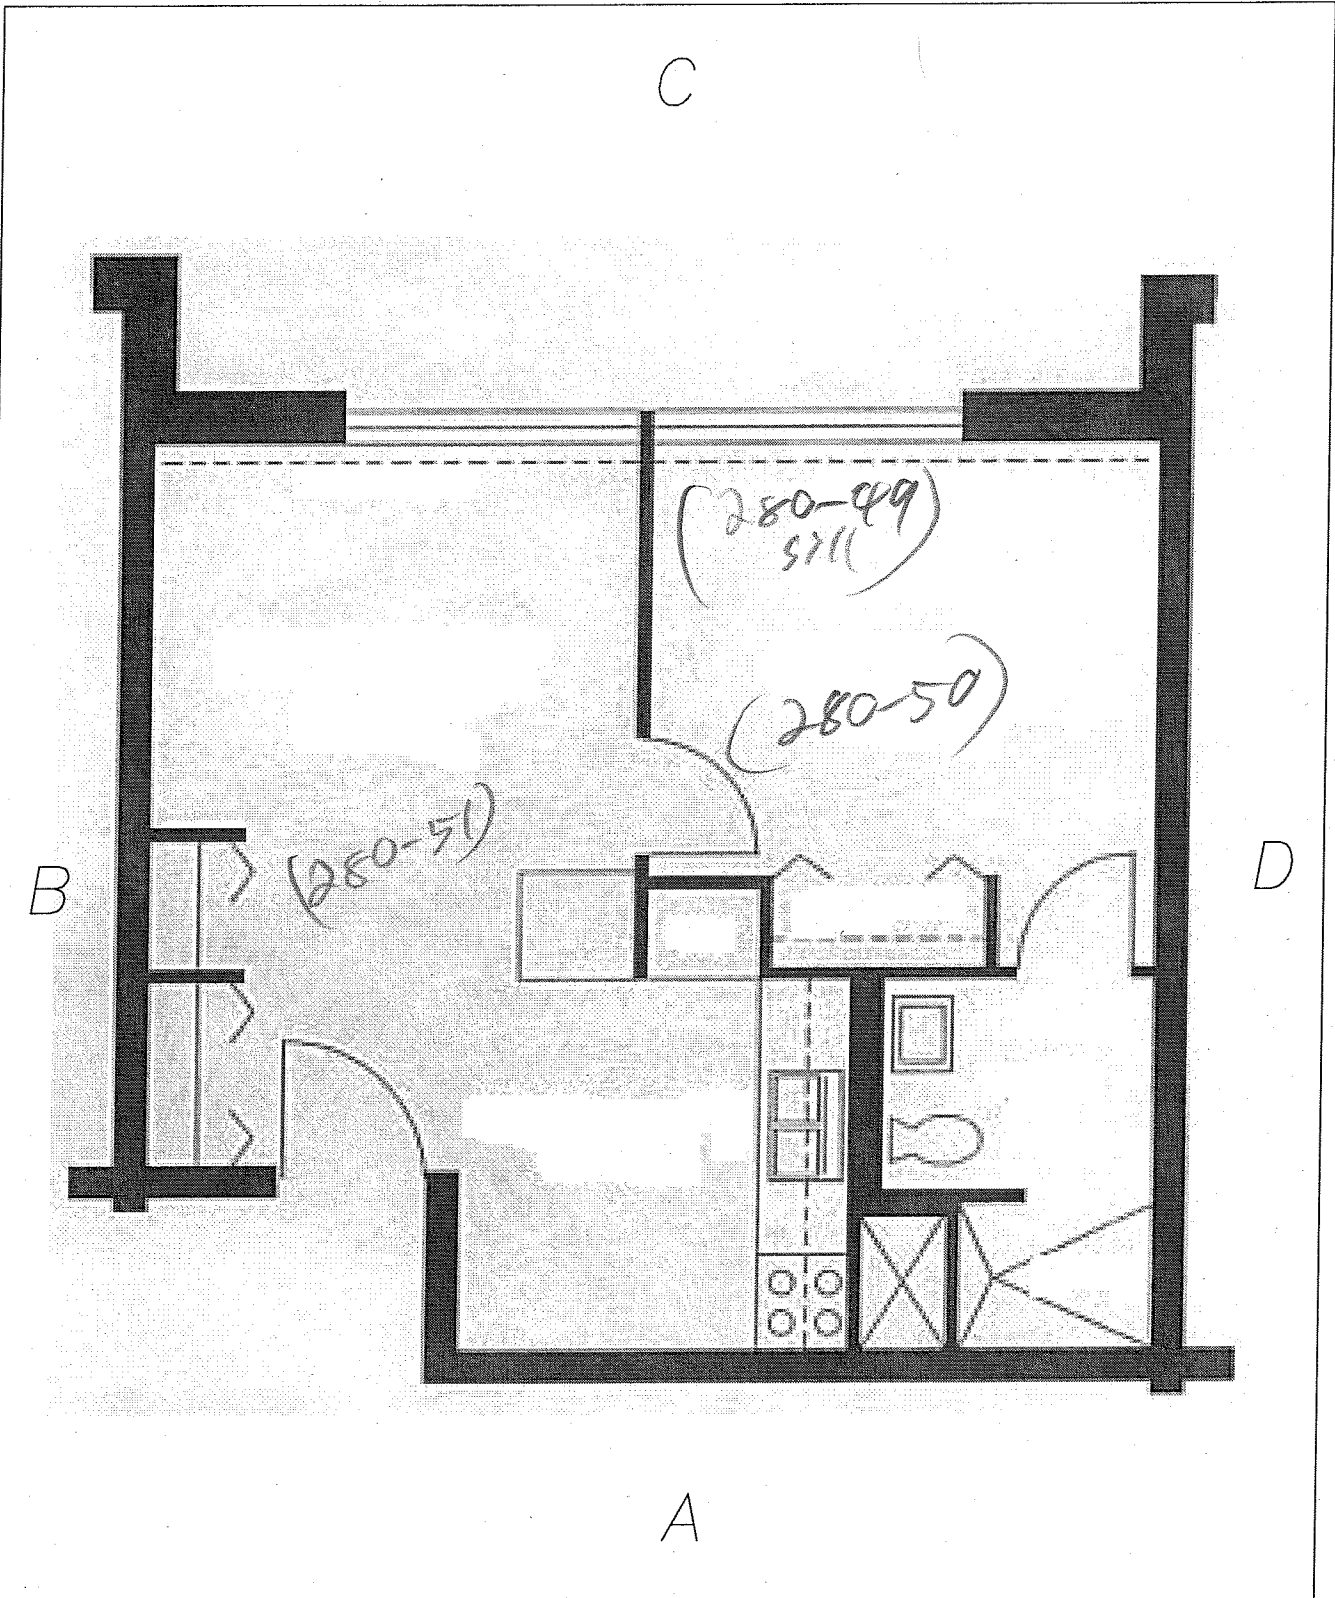



psi Information
 To Build On
 Engineering • Consulting • Testing
 Environmental Services
 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120
 PHONE: (651) 646-8148 FAX: (651) 646-8258


PHA Hi-Rise Risk Assessment

Ravoux- Hi-Rise
 280 Ravoux Street
 St. Paul, Minnesota 55103

Unit: 201
 Date: 11-05-10
 File Name: Unit Layout A-2 Single Bedroom
 Project Number: 0673226-11

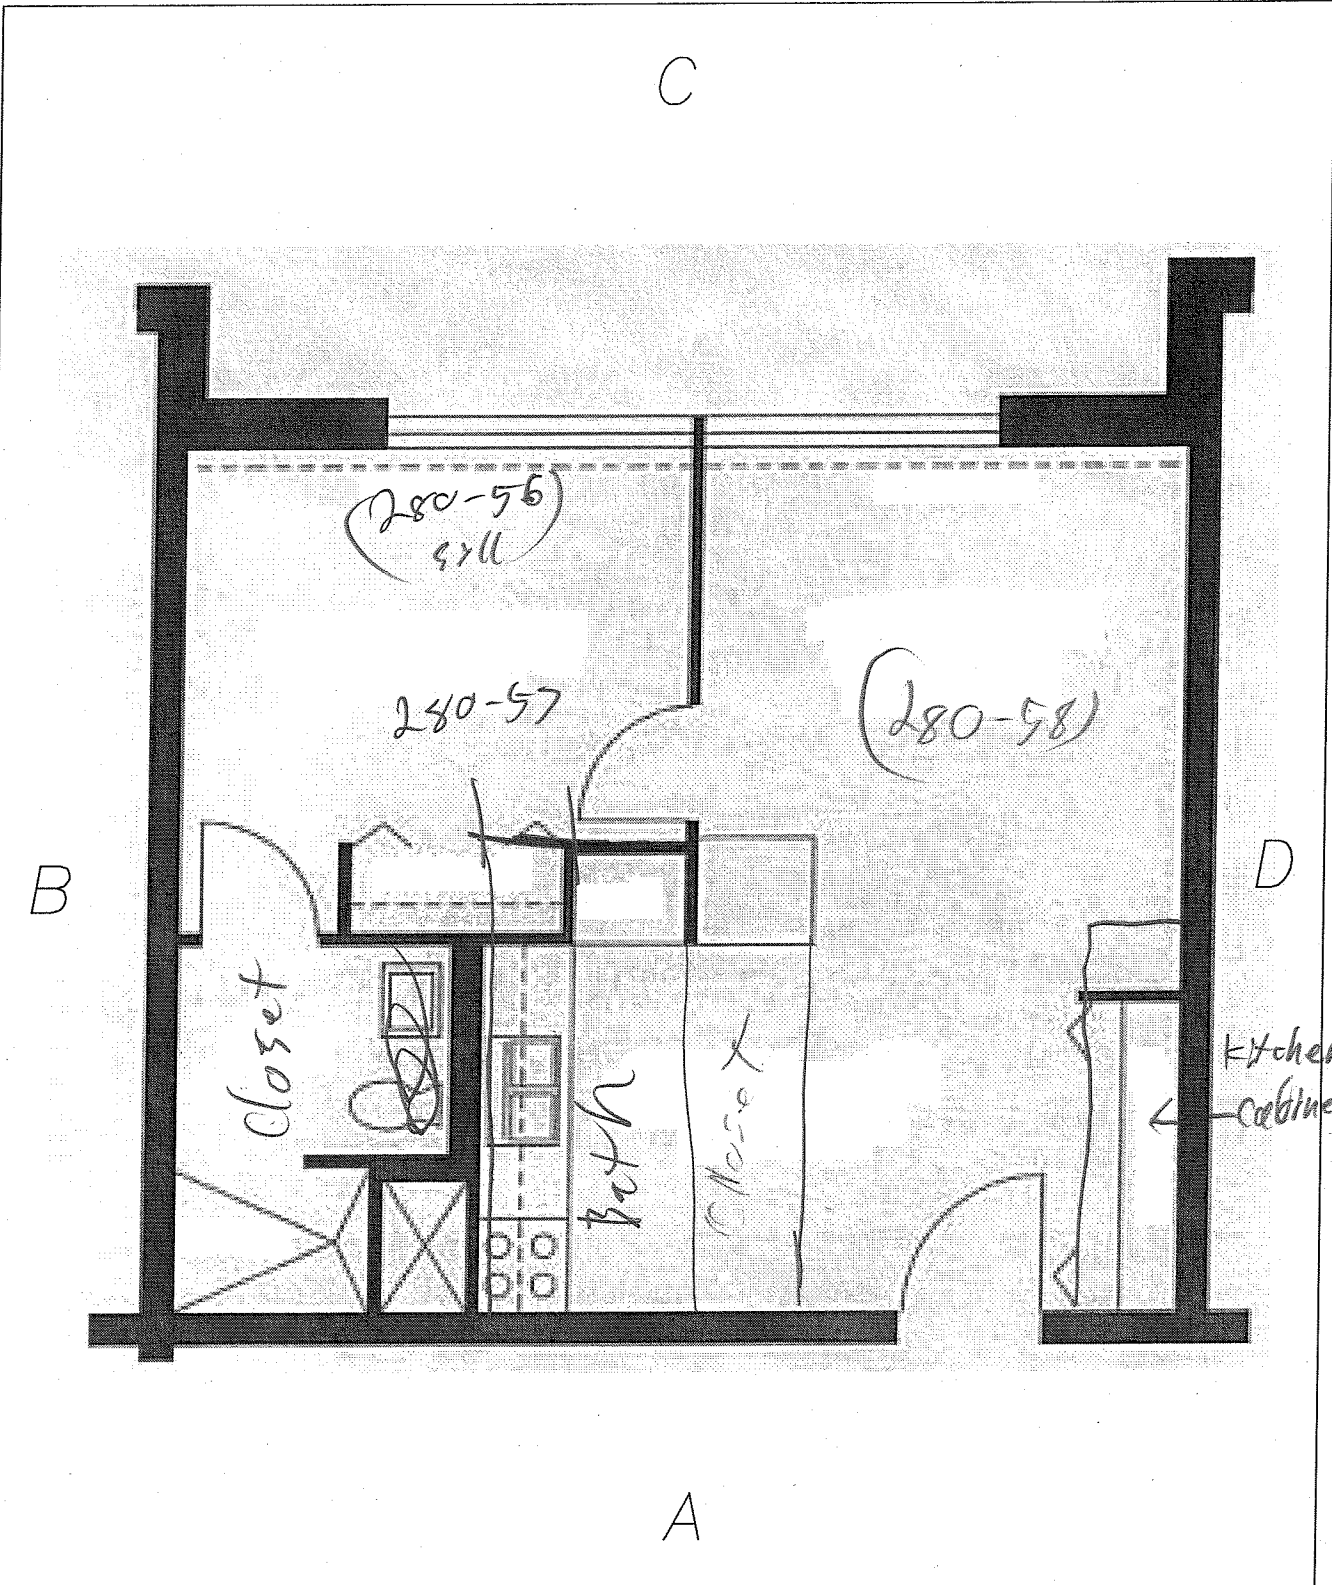

 Information To Build On Engineering • Consulting • Testing <i>Environmental Services</i> 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120 PHONE: (651) 646-8148 FAX: (651) 646-8258	PHA Hi-Rise Risk Assessment		Unit: <u>115</u>
	Ravoux- Hi-Rise 280 Ravoux Street St. Paul, Minnesota 55103		Date: 11-05-10
			File Name: Type B-1 Studio
			Project Number: 0673226-11

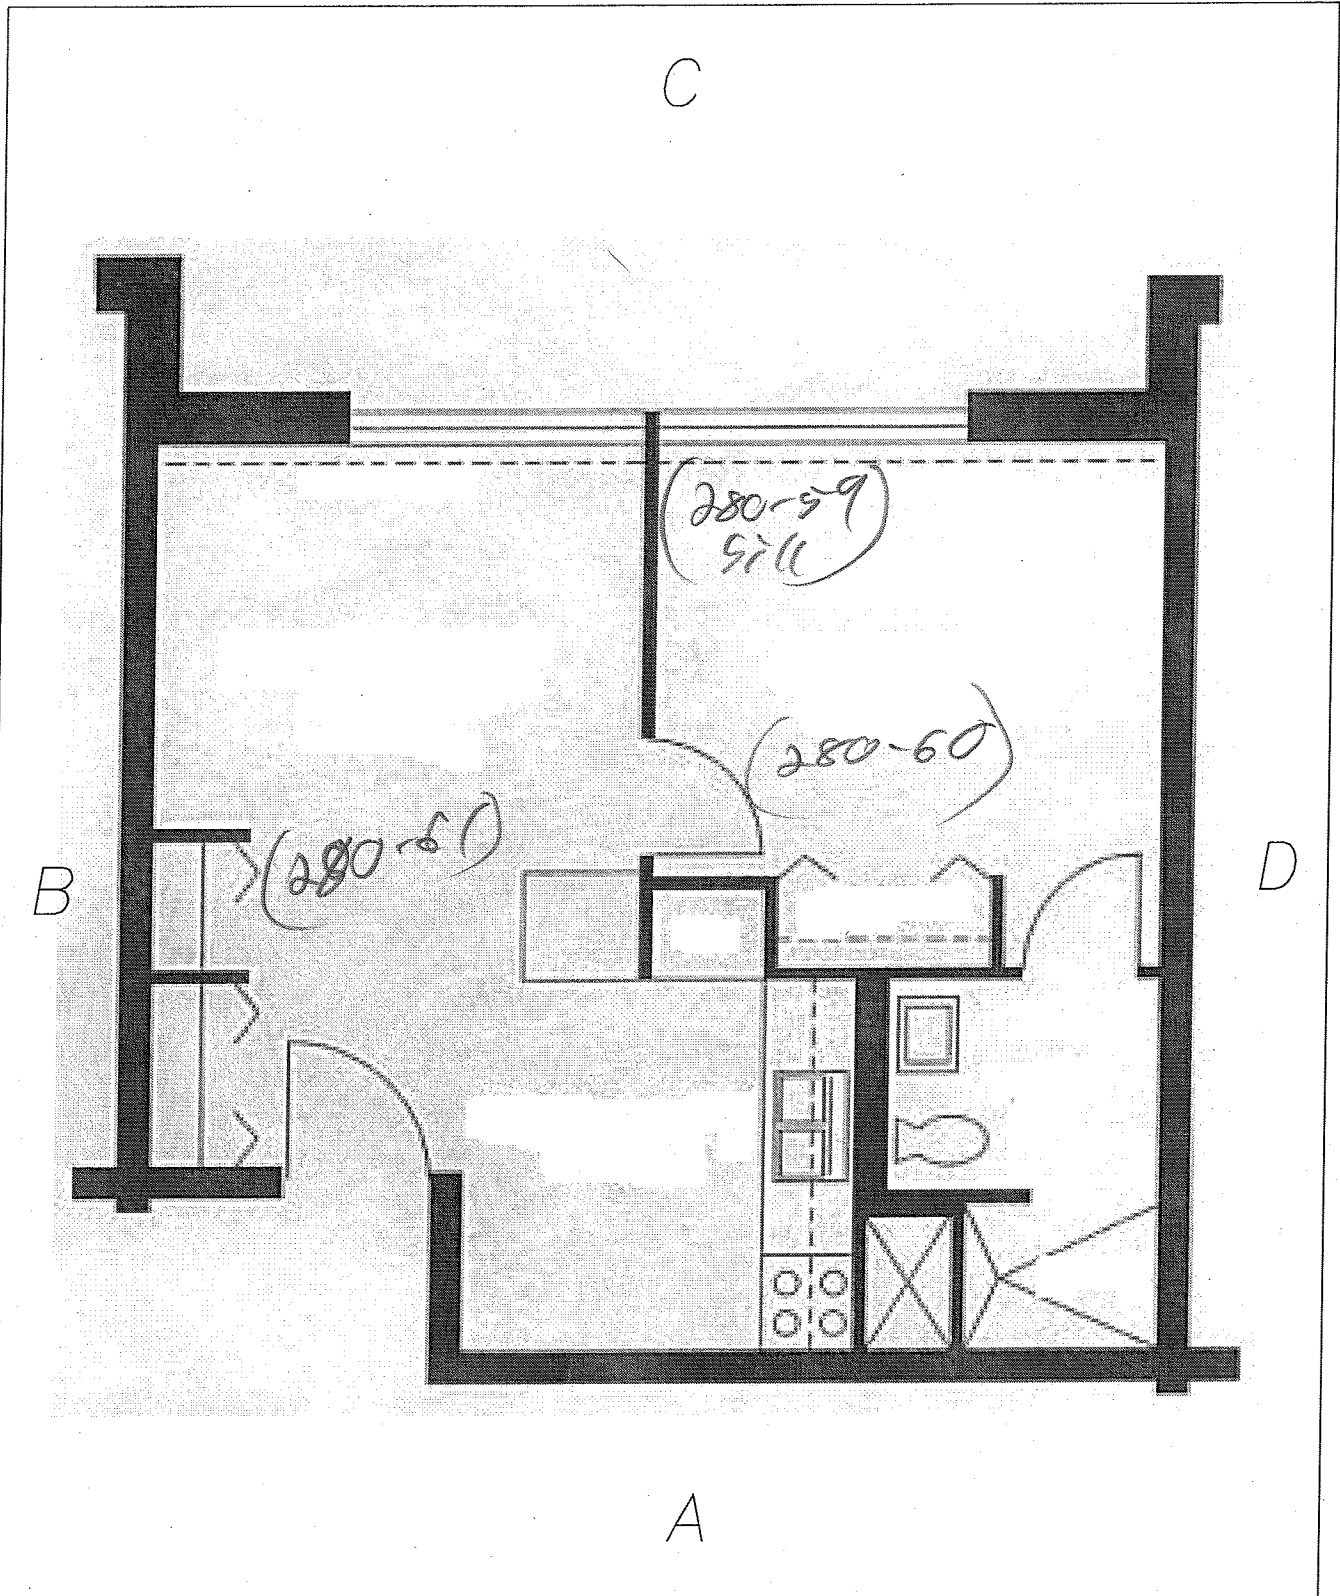



psi Information
 To Build On
 Engineering • Consulting • Testing
 Environmental Services
 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120
 PHONE: (651) 646-8148 FAX: (651) 646-8258

PHA Hi-Rise Risk Assessment

Ravoux- Hi-Rise
 280 Ravoux Street
 St. Paul, Minnesota 55103

Unit: 107
 Date: 11-05-10
 File Name: Unit Layout A-2 Single Bedroom
 Project Number: 0673226-11

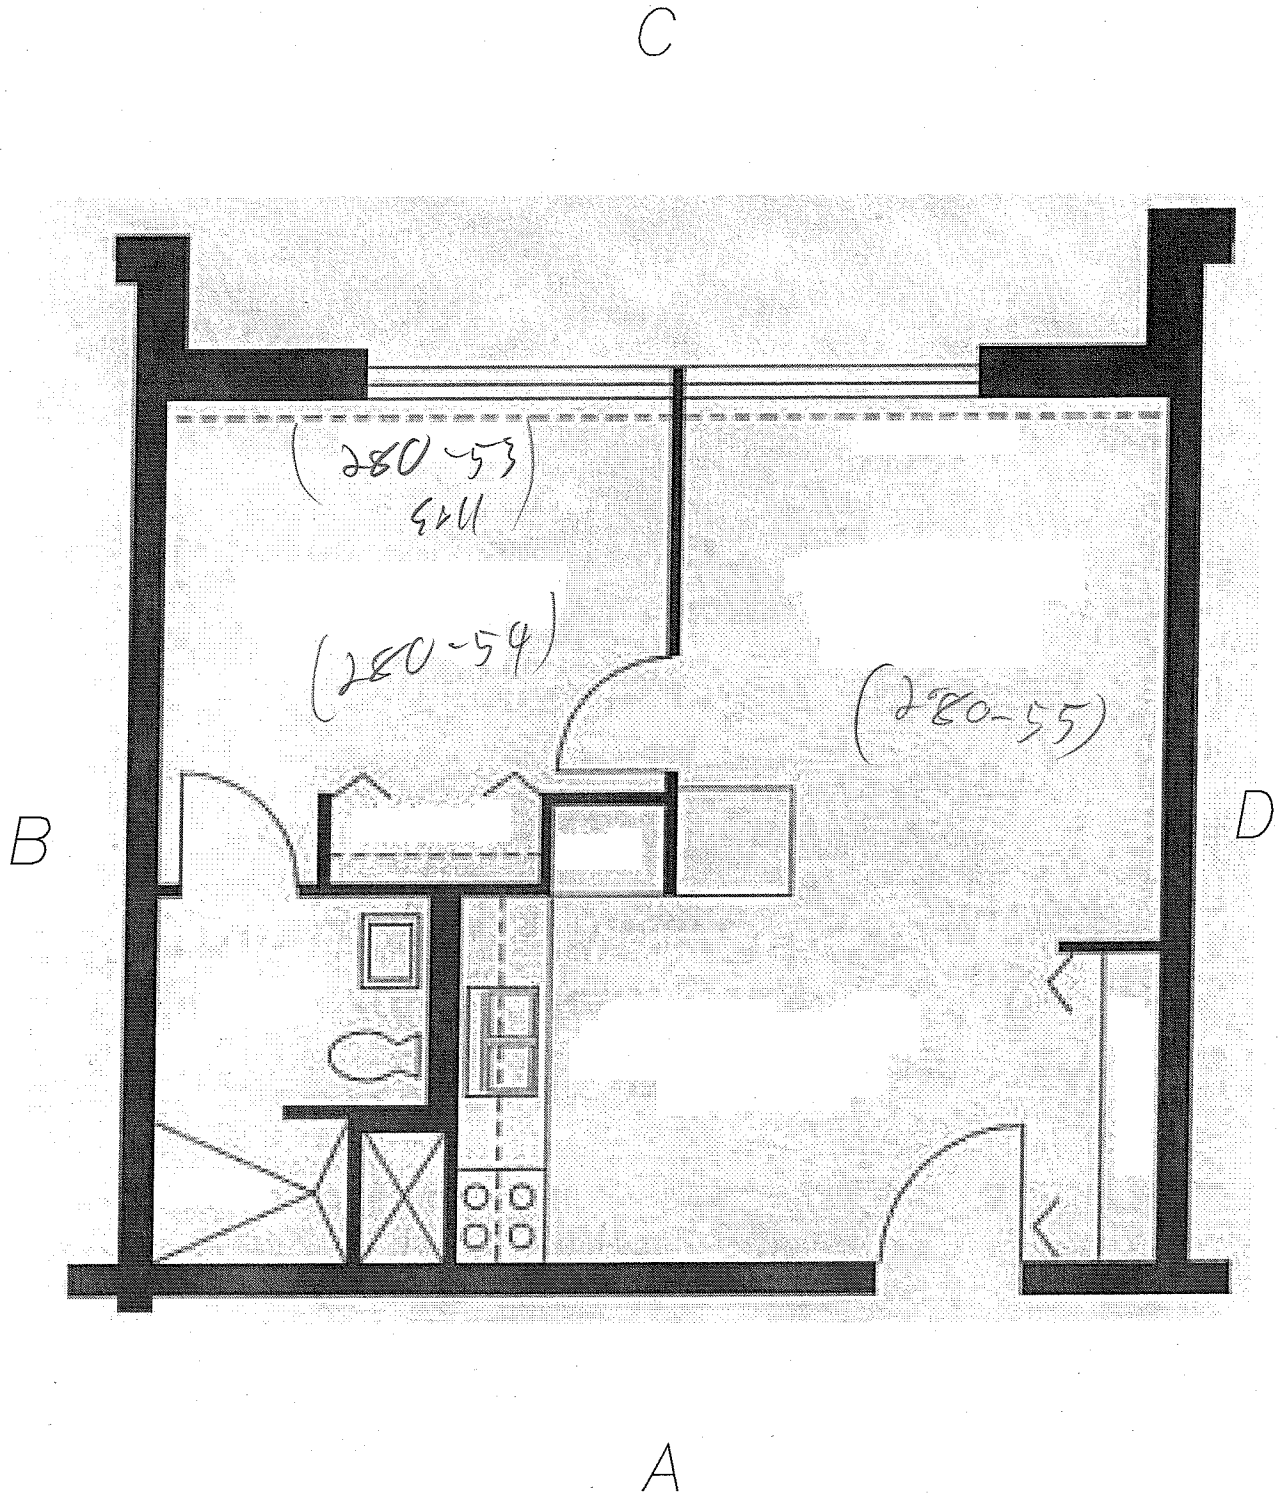

 Information To Build On Engineering • Consulting • Testing <u>Environmental Services</u> 2401 Pilot Knob Road, #138, Mendota Heights, MN 55120 PHONE: (651) 646-8148 FAX: (651) 646-8258	PHA Hi-Rise Risk Assessment	Unit: <u>119</u>
	Ravoux- Hi-Rise 280 Ravoux Street St. Paul, Minnesota 55103	Date: 11-05-10
		File Name: Type B-1 Studio
		Project Number: 0673226-11

SECTION B: PROPERTY CONDITION

B-1:	BUILDING CONDITION CHECKLIST
B-2:	PAINT CONDITION ON SELECTED SURFACES

DESCRIPTION OF CONTENTS

The section includes required information about the condition of the home and overall condition of paint. The documents included are:

B-1: The Building Condition Checklist identifies the overall condition of the buildings on the property. These conditions can contribute to paint deterioration and may need to be corrected in order to stop further deterioration. For instance, a leaky roof may allow water to seep into interior walls and damage paint. This building condition would need to be fixed in order to stop the source of deterioration.

VISUAL INSPECTION WORKSHEET

SECTION B

BUILDING CONDITION CHECKLIST

B-1

TOTAL: IF THERE ARE TWO OR MORE CHECKS IN THE BOXES BELOW, THE DWELLING IS CONSIDERED TO BE IN POOR CONDITION FOR THE PURPOSES OF A RISK ASSESSMENT.

- | | |
|---|---|
| <input type="checkbox"/> Roof is missing parts of surfaces: tiles, boards, shingles, etc.
<input type="checkbox"/> Roof has large holes or cracks
<input type="checkbox"/> Gutters/downspouts broken
<input type="checkbox"/> Chimney cracked, loose/ missing bricks out of plumb
<input type="checkbox"/> Exterior/Interior walls have cracks or holes | <input type="checkbox"/> Water stains on interior walls or ceilings
<input type="checkbox"/> Wall plaster or drywall is deteriorated
<input type="checkbox"/> Two or more doors or windows missing or boarded up
<input type="checkbox"/> Porch steps have missing or broken parts
<input type="checkbox"/> Foundation damaged or structure leans or is unsound |
|---|---|

PAINT CONDITION ON SELECTED SURFACES

B-2

Identify any painted components with visible bite marks here: NONE

Building Component	Paint Condition (I)ntact (F)air (P)oor	Friction or Impact Damage (Y/N)	Moisture Deterioration (Y/N)
Interior Doors	I	N	N
Ceilings	I	N	N
Walls	I	N	N
Interior Windows	I	N	N
Interior Floors	I	N	N
Interior Trim	I	N	N
Stairways	I	N	N
Radiators/Covers	I	N	N
Kitchen Cabinets	I	N	N
Bathroom Cabinets	I	N	N

Paint in Poor Condition:

- (a) More than 10 S.F. on an exterior component with large surface area (b) More than 2 S.F. on an interior component with a large surface area
 (c) More than 10% of total surface area on an interior /exterior component with small surface area.

SECTION C: OWNERSHIP AND OCCUPANCY

C-1: PROPERTY DESCRIPTION
C-2: OCCUPANT INFORMATION

DESCRIPTION OF CONTENTS

The section includes:

- C-1 A physical description of the house, property and other buildings
- C-2 Information about **current** occupancy as of the date of this report.

PROPERTY DESCRIPTION C-1

Property Address:	280 Ravoux Street, St. Paul, Minnesota
Current property owner:	Public Housing Agency of the City of St. Paul
Owner current address:	555 Wabasha Street North, Suite 400, St. Paul, MN
Owner Contact:	Dave Lang (651)298-5664
All levels excluding basements/attics:	8
Single or Multi-family:	Multi-family Hi-rise
Construction type:	Concrete
Original year built:	1970

CURRENT OCCUPANCY C-2

Number of apartment units:	220
Percent Occupancy:	99%

SECTION D: SAMPLING PROCEDURES

D-1:	PAINT CHIPS
D-2:	DUST
D-3:	SOIL

DESCRIPTION OF CONTENTS: This section describes procedures used to collect samples

PAINT CHIP SAMPLING PROCEDURE D-1

Paint is considered lead-based if the laboratory analysis is 5,000 micrograms per gram ($\mu\text{g/g}$) or 0.5%. Paint chip samples may be collected and analyzed for lead content. When paint is sample, the risk assessor will use the following procedure:

- The paint is scraped down to the original surface and placed into a clean, labeled container.
- The sample area and tools are cleaned with a damp disposable wipe cloth and the sample location is repaired.
- Samples are submitted for analysis to the Minneapolis Public Health Laboratory. Lead content is reported either in micrograms per gram ($\mu\text{g/g}$) or percent by weight (% by wt.).
- The risk assessor may include paint sampling locations on the diagram located in Section A-4 of this report
- The results of all paint sampling are included in section A of this report.

DUST SAMPLING PROCEDURE D-2

Dust is considered lead-contaminated if the laboratory reports any of the following:

Floors: 40 micrograms per square foot ($\mu\text{g}/\text{ft}^2$) Sills: 250 ($\mu\text{g}/\text{ft}^2$) Troughs: 400 ($\mu\text{g}/\text{ft}^2$)

Dust wipe samples are collected according to HUD Guidelines in each area where a child, 6 or under, is most likely to come into contact with lead-contaminated dust. Dust samples are collected using the following method:

- A specific area of an interior window sill (also called stool), window trough (also called the window well) is measured and marked.
- The risk assessor uses an approved sampling wipe with a gloved hand to wipe across the sampling area in a series of "S" patterns.
- The wipe is then placed in a container labeled with the site and sample location and size of the sample area.
- Samples are then analyzed by the Minneapolis Public Health Laboratory
- The risk assessor may include dust sample locations on the diagram located in Section A-4 of this report.
- The results of all dust sampling and sample locations are included in section A of this report.

SOIL SAMPLING PROCEDURE D-3

Laboratory results for soil may be reported in parts per million (ppm) or micrograms per gram ($\mu\text{g/g}$). Soil is considered lead-contaminated if the lead content is 400 ppm or $\mu\text{g/g}$ in a play area, or 1200 ppm or $\mu\text{g/g}$ around the house foundation or other bare soil areas.

- The assessor will collect soil using a clean, rigid container, from the upper $\frac{1}{2}$ inch of soil
- Soil samples from several locations may be added together (composited)
- The risk assessor may identify soil sample locations on the diagram in Section A-4 of this report.
- Samples are then sent to the Minneapolis Public Health Laboratory for analysis.
- The results of all soil sampling and sample locations are included in section A of this report.

SECTION E: HAZARD REDUCTION AND RELATED REQUIREMENTS

E-1:	STANDARD RE-EVALUATION SCHEDULE
E-2:	DISCLOSURE NOTICE
E-3:	REMEDIATION COST ESTIMATES

DESCRIPTION OF CONTENTS

This section includes a plan for the property owner to monitor the lead-related hazards identified during the assessment and a notice which must be given to future tenants or buyers. Additional guidance for getting help with the permanent elimination of lead-related hazards is also provided. The documents are organized as follows:

E.1 Standard Re-evaluation Schedule: This is a property owner responsibility. A plan for performing a re-evaluation and regular limited assessments is provided here.

E.2 Disclosure Notice: This is a property owner responsibility. This notice should be provided, along with this report and the EPA brochure entitled, "Protect Your Family from Lead in Your Home", to any potential buyer or anyone leasing the property before closing the transaction.

E.3 Remediation Cost Estimates: The table in this section provides approximate cost information only. Abatement costs vary according to location, materials used and market changes. These prices are not intended to be used for bid purposes. PSI encourages the client to solicit actual bids from qualified lead abatement contractors for any work resulting from this assessment.

STANDARD RE-EVALUATION SCHEDULE

E-1

A Re-evaluation is a follow-up limited risk assessment to determine the effectiveness of implemented hazard controls and whether new hazards have developed. The Reevaluation and Owner Visual Survey schedules are established by using the hazard evaluation results and the actions which will be taken (abatement / interim controls) to reduce existing hazards. The reevaluation must be performed by a licensed risk assessor and will be implemented in order to discover:

- ✓ The presence of leaded dust above applicable standards
- ✓ Newly deteriorated known or suspected lead-based paint
- ✓ Deteriorated or failed interim controls, encapsulants or enclosure treatments
- ✓ New bare soil with lead levels above applicable standards

Reevaluation is not required for enclosure or encapsulation. The following schedule establishes when the reevaluation must be performed if it is required.

An Owner Visual Survey is a periodic task performed by an owner or owner's representative which will be implemented in order to discover:

- ✓ New deterioration on known or suspected lead based paint surfaces
- ✓ Deteriorated or failed interim controls, encapsulants or enclosure treatments
- ✓ Structural problems which may threaten the integrity of any known or suspected lead-based paint.

If any hazards are eliminated with the use of encapsulants, check for signs of deterioration or detachment from the surface about one month after application, again after 6 months and annually thereafter. For enclosures, monitor annually. The following schedule establishes when the visual survey must be performed.

STANDARD REEVALUATION SCHEDULE

Schedule	Evaluation Results	Action Taken	Reevaluation Frequency and Duration	Owner Visual Survey
1	<input type="checkbox"/> Combination risk assessment/inspection finds no leaded dust or soil and no LBP	<input type="checkbox"/> None	<input type="checkbox"/> None	<input type="checkbox"/> None
2	<input checked="" type="checkbox"/> No lead-based paint hazards found during risk assessment conducted before hazard control or at clearance (hazards include dust & soil)	<input checked="" type="checkbox"/> None	<input checked="" type="checkbox"/> 3 Years	<input checked="" type="checkbox"/> Annually and whenever information indicates a possible problem
3	<input type="checkbox"/> The average of leaded dust levels on all floors, interior sills or window troughs sampled exceeds the applicable standard but by less than a factor of 10	<input type="checkbox"/> Interim controls and/or hazard abatement or mix of both including, but not necessarily limited to, dust removal. (excluding window replacement)	<input type="checkbox"/> 1 Year, 2 Years	<input type="checkbox"/> Same as schedule 2, except for encapsulants. The first visual survey of encapsulants to be done one month after clearance; the second done 6 months later and annually thereafter
		<input checked="" type="checkbox"/> Treatments specified in section A (including window replacement)	<input checked="" type="checkbox"/> 1 Year	<input checked="" type="checkbox"/> Same as schedule 2, except for encapsulants. The first visual survey of encapsulants to be done one month after clearance; the second done 6 months later and annually thereafter
		<input type="checkbox"/> Abatement of all LBP using encapsulation or enclosure	<input type="checkbox"/> None	<input type="checkbox"/> Same as above
		<input type="checkbox"/> Removal of all lead-based paint	<input type="checkbox"/> None	<input type="checkbox"/> None
4	<input type="checkbox"/> The average of leaded dust levels on all floors, interior window sills or window troughs sampled exceeds the applicable standard by a factor of 10 or more	<input type="checkbox"/> Interim controls and/or abatement or mix of two including but not necessarily limited to dust removal. (excluding window replacement)	<input type="checkbox"/> 6 Months, 1 Year, 2 Years	<input type="checkbox"/> Same as schedule 3
		<input type="checkbox"/> Treatments specified in A (including window replacement)	<input type="checkbox"/> 6 Months, 2 Years	<input type="checkbox"/> Same as schedule 3
		<input type="checkbox"/> Abatement of all LBP using encapsulation and enclosure	<input type="checkbox"/> None	<input type="checkbox"/> Same as schedule 3
		<input type="checkbox"/> Removal of all LBP	<input type="checkbox"/> None	<input type="checkbox"/> None
5	<input type="checkbox"/> No leaded dust or leaded soil hazards identified, but LBP or LBP hazards are found	<input type="checkbox"/> Interim controls or mix of interim controls & abatement (excluding window replacement)	<input type="checkbox"/> 2 Years	<input type="checkbox"/> Same as schedule 3
		<input type="checkbox"/> Interim controls or mix of interim controls & abatement (including window replacement)	<input type="checkbox"/> 3 Years	<input type="checkbox"/> Same as schedule 3
		<input type="checkbox"/> Abatement of all LBP hazards but not all LBP	<input type="checkbox"/> 4 Years	<input type="checkbox"/> Same as schedule 3
		<input type="checkbox"/> Abatement of all LBP using encapsulation or enclosure	<input type="checkbox"/> None	<input type="checkbox"/> Same as schedule 3
		<input type="checkbox"/> Removal of all LBP	<input type="checkbox"/> None	<input type="checkbox"/> None
6	<input checked="" type="checkbox"/> Bare leaded soil exceeds standard but less than 5,000 µg/g	<input checked="" type="checkbox"/> Interim controls	<input checked="" type="checkbox"/> None	<input checked="" type="checkbox"/> Three months to check new ground cover, then annually to identify new bare spots
7	<input type="checkbox"/> Bare leaded soil greater than or equal to 5,000 µg/g	<input type="checkbox"/> Abatement (paving or removal)	<input type="checkbox"/> None	<input type="checkbox"/> None for removal, annually to identify new bare spots or deterioration of paving

This notice should accompany this report and be provided to any potential buyer or lessor of the property addressed in this assessment prior to any closing transaction.

The Federal Residential Lead-Based Paint Hazard Reduction Act, 42 U.S.C. 4852(d), requires sellers and landlords of most residential housing built before 1978 to disclose all available records and reports concerning lead-based paint or lead-based paint hazards, including the test results in this notice, to purchasers and tenants at the time of sale or lease or upon lease renewal. This disclosure must occur even if hazard reduction or abatement has been completed. Failure to disclose these test results is a violation of U.S. Housing and Urban Development and the U. S. Environmental Protection Agency regulations at 24 CFR Part 35 and 40 CFR Part 745 and can result in a fine up to \$11,000 per violation. To find out more information about your obligation under federal lead-based paint requirements, call 1-800-424-LEAD.

ABATEMENT & INTERIM CONTROLS COST ESTIMATES

The following estimates are a reflection of average prices for remediation work. Abatement costs vary according to location, materials used and market changes. These prices are not intended to be used for bid purposes. PSI encourages the client to solicit actual bids from qualified lead abatement contractors for any work resulting from this assessment

Abatement Methods	Cost / Unit	Interim Control Methods	Cost / Unit
Scrape/Encapsulate Wood/Metal	\$4 / Sq Ft	Repair/Paint	\$2.00 / Sq Ft
Enclose Wood/Plaster/Drywall Surface	\$3-5 / Sq Ft	Repair/Paint	\$2.00/ Sq Ft
Replace windows	\$ 300-500 / ea	Line Troughs, reduce friction/ impact points	\$200-300 / ea
Replace door stops	\$30/ ea.	Repaint stops / install felt liners	\$5 / each
Replace door and casing	\$200-300 / ea.	Wet plane friction & impact points, repaint	\$20-30 ea.
Remove and replace contaminated soil	\$12 Cubic Ft	Rototill soil and seed or sod	\$3.50-5/Sq Ft

SECTION F: PHA MANAGEMENT INFORMATION

Management information as provided by the client on February 4, 2011, is included on the following pages.

Form 5.6 (continued)

Part 2: Management Information

- List names of individuals who have responsibility for lead-based paint. Include owner, property manager (if applicable), maintenance supervisor and staff (if applicable), and others. Include any training in lead hazard control work (by inspector, supervisor, worker, etc.) that has been completed. Use additional pages, if necessary.

This information will be needed to devise the risk management plan contained in the risk assessor's report.

Name	Position	Training completed (if none, enter "None")
PHA St. Paul	Owner	
XIONG THAO	Property manager	NONE
JOHN CONNOR	Maintenance	NONE

- Have there been previous lead-based paint evaluations?
 _____ Yes No (If yes, attach the report)
- Has there been previous lead hazard control activity?
 _____ Yes No (If yes, attach the report)
- Maintenance usually conducted at time of dwelling turnover, including typical cleaning, repainting, and repair activity.
 Repainting: WALL SURFACES
 Cleaning: WASH WINDOWS; CLEAN OF WAX FLOORS
 Repair: AS NEEDED
 Other: _____
 Comments: _____
- Employee and worker safety plan
 - Is there an occupational safety and health plan for maintenance workers?
 _____ Yes _____ No (If yes, attach plan)
 - Are workers trained in lead hazard recognition?
 _____ Yes No If yes, who performed the training? _____

Chapter 5: Risk Assessment

Form 5.6 (continued)

- c. Are workers involved in a hazard communication program?
_____ Yes No
- d. Are workers trained in proper use of respirators?
 Yes _____ No
- e. Is there a medical surveillance program?
_____ Yes No
6. Is a HEPA vacuum available?
_____ Yes No
7. Are there any onsite licensed or unlicensed day-care facilities?
_____ Yes No If yes, give location _____
8. Planning for resident children with elevated blood lead levels
- a. Who would respond for the owner if a resident child with an elevated blood lead level is identified?
Property Manager
- b. Is there a plan to relocate such children?
_____ Yes No If yes, where? _____
- c. Does the owner know if there ever has been a resident child with an elevated blood lead level?
_____ Yes _____ No Unknown
9. Owner Inspections
- a. Are there periodic inspections of all dwellings by the owner?
 Yes _____ No If yes, how often? Yearly
- b. Is the paint condition assessed during these inspections?
 Yes _____ No
10. Have any of the dwellings ever received a housing code violation notice?
_____ Yes _____ No Unknown
If yes, describe code violation _____
11. If previously detected, unabated lead-based paint exists in the dwelling, have the residents been informed?
_____ Yes _____ No Not Applicable

SECTION G: WARRANTY

The field and laboratory results reported herein are considered sufficient in detail and scope to determine the presence of accessible and/or exposed lead-based paint (LPB) for the building structure. Professional Service Industries (PSI), Inc., warrants that the findings contained herein have been prepared in general accordance with accepted professional practices at the time of its preparation as applied by professionals in the community. Changes in the state of the art or in applicable regulations cannot be anticipated and have not been addressed in this report. A copy of personnel certifications has been provided for your review. PSI's evaluation of the relative risk of exposure to lead identified during this assessment is based on conditions observed at the time of the evaluation. PSI cannot be responsible for changing conditions that may alter the relative exposure risk or future changes in accepted methodology.

The survey and analytical methods have been used to provide the client with information regarding the presence of accessible and/or exposed suspect LBP existing at the time of the inspection. Test results are valid only for the material(s) tested. There is a distinct possibility that conditions may exist which could not be identified within the scope of the study or which were not apparent during the site visit. This inspection covered only those areas that were exposed and/or physically accessible to the Inspector. The study is also limited to the information available from the client at the time it was conducted.

As directed by the client, PSI did not provide any service to investigate or detect the presence of moisture, mold or other biological contaminants in or around any structure, or any service that was designed or intended to prevent or lower the risk of the occurrence of the amplification of the same. Client acknowledges that mold is ubiquitous to the environment with mold amplification occurring when building materials are impacted by moisture. Client further acknowledges that site conditions are outside of PSI's control, and that mold amplification will likely occur, or continue to occur, in the presence of moisture. As such, PSI cannot and shall not be held responsible for the occurrence or recurrence of mold amplification.

No other warranties are implied or expressed.

SECTION H: CERTIFICATIONS

Minnesota Department of Health

has authorized

Professional Service Industries, Inc.

2401 Pilot Knob Rd #138

Mendota Heights, Minnesota 55120

in accordance with Minnesota Statutes, section 144.9505 and Minnesota Rules, part 4761.2200,
to practice in the State of Minnesota as a

Certified Lead Firm

License No: LF150

Expires 05/18/2012

This certificate is nontransferable.



Linda B. Bruemmer, Director
Division of Environmental Health

Certificate No: 5LM10011008PbRA

Issue Date: October 1, 2010

This diploma is awarded to

Stephen Luth

8542 Stevens Ave S Bloomington MN 55420

for successfully completing and passing the examination for the

**LEAD (Pb) RISK ASSESSOR
INITIAL TRAINING COURSE**


This training course is Approved by the State of Minnesota
under Minnesota Rules, parts 4761.2000 to 4761.2700
and meets the requirements of 40 CFR 745.225,
and Title X of the Toxic Substances Control Act (TSCA)

conducted by

Lake States Environmental, Ltd.

in


**White Bear Lake, MN on September 29 - October 1, 2010
Examination Date: October 1, 2010**

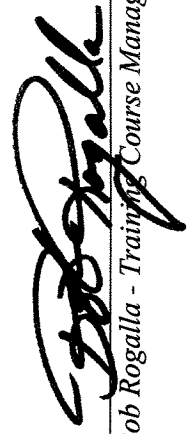

Bob Rogalla - Training Course Manager

Environmental, Ltd
Rice Lake, WI 54868

(800) 254-9811



**LEAD
Risk Assessor**

Licensed by:
State of Minnesota
Department of Health
License No. LR3835
Expires 10/01/2011

Stephen A Luth
8542 Stevens Ave
Bloomington, MN 55420

Fonda S. Guernsey
Director, Env. Health Div.

Certificate No: 5LM05271014PbRAR

Issue Date: May 27, 2010

This diploma is awarded to
Eric Brazeau
924 248th St. Osceola WI 54020
for successfully completing and passing the examination for the

**LEAD (Pb) RISK ASSESSOR
REFRESHER TRAINING COURSE**


This training course is Approved by the State of Minnesota
under Minnesota Rules, parts 4761.2000 to 4761.2700
and meets the requirements of 40 CFR 745.225,
and Title X of the Toxic Substances Control Act (TSCA)
conducted by

Lake States Environmental, Ltd.

in
White Bear Lake, MN on May 27, 2010
Examination Date: May 27, 2010


Bob Rogalla - Training Course Manager

Lake States Environmental, Ltd
P. O. Box 645, Rice Lake, WI 54868
(800) 254-9811



Janda S. Brunner
Director, Env. Health Div.

MINNESOTA
MDH LEAD
DEPARTMENT OF HEALTH Risk Assessor
Licensed by:
State of Minnesota
Department of Health
License No. LR664
Expires 05/27/2011

Eric D Brazeau
2401 Pilot Knob Rd #138
Mendota Heights, MN 55120

Certificate No: 5LM03071105PbRAR

Issue Date: March 7, 2011

This diploma is awarded to

Michael Tjaden

389 Pascal St S St Paul MN 55105

for successfully completing and passing the examination for the

**LEAD (Pb) RISK ASSESSOR
REFRESHER TRAINING COURSE**

This training course is Approved by the State of Minnesota
under Minnesota Rules, parts 4761.2000 to 4761.2700
and meets the requirements of 40 CFR 745.225,
and Title X of the Toxic Substances Control Act (TSCA)
conducted by


Lake States Environmental, Ltd.


in

White Bear Lake, MN on March 7, 2011

Examination Date: March 7, 2011

Lake States Environmental, Ltd
P. O. Box 645, Rice Lake, WI 54868
(800) 254-9811

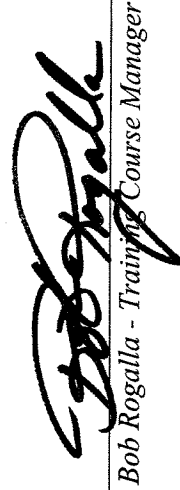
Bob Rogalla - Training Course Manager



MINNESOTA **MDH** LEAD
DEPARTMENT OF HEALTH Risk Assessor

Licensed by:
State of Minnesota
Department of Health
License No. LR316
Expires 03/07/2012

Michael E Tjaden
389 Pascal St S
St Paul, MN 55105


Director, Env. Health Div.



AIHA

Laboratory Accreditation
Programs, LLC

AIHA Laboratory Accreditation Programs, LLC

acknowledges that

PSI - Professional Service Industries, Inc.

850 Poplar Street, Pittsburgh, PA 15220

Laboratory ID: 100373

has fulfilled the requirements of the AIHA Laboratory Accreditation Programs (AIHA-LAP), LLC thereby, conforming to the ISO/IEC 17025:2005 international standard, *General Requirements for the Competence of Testing and Calibration Laboratories*. The above named laboratory, along with all premises from which key activities are performed, as listed above, have been accredited by AIHA-LAP, LLC in the following:

ACCREDITATION PROGRAMS

- | | | |
|-------------------------------------|-----------------------------------|-----------------------------------|
| <input checked="" type="checkbox"/> | INDUSTRIAL HYGIENE | Accreditation Expires: 01/01/2012 |
| <input checked="" type="checkbox"/> | ENVIRONMENTAL LEAD | Accreditation Expires: 01/01/2012 |
| <input checked="" type="checkbox"/> | ENVIRONMENTAL MICROBIOLOGY | Accreditation Expires: 01/01/2012 |
| <input type="checkbox"/> | FOOD | Accreditation Expires: |

Specific Field(s) of Testing (FoT)/Method(s) within each Accreditation Program for which the above named laboratory maintains accreditation is outlined on the attached **Scope of Accreditation**. Continued accreditation is contingent upon successful on-going compliance with LQAP requirements. This certificate is not valid without the attached **Scope of Accreditation**. Please review the AIHA website for the most current status of the scope of accreditation.



Pamela A. Kostle, CIH
Chairperson, Analytical Accreditation Board

Date Issued: 12/01/2009



AIHA Laboratory Accreditation Programs, LLC SCOPE OF ACCREDITATION

PSI - Professional Service Industries, Inc.
850 Poplar Street, Pittsburgh, PA 15220

Laboratory ID: **100373**
Issue Date: 12/01/2009

The laboratory is approved for those specific field(s) of testing/methods listed in the table below. Clients are urged to verify the laboratory's current accreditation status for the particular field(s) of testing/Methods, since these can change due to proficiency status, suspension and/or revocation. A complete listing of currently accredited Industrial Hygiene laboratories is available on the AIHA-LAP, LLC website at: <http://www.aihaaccreditedlabs.org>

The EPA recognizes the AIHA-LAP, LLC ELLAP program as meeting the requirements of the National Lead Laboratory Accreditation Program (NLLAP) established under Title X of the Residential Lead-Based Paint Hazard Reduction Act of 1992 and includes paint, soil and dust wipe analysis. Air analysis is not included as part of the NLLAP.

Environmental Lead Laboratory Accreditation Program (ELLAP)

Initial Accreditation Date: 06/07/1996

Field of Testing (FoT)	Method	Method Description <i>(for internal methods only)</i>
Paint	EPA SW-846 7420	
Settled Dust by Wipe	EPA SW-846 7420	
Soil	EPA SW-846 7420	

The laboratory participates in the following AIHA-LAP, LLC testing programs:

- Paint
- Soil
- Settled Dust by Wipe
- Airborne Dust